

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for
Cooper Lighting Solutions
(formerly Eaton)

Brand: PORTFOLIO

Report Number: P250599

Luminaire Tested: **LSR8B120D010 EC8B120940 8LBM0B**

Issue Date: 03/03/2020

Test Information

Test Method: LM-79-08
Report Number: P250599
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P13928)
Test Lab: INNOVATION CENTER-P1
Issue Date: 03/03/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: PORTFOLIO
Catalog Number: LSR8B120D010 EC8B120940 8LBM0B
Description: PORTFOLIO 8 INCH MEDIUM DISTRIBUTION 55 DEG CUTOFF RECESSED
DOWNLIGHT- CYLINDEC
90 CRI 4000 CCT WITH SPECULAR BLACK TRIM
Light Source: -
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 7001.0 lumens
Efficiency: N/A
Efficacy: 59.2 lumens/watt
Spacing Criteria (0/90/45): 0.79 / 0.79 / 0.87
Luminous Opening: Circular (Dia: 0.67' x H: 0')
CIE Type: Direct


Input Watts (W): 118.3
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P250599

CATALOG NUMBER: LSR8B120D010 EC8B120940 8LBM0B

Luminous Intensity Polar Plot

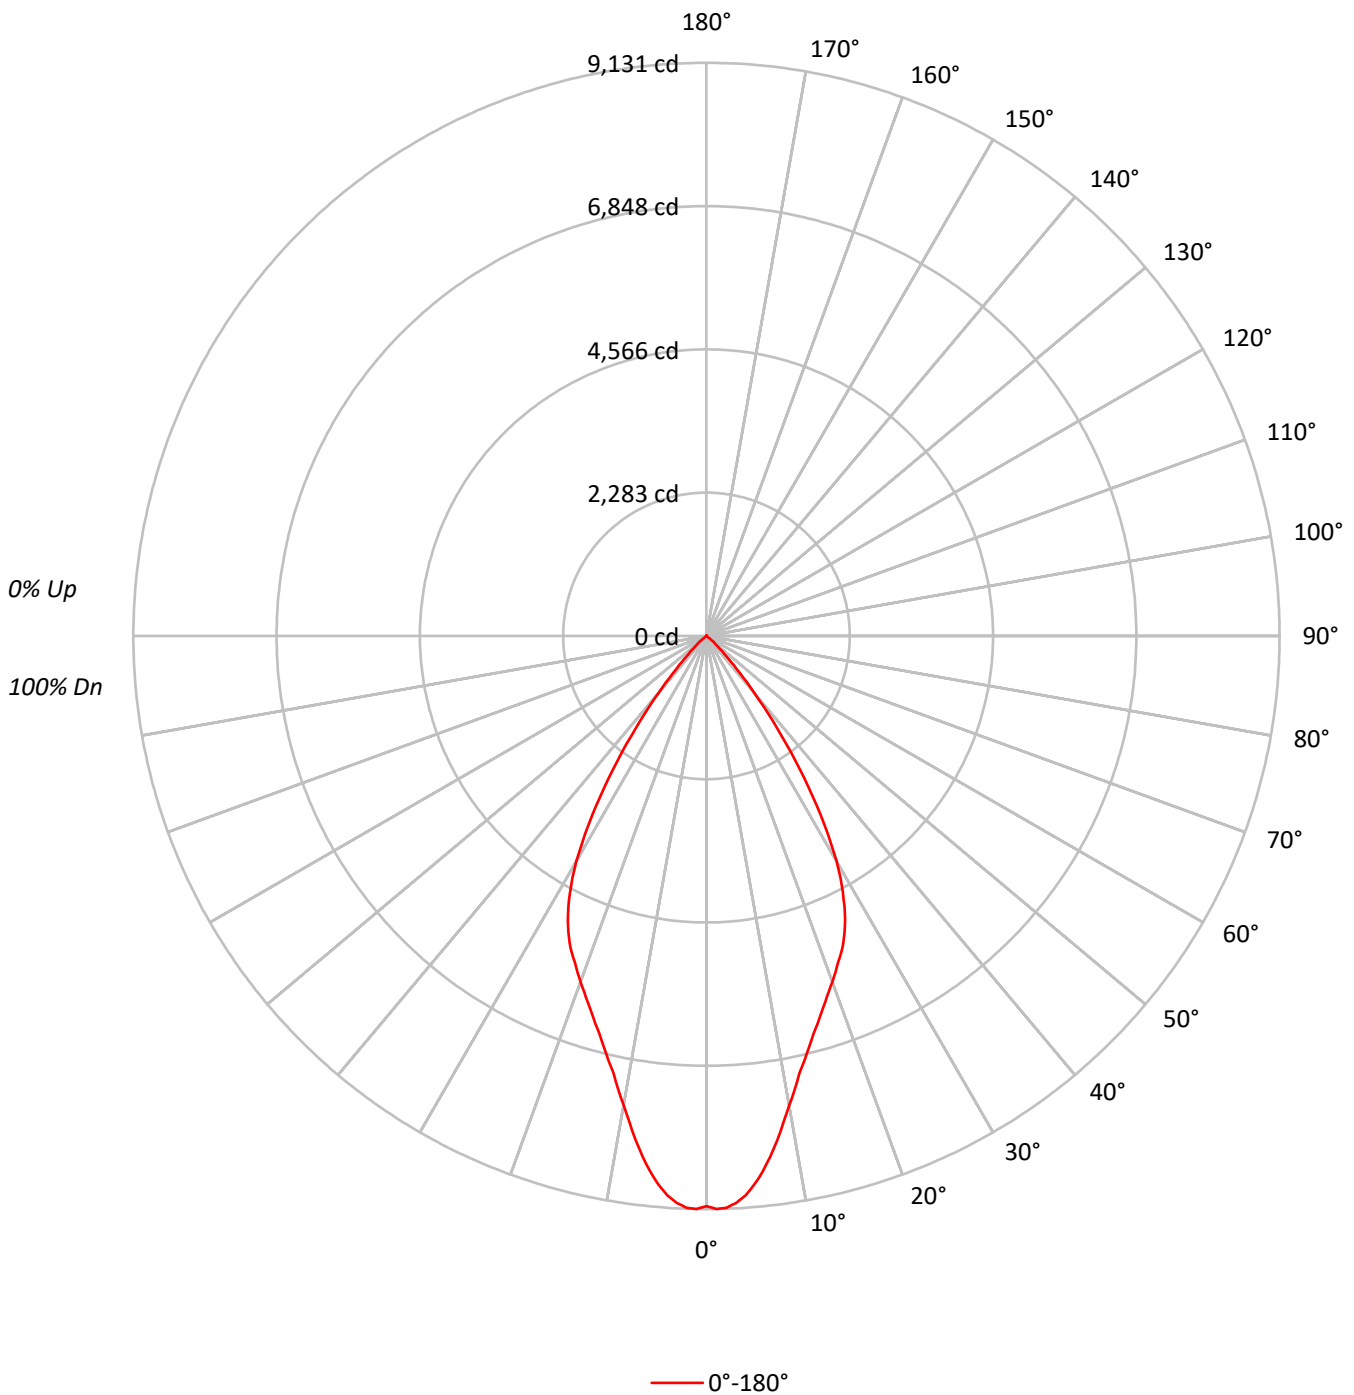



TEST NUMBER: P250599

CATALOG NUMBER: LSR8B120D010 EC8B120940 8LBM0B

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10	0		
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50	30	10	0
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102	102	102	100
1	114	111	108	106	111	109	107	105	105	103	101		101	100	98		98	97	96	94
2	108	103	99	96	106	102	98	95	98	95	93		95	93	91		93	91	89	87
3	103	96	92	88	101	95	91	87	92	89	86		90	87	84		88	85	83	81
4	98	90	85	81	96	89	84	80	87	83	79		85	81	78		83	80	77	76
5	93	85	79	75	91	84	78	74	82	77	74		80	76	73		79	75	72	71
6	88	79	74	69	87	79	73	69	77	72	69		76	71	68		74	71	68	66
7	84	75	69	65	83	74	68	64	73	68	64		72	67	64		70	66	63	62
8	80	70	64	60	79	70	64	60	69	64	60		68	63	60		67	63	60	58
9	76	66	61	57	75	66	60	57	65	60	56		64	60	56		63	59	56	55
10	72	63	57	53	71	62	57	53	62	57	53		61	56	53		60	56	53	51

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	280117
5°	271554
10°	237827
15°	209968
20°	192400
25°	177157
30°	147451
35°	97939
40°	47665
45°	17265
50°	5195
55°	366
60°	0
65°	248
70°	0
75°	0
80°	604
85°	0



TEST NUMBER: P250599

CATALOG NUMBER: LSR8B120D010 EC8B120940 8LBM0B

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	797.9	11.4
10°-20°	1853.0	26.5
20°-30°	2350.8	33.6
30°-40°	1610.5	23.0
40°-50°	367.0	5.2
50°-60°	18.3	0.3
60°-70°	0.8	0.0
70°-80°	1.3	0.0
80°-90°	1.4	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	5001.7	71.4
0°-40°	6612.1	94.4
0°-60°	6997.4	99.9
0°-90°	7001.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	7001.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	9084	
5°	8773	798
15°	6577	1853
25°	5207	2351
35°	2602	1610
45°	396	367
55°	7	18
65°	3	1
75°	0	1
85°	0	1
90°	0	



TEST NUMBER: P250599

CATALOG NUMBER: LSR8B120D010 EC8B120940 8LBM0B

CANDELA DISTRIBUTION (FULL):

0°	
0°	9084.0
1°	9131.4
2°	9114.4
3°	9046.8
4°	8931.7
5°	8772.8
6°	8579.9
7°	8356.6
8°	8109.6
9°	7845.7
10°	7595.4
11°	7365.3
12°	7118.4
13°	6939.1
14°	6749.6
15°	6577.1
16°	6421.4
17°	6269.1
18°	6127.1
19°	5988.3
20°	5863.1
21°	5734.6
22°	5602.6
23°	5487.6
24°	5359.1
25°	5206.8
26°	5037.6
27°	4841.4
28°	4631.7
29°	4398.2
30°	4141.1
31°	3850.1
32°	3549.0
33°	3234.4
34°	2912.9
35°	2601.7
37.5°	1837.1
40°	1184.1
42.5°	696.9
45°	395.9
47.5°	213.2
50°	108.3
52.5°	20.3
55°	6.8
57.5°	3.4



TEST NUMBER: P250599

CATALOG NUMBER: LSR8B120D010 EC8B120940 8LBM0B

CANDELA DISTRIBUTION (continued):

	0°
60°	0.0
62.5°	0.0
65°	3.4
67.5°	0.0
70°	0.0
72.5°	3.4
75°	0.0
77.5°	0.0
80°	3.4
82.5°	0.0
85°	0.0
87.5°	3.4
90°	0.0

(END OF REPORT)