

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for
Cooper Lighting Solutions
(formerly Eaton)

Brand: PORTFOLIO

Report Number: P247300

Luminaire Tested: **LD8B100D010 ER8B100840 8LBM0WMH**

Issue Date: 03/03/2020

Test Information

Test Method: LM-79-08
Report Number: P247300
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P201734)
Test Lab: INNOVATION CENTER-P1
Issue Date: 03/03/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: PORTFOLIO
Catalog Number: LD8B100D010 ER8B100840 8LBM0WMH
Description: PORTFOLIO 8 INCH MEDIUM DISTRIBUTION 55 DEG CUTOFF RECESSED
DOWNLIGHT
80 CRI 4000 CCT WITH WARM HAZE TRIM
Light Source: -
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 10277.0 lumens
Efficiency: N/A
Efficacy: 96.7 lumens/watt
Spacing Criteria (0/90/45): 0.9 / 0.9 / 0.9
Luminous Opening: Circular (Dia: 0.67' x H: 0')
CIE Type: Direct


Input Watts (W): 106.3
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P247300

CATALOG NUMBER: LD8B100D010 ER8B100840 8LBM0WMH

Luminous Intensity Polar Plot

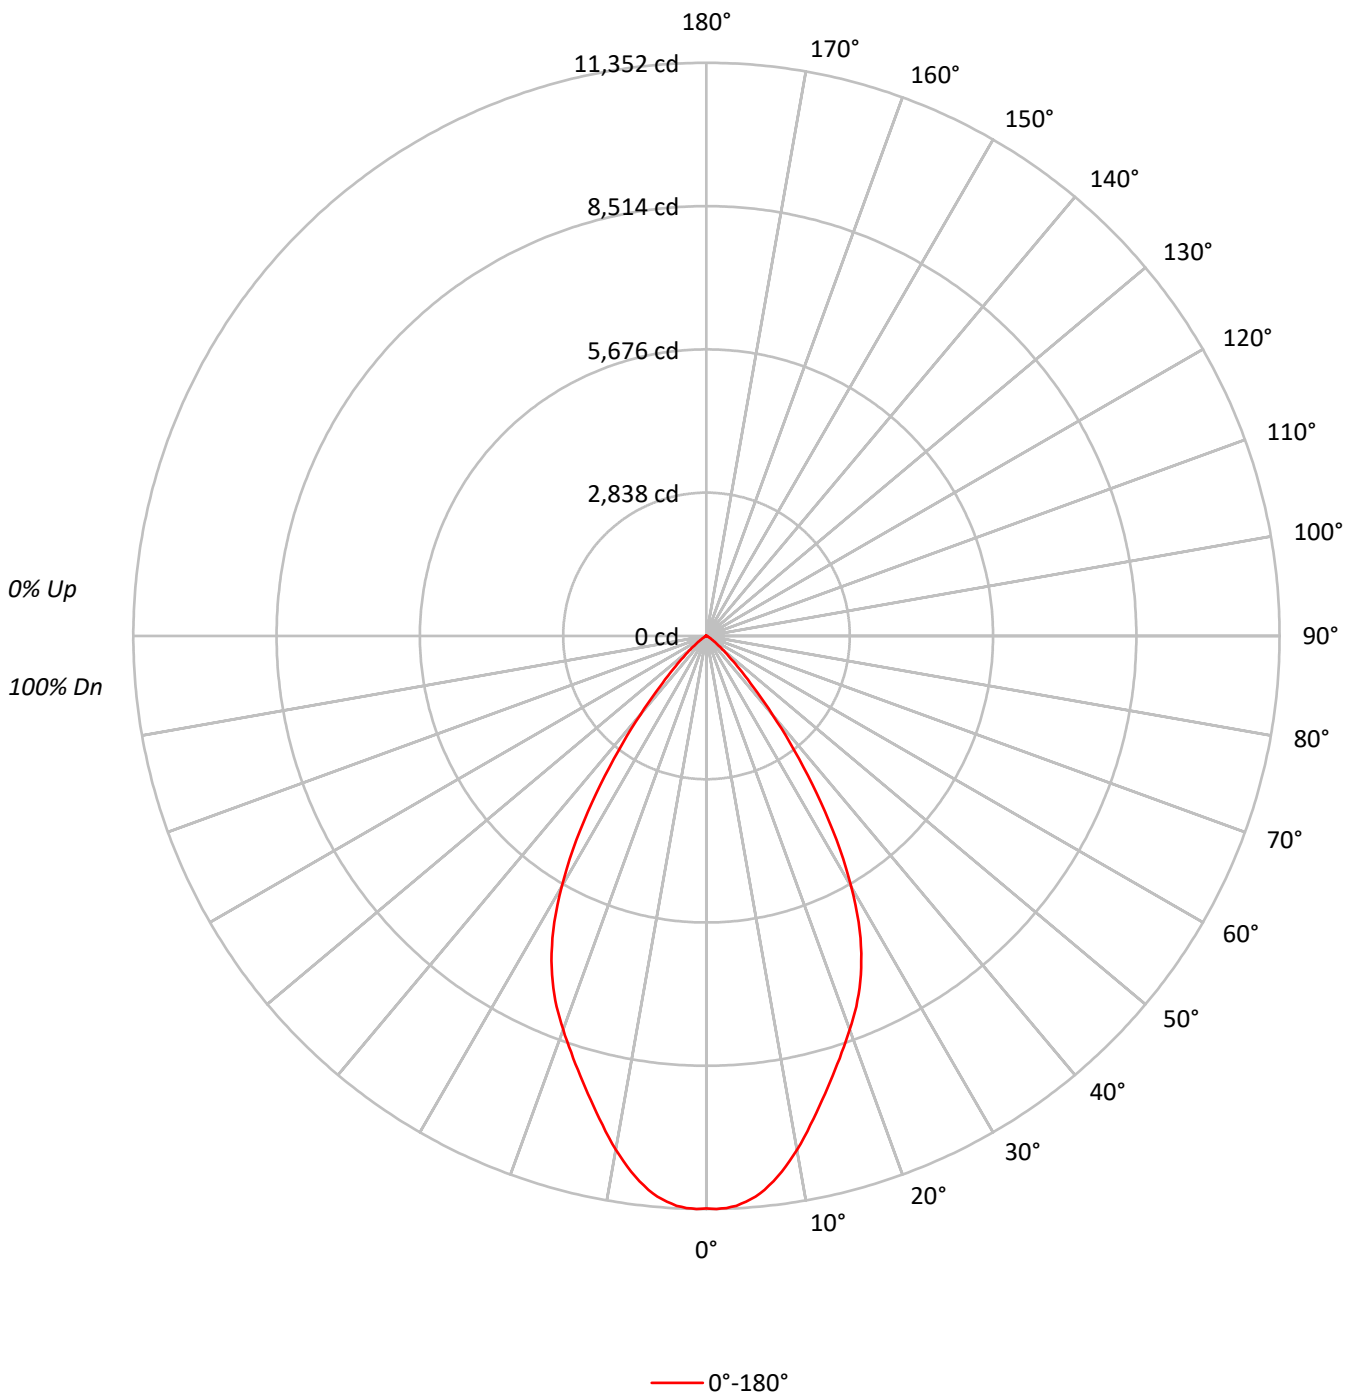



TEST NUMBER: P247300

CATALOG NUMBER: LD8B100D010 ER8B100840 8LBM0WMH

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10	0		
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50	30	10	0
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102	102	102	100
1	113	111	108	106	111	108	106	104	104	103	101		101	99	98		97	96	95	93
2	108	103	99	95	105	101	97	94	98	95	92		95	92	90		92	90	88	86
3	102	95	90	86	100	94	89	86	91	87	84		89	86	83		87	84	82	80
4	97	89	83	79	95	88	82	78	86	81	77		84	80	77		82	78	76	74
5	92	83	77	73	90	82	76	72	80	75	72		79	74	71		77	73	70	69
6	87	78	72	67	85	77	71	67	75	70	66		74	69	66		73	69	66	64
7	82	73	67	62	81	72	66	62	71	66	62		70	65	61		68	64	61	60
8	78	68	62	58	77	68	62	58	67	61	58		66	61	57		65	60	57	56
9	74	64	58	54	73	64	58	54	63	58	54		62	57	54		61	57	54	52
10	71	61	55	51	70	60	55	51	60	54	51		59	54	51		58	54	50	49

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	349579
5°	345073
10°	323509
15°	295828
20°	272341
25°	246773
30°	204333
35°	143300
40°	81546
45°	40020
50°	19741
55°	8957
60°	4243
65°	2298
70°	234
75°	310
80°	0
85°	0



TEST NUMBER: P247300

CATALOG NUMBER: LD8B100D010 ER8B100840 8LBM0WMH

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1037.4	10.1
10°-20°	2601.3	25.3
20°-30°	3283.8	32.0
30°-40°	2362.2	23.0
40°-50°	781.9	7.6
50°-60°	170.3	1.7
60°-70°	35.0	0.3
70°-80°	3.4	0.0
80°-90°	1.8	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	6922.5	67.4
0°-40°	9284.7	90.3
0°-60°	10236.8	99.6
0°-90°	10277.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	10277.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	11337	
5°	11148	###
15°	9267	2601
25°	7253	3284
35°	3807	2362
45°	918	782
55°	167	170
65°	32	35
75°	3	3
85°	0	2
90°	0	



TEST NUMBER: P247300

CATALOG NUMBER: LD8B100D010 ER8B100840 8LBM0WMH

CANDELA DISTRIBUTION (FULL):

	0°
0°	11336.6
1°	11352.5
2°	11339.2
3°	11301.8
4°	11232.3
5°	11147.9
6°	11032.0
7°	10881.0
8°	10714.4
9°	10532.2
10°	10331.8
11°	10127.2
12°	9904.5
13°	9689.8
14°	9473.8
15°	9266.6
16°	9062.7
17°	8867.2
18°	8673.3
19°	8486.9
20°	8299.2
21°	8107.0
22°	7919.3
23°	7715.0
24°	7494.8
25°	7252.9
26°	6998.9
27°	6716.1
28°	6417.0
29°	6084.8
30°	5738.6
31°	5374.6
32°	4991.4
33°	4589.3
34°	4196.1
35°	3806.7
37.5°	2858.7
40°	2025.8
42.5°	1372.4
45°	917.7
47.5°	615.7
50°	411.5
52.5°	248.4
55°	166.6
57.5°	115.9



TEST NUMBER: P247300

CATALOG NUMBER: LD8B100D010 ER8B100840 8LBM0WMH

CANDELA DISTRIBUTION (continued):

	0°
60°	68.8
62.5°	47.1
65°	31.5
67.5°	28.3
70°	2.6
72.5°	6.5
75°	2.6
77.5°	2.6
80°	0.0
82.5°	6.5
85°	0.0
87.5°	0.0
90°	0.0

(END OF REPORT)