

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for
Cooper Lighting Solutions
(formerly Eaton)

Brand: PORTFOLIO

Report Number: P250536

Luminaire Tested: **LD8B120D010 ER8B1209730 8LBM0GPH**

Issue Date: 03/03/2020

Test Information

Test Method: LM-79-08
Report Number: P250536
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (P14005)
Test Lab: INNOVATION CENTER-P1
Issue Date: 03/03/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: PORTFOLIO
Catalog Number: LD8B120D010 ER8B1209730 8LBM0GPH
Description: PORTFOLIO 8 INCH MEDIUM DISTRIBUTION 55 DEG CUTOFF RECESSED
DOWNLIGHT
97 CRI 3000 CCT WITH GRAPHITE TRIM
Light Source: -
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 7947.9 lumens
Efficiency: N/A
Efficacy: 67.2 lumens/watt
Spacing Criteria (0/90/45): 0.82 / 0.82 / 0.87
Luminous Opening: Point Source (0' x 0' x 0')
CIE Type: Direct


Input Watts (W): 118.3
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P250536

CATALOG NUMBER: LD8B120D010 ER8B1209730 8LBM0GPH

Luminous Intensity Polar Plot

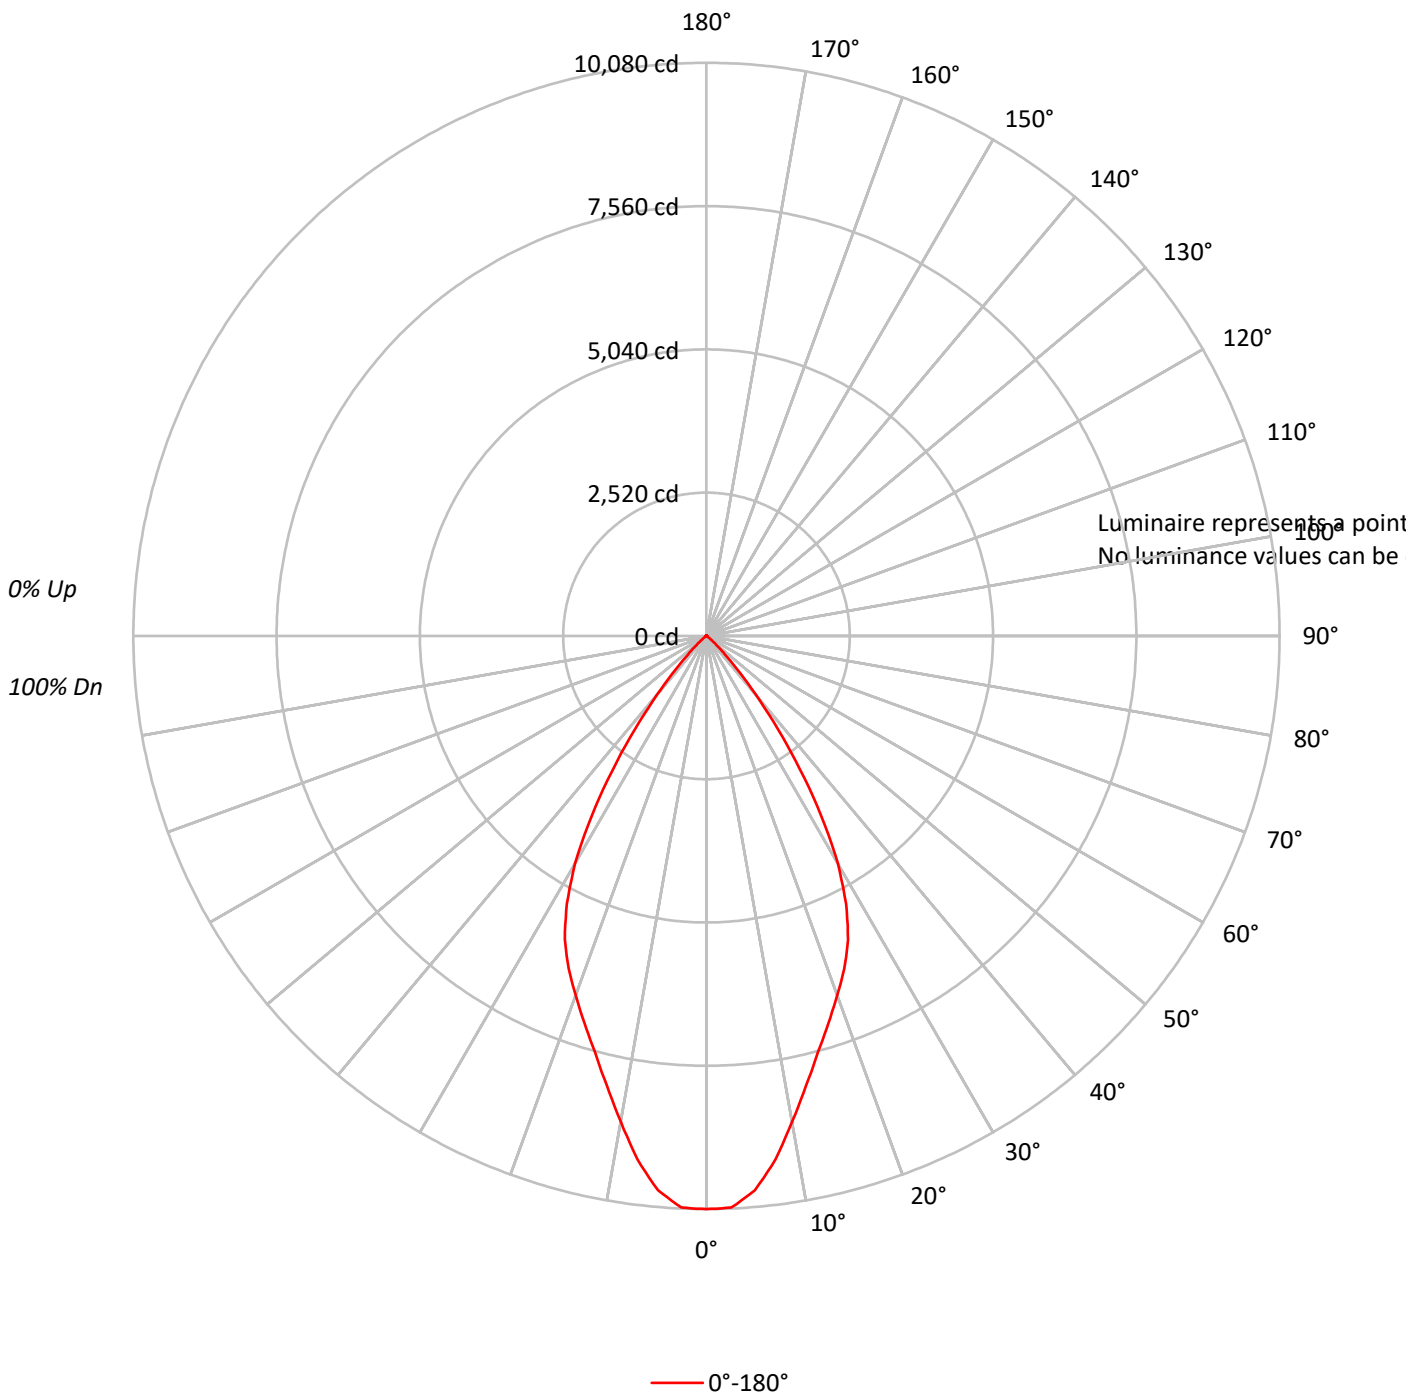



TEST NUMBER: P250536

CATALOG NUMBER: LD8B120D010 ER8B1209730 8LBM0GPH

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

| RF | 20 | | | | 20 | | | | 20 | | | | 20 | | | | 20 | | | | | | | |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|--|--|
| RC | 80 | | | | 70 | | | | 50 | | | | 30 | | | | 10 | | | | 0 | | | |
| RW | 70 | 50 | 30 | 10 | 70 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 0 | | | |
| RCR | | | | | | | | | | | | | | | | | | | | | | | | |
| 0 | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | 106 | 106 | 106 | 102 | 102 | 102 | 100 | 100 | 100 | 100 | 100 | | |
| 1 | 114 | 111 | 108 | 106 | 111 | 109 | 107 | 105 | 105 | 103 | 101 | 101 | 100 | 98 | 98 | 96 | 95 | 94 | 94 | 94 | 94 | 94 | | |
| 2 | 108 | 103 | 99 | 96 | 106 | 102 | 98 | 95 | 98 | 95 | 93 | 95 | 93 | 91 | 93 | 91 | 89 | 87 | 87 | 87 | 87 | 87 | | |
| 3 | 103 | 96 | 92 | 88 | 101 | 95 | 91 | 87 | 92 | 89 | 86 | 90 | 87 | 84 | 88 | 85 | 83 | 81 | 81 | 81 | 81 | 81 | | |
| 4 | 98 | 90 | 85 | 81 | 96 | 89 | 84 | 80 | 87 | 83 | 79 | 85 | 81 | 78 | 83 | 80 | 77 | 76 | 76 | 76 | 76 | 76 | | |
| 5 | 93 | 85 | 79 | 75 | 91 | 84 | 78 | 74 | 82 | 77 | 74 | 80 | 76 | 73 | 79 | 75 | 72 | 71 | 71 | 71 | 71 | 71 | | |
| 6 | 88 | 79 | 73 | 69 | 87 | 79 | 73 | 69 | 77 | 72 | 69 | 76 | 71 | 68 | 74 | 71 | 68 | 66 | 66 | 66 | 66 | 66 | | |
| 7 | 84 | 75 | 69 | 65 | 82 | 74 | 68 | 64 | 73 | 68 | 64 | 72 | 67 | 64 | 70 | 66 | 63 | 62 | 62 | 62 | 62 | 62 | | |
| 8 | 80 | 70 | 64 | 60 | 79 | 70 | 64 | 60 | 69 | 64 | 60 | 68 | 63 | 60 | 67 | 63 | 59 | 58 | 58 | 58 | 58 | 58 | | |
| 9 | 76 | 66 | 61 | 57 | 75 | 66 | 60 | 57 | 65 | 60 | 56 | 64 | 59 | 56 | 63 | 59 | 56 | 55 | 55 | 55 | 55 | 55 | | |
| 10 | 72 | 63 | 57 | 53 | 71 | 62 | 57 | 53 | 62 | 57 | 53 | 61 | 56 | 53 | 60 | 56 | 53 | 51 | 51 | 51 | 51 | 51 | | |

AVERAGE LUMINANCE (cd/sqm):





TEST NUMBER: P250536

CATALOG NUMBER: LD8B120D010 ER8B1209730 8LBM0GPH

ZONAL LUMENS:

| Zone | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10° | 897.4 | 11.3 |
| 10°-20° | 2133.7 | 26.8 |
| 20°-30° | 2658.3 | 33.4 |
| 30°-40° | 1793.1 | 22.6 |
| 40°-50° | 424.0 | 5.3 |
| 50°-60° | 31.0 | 0.4 |
| 60°-70° | 5.5 | 0.1 |
| 70°-80° | 4.1 | 0.1 |
| 80°-90° | 0.9 | 0.0 |
| 90°-100° | 0.0 | 0.0 |
| 100°-110° | 0.0 | 0.0 |
| 110°-120° | 0.0 | 0.0 |
| 120°-130° | 0.0 | 0.0 |
| 130°-140° | 0.0 | 0.0 |
| 140°-150° | 0.0 | 0.0 |
| 150°-160° | 0.0 | 0.0 |
| 160°-170° | 0.0 | 0.0 |
| 170°-180° | 0.0 | 0.0 |
| 0°-30° | 5689.4 | 71.6 |
| 0°-40° | 7482.5 | 94.1 |
| 0°-60° | 7937.4 | 99.9 |
| 0°-90° | 7947.9 | 100.0 |
| 90°-120° | 0.0 | 0.0 |
| 90°-150° | 0.0 | 0.0 |
| 90°-180° | 0.0 | 0.0 |
| 0°-180° | 7947.9 | 100.0 |

CANDELA DISTRIBUTION:

| | 0° | Flux |
|-----|-------|------|
| 0° | 10080 | |
| 5° | 9788 | 897 |
| 15° | 7577 | 2134 |
| 25° | 5893 | 2658 |
| 35° | 2874 | 1793 |
| 45° | 461 | 424 |
| 55° | 14 | 31 |
| 65° | 0 | 6 |
| 75° | 10 | 4 |
| 85° | 3 | 1 |
| 90° | 0 | |



TEST NUMBER: P250536

CATALOG NUMBER: LD8B120D010 ER8B1209730 8LBM0GPH

CANDELA DISTRIBUTION (FULL):

| | 0° |
|-------|---------|
| 0° | 10080.1 |
| 2.5° | 10063.0 |
| 5° | 9787.9 |
| 7.5° | 9289.4 |
| 10° | 8674.1 |
| 12.5° | 8093.0 |
| 15° | 7577.4 |
| 17.5° | 7133.8 |
| 20° | 6724.7 |
| 22.5° | 6332.8 |
| 25° | 5892.7 |
| 27.5° | 5318.6 |
| 30° | 4617.2 |
| 32.5° | 3768.1 |
| 35° | 2874.2 |
| 37.5° | 2055.9 |
| 40° | 1340.8 |
| 42.5° | 801.1 |
| 45° | 460.7 |
| 47.5° | 257.8 |
| 50° | 127.2 |
| 52.5° | 58.5 |
| 55° | 13.7 |
| 57.5° | 3.4 |
| 60° | 6.9 |
| 62.5° | 10.3 |
| 65° | 0.0 |
| 67.5° | 6.9 |
| 70° | 3.4 |
| 72.5° | 3.4 |
| 75° | 10.3 |
| 77.5° | 0.0 |
| 80° | 0.0 |
| 82.5° | 0.0 |
| 85° | 3.4 |
| 87.5° | 0.0 |
| 90° | 0.0 |

(END OF REPORT)