

Scaled data based on original data using
LM-79-08 Approved Method: Electrical and Photometric Measurements of Solid-State
Lighting Products

Test Report Prepared for
Cooper Lighting Solutions
(formerly Eaton)

Brand: PORTFOLIO

Report Number: P246592

Luminaire Tested: **LD8B40D010 ER8B40950 8LBW0MW**

Issue Date: 03/03/2020

Test Information

Test Method: LM-79-08
Report Number: P246592
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-1801-521-48)
Test Lab: INNOVATION CENTER(G1)
Issue Date: 03/03/2020
Manufacturer: COOPER LIGHTING SOLUTIONS (FORMERLY EATON)
Product Line: PORTFOLIO
Catalog Number: LD8B40D010 ER8B40950 8LBW0MW
Description: PORTFOLIO 8 INCH WIDE DISTRIBUTION 60 DEGREE CUTOFF RECESSED
DOWNLIGHT
90 CRI 5000 CCT WITH MATTE WHITE TRIM
Light Source: -
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 4136.0 lumens
Efficiency: N/A
Efficacy: 101.1 lumens/watt
Spacing Criteria (0/90/45): 1.11 / 1.11 / 1.05
Luminous Opening: Circular (Dia: 0.67' x H: 0')
CIE Type: Direct


Input Watts (W): 40.9
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 25 FT



TEST NUMBER: P246592

CATALOG NUMBER: LD8B40D010 ER8B40950 8LBW0MW

Luminous Intensity Polar Plot

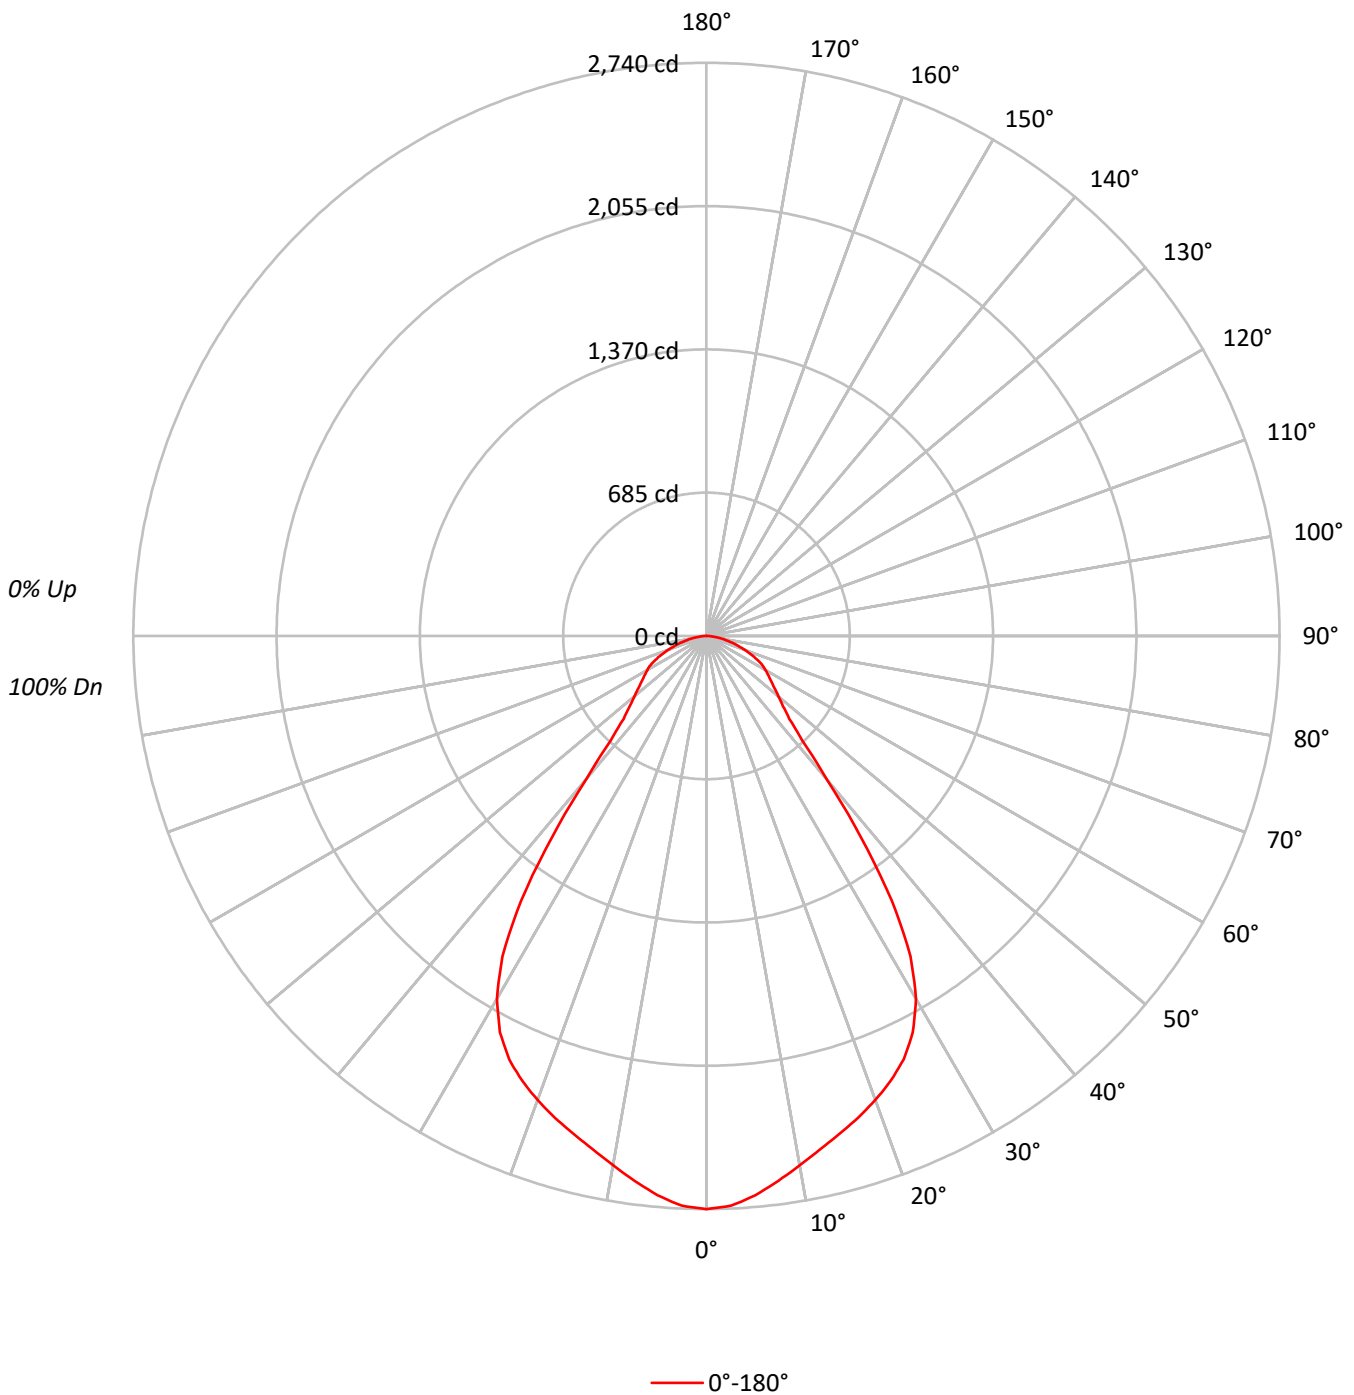



TEST NUMBER: P246592

CATALOG NUMBER: LD8B40D010 ER8B40950 8LBW0MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

| | | | | | | | | | | | | | | | | | | |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|
| RF | 20 | | | | 20 | | | | 20 | | | | 20 | | | | 20 | |
| RC | 80 | | | | 70 | | | | 50 | | | | 30 | | | | 10 | 0 |
| RW | 70 | 50 | 30 | 10 | 70 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 0 |
| RCR | | | | | | | | | | | | | | | | | | |
| 0 | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | 106 | 106 | 106 | 102 | 102 | 102 | 100 |
| 1 | 111 | 107 | 104 | 101 | 109 | 105 | 102 | 99 | 101 | 99 | 96 | 97 | 95 | 93 | 94 | 92 | 91 | 89 |
| 2 | 103 | 97 | 91 | 87 | 101 | 95 | 90 | 86 | 92 | 87 | 84 | 88 | 85 | 82 | 86 | 83 | 80 | 78 |
| 3 | 96 | 88 | 81 | 76 | 94 | 86 | 80 | 75 | 83 | 78 | 74 | 81 | 76 | 73 | 78 | 75 | 72 | 70 |
| 4 | 90 | 80 | 73 | 67 | 88 | 79 | 72 | 67 | 76 | 70 | 66 | 74 | 69 | 65 | 72 | 68 | 64 | 62 |
| 5 | 84 | 73 | 66 | 60 | 82 | 72 | 65 | 60 | 70 | 64 | 59 | 68 | 63 | 59 | 67 | 62 | 58 | 56 |
| 6 | 79 | 67 | 60 | 54 | 77 | 66 | 59 | 54 | 65 | 58 | 54 | 63 | 58 | 53 | 62 | 57 | 53 | 51 |
| 7 | 74 | 62 | 55 | 49 | 72 | 61 | 54 | 49 | 60 | 54 | 49 | 59 | 53 | 49 | 57 | 52 | 48 | 47 |
| 8 | 69 | 58 | 50 | 45 | 68 | 57 | 50 | 45 | 56 | 50 | 45 | 55 | 49 | 45 | 54 | 48 | 45 | 43 |
| 9 | 65 | 54 | 47 | 42 | 64 | 53 | 46 | 42 | 52 | 46 | 41 | 51 | 45 | 41 | 50 | 45 | 41 | 40 |
| 10 | 62 | 50 | 43 | 39 | 61 | 50 | 43 | 39 | 49 | 43 | 38 | 48 | 42 | 38 | 47 | 42 | 38 | 37 |

AVERAGE LUMINANCE (cd/sqm):

| | |
|-----|-------|
| | 0° |
| 0° | 84504 |
| 5° | 83081 |
| 10° | 80469 |
| 15° | 78607 |
| 20° | 77487 |
| 25° | 75966 |
| 30° | 71324 |
| 35° | 58221 |
| 40° | 36068 |
| 45° | 24425 |
| 50° | 21521 |
| 55° | 20311 |
| 60° | 20142 |
| 65° | 19525 |
| 70° | 17500 |
| 75° | 15155 |
| 80° | 12821 |
| 85° | 10225 |



TEST NUMBER: P246592

CATALOG NUMBER: LD8B40D010 ER8B40950 8LBW0MW

ZONAL LUMENS:

| Zone | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10° | 252.5 | 6.1 |
| 10°-20° | 695.4 | 16.8 |
| 20°-30° | 1019.9 | 24.7 |
| 30°-40° | 932.2 | 22.5 |
| 40°-50° | 461.5 | 11.2 |
| 50°-60° | 341.3 | 8.3 |
| 60°-70° | 262.3 | 6.3 |
| 70°-80° | 136.7 | 3.3 |
| 80°-90° | 34.1 | 0.8 |
| 90°-100° | 0.0 | 0.0 |
| 100°-110° | 0.0 | 0.0 |
| 110°-120° | 0.0 | 0.0 |
| 120°-130° | 0.0 | 0.0 |
| 130°-140° | 0.0 | 0.0 |
| 140°-150° | 0.0 | 0.0 |
| 150°-160° | 0.0 | 0.0 |
| 160°-170° | 0.0 | 0.0 |
| 170°-180° | 0.0 | 0.0 |
| 0°-30° | 1967.8 | 47.6 |
| 0°-40° | 2900.0 | 70.1 |
| 0°-60° | 3702.8 | 89.5 |
| 0°-90° | 4136.0 | 100.0 |
| 90°-120° | 0.0 | 0.0 |
| 90°-150° | 0.0 | 0.0 |
| 90°-180° | 0.0 | 0.0 |
| 0°-180° | 4136.0 | 100.0 |

CANDELA DISTRIBUTION:

| | 0° | Flux |
|-----|------|------|
| 0° | 2740 | |
| 5° | 2684 | 252 |
| 15° | 2462 | 695 |
| 25° | 2233 | 1020 |
| 35° | 1547 | 932 |
| 45° | 560 | 462 |
| 55° | 378 | 341 |
| 65° | 268 | 262 |
| 75° | 127 | 137 |
| 85° | 29 | 34 |
| 90° | 0 | |



TEST NUMBER: P246592

CATALOG NUMBER: LD8B40D010 ER8B40950 8LBW0MW

CANDELA DISTRIBUTION (FULL):

| 0° | |
|-------|--------|
| 0° | 2740.4 |
| 2.5° | 2726.0 |
| 5° | 2684.0 |
| 7.5° | 2627.6 |
| 10° | 2569.9 |
| 12.5° | 2513.4 |
| 15° | 2462.3 |
| 17.5° | 2413.7 |
| 20° | 2361.3 |
| 22.5° | 2302.2 |
| 25° | 2232.7 |
| 27.5° | 2137.0 |
| 30° | 2003.1 |
| 32.5° | 1815.6 |
| 35° | 1546.6 |
| 37.5° | 1213.4 |
| 40° | 896.0 |
| 42.5° | 678.2 |
| 45° | 560.1 |
| 47.5° | 495.9 |
| 50° | 448.6 |
| 52.5° | 410.6 |
| 55° | 377.8 |
| 57.5° | 350.3 |
| 60° | 326.6 |
| 62.5° | 301.7 |
| 65° | 267.6 |
| 67.5° | 230.9 |
| 70° | 194.1 |
| 72.5° | 160.0 |
| 75° | 127.2 |
| 77.5° | 98.4 |
| 80° | 72.2 |
| 82.5° | 49.8 |
| 85° | 28.9 |
| 87.5° | 10.5 |
| 90° | 0.0 |

(END OF REPORT)