

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P866694

Luminaire Tested: PRLX-2001-L-927-32L-L-X-X-GREY-X

Issue Date: 8/20/2024

Test Information

Test Method: LM-79-2019
Report Number: P866694
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2304-993-78)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 8/20/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: Prenalux
Catalog Number: PRLX-2001-L-927-32L-L-X-X-GREY-X
Description: PRENTALUX 3D PRINTED PENDANT LED LUMINAIRE, LARGE LIGHT ENGINE, FLAT LENS,
TAPERED DRUM WITH GRAY INTERIOR SHADE.
LIGHT LEVEL 2
Light Source: 2700K CCT, 90 CRI LEDS
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 2457.6 lumens
Efficiency: N/A
Efficacy: 94.2 lumens/watt
Spacing Criteria (0/90/45): 1.17 / 1.17 / 1.27
Luminous Opening: Circular (Dia: 1.58' x H: 0')
CIE Type: Direct

Input Watts (W): 26.1
Input Voltage (V): 120
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: 0.5 HR
Operation Time: 3 HR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P866694

CATALOG NUMBER: PRLX-2001-L-927-32L-L-X-X-GREY-X

Luminous Intensity Polar Plot

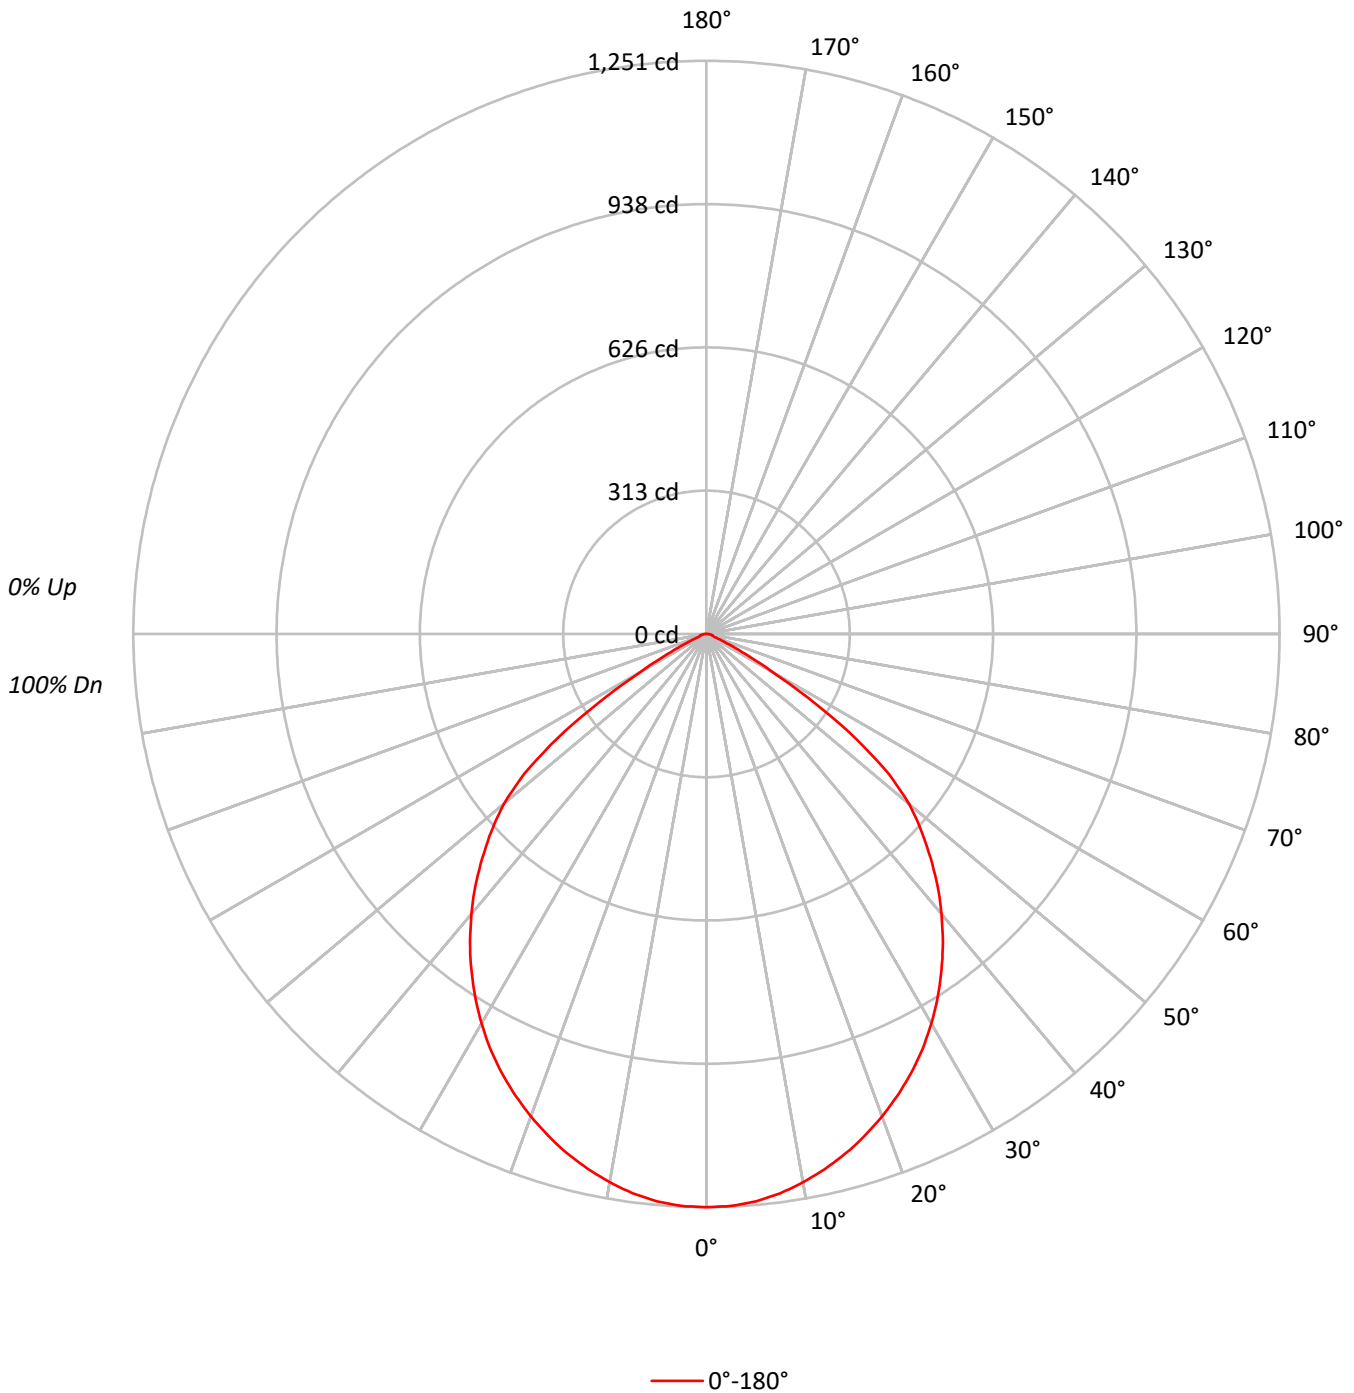



TEST NUMBER: P866694

CATALOG NUMBER: PRLX-2001-L-927-32L-L-X-X-GREY-X

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10	0		
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50	30	10	0
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102	102	102	100
1	112	108	105	102	109	106	103	100	102	99	97		98	96	94		94	93	91	90
2	104	97	92	87	101	95	91	86	92	88	84		89	86	83		86	83	81	79
3	96	88	81	76	94	86	80	75	83	78	74		81	76	73		78	75	71	69
4	89	79	72	66	87	78	71	66	75	70	65		73	68	64		71	67	63	61
5	83	72	64	58	81	71	63	58	69	62	57		67	61	57		65	60	56	54
6	77	65	57	52	75	64	57	52	63	56	51		61	55	51		60	54	50	49
7	72	60	52	46	70	59	51	46	57	51	46		56	50	46		55	49	45	44
8	67	55	47	42	65	54	47	42	53	46	41		52	46	41		51	45	41	39
9	63	50	43	38	61	50	43	38	49	42	38		48	42	37		47	41	37	36
10	59	47	39	35	58	46	39	35	45	39	34		44	38	34		44	38	34	33

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	6841
5°	6821
10°	6746
15°	6644
20°	6520
25°	6378
30°	6199
35°	5970
40°	5693
45°	5346
50°	4912
55°	3793
60°	1834
65°	692
70°	273
75°	300
80°	343
85°	389

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 5346 cd/sqm

TEST NUMBER: P866694

CATALOG NUMBER: PRLX-2001-L-927-32L-L-X-X-GREY-X

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	117.8	4.8
10°-20°	330.8	13.5
20°-30°	486.5	19.8
30°-40°	558.7	22.7
40°-50°	532.6	21.7
50°-60°	343.8	14.0
60°-70°	66.1	2.7
70°-80°	14.9	0.6
80°-90°	6.4	0.3
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	935.0	38.0
0°-40°	1493.8	60.8
0°-60°	2370.2	96.4
0°-90°	2457.6	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2457.6	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1251	
5°	1243	118
15°	1174	331
25°	1057	486
35°	895	559
45°	692	533
55°	398	344
65°	54	66
75°	14	15
85°	6	6
90°	0	

TEST NUMBER: P866694

CATALOG NUMBER: PRLX-2001-L-927-32L-L-X-X-GREY-X

CANDELA DISTRIBUTION (FULL):

	0°
0°	1251.3
2.5°	1249.7
5°	1243.0
7.5°	1231.6
10°	1215.3
12.5°	1196.0
15°	1174.0
17.5°	1148.7
20°	1120.8
22.5°	1090.0
25°	1057.4
27.5°	1021.5
30°	982.0
32.5°	939.6
35°	894.6
37.5°	847.9
40°	797.7
42.5°	747.3
45°	691.5
47.5°	636.5
50°	577.6
52.5°	501.3
55°	398.0
57.5°	277.3
60°	167.7
62.5°	96.1
65°	53.5
67.5°	27.9
70°	17.1
72.5°	15.5
75°	14.2
77.5°	12.7
80°	10.9
82.5°	8.8
85°	6.2
87.5°	3.1
90°	0.0



TEST NUMBER: P866694
 CATALOG NUMBER: PRLX-2001-L-927-32L-L-X-X-GREY-X

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	14.58	15.99	14.95	16.30	16.61	14.58	15.99	14.95	16.30	16.61
	3H	14.51	15.74	14.89	16.07	16.44	14.51	15.74	14.89	16.07	16.44
	4H	14.46	15.61	14.87	15.96	16.34	14.46	15.61	14.87	15.96	16.34
	6H	14.42	15.47	14.83	15.84	16.23	14.42	15.47	14.83	15.84	16.23
	8H	14.40	15.39	14.82	15.78	16.19	14.40	15.39	14.82	15.78	16.19
	12H	14.37	15.32	14.80	15.71	16.14	14.37	15.32	14.80	15.71	16.14
4H	2H	14.47	15.61	14.87	15.96	16.34	14.47	15.61	14.87	15.96	16.34
	3H	14.41	15.33	14.82	15.73	16.14	14.41	15.33	14.82	15.73	16.14
	4H	14.36	15.18	14.79	15.60	16.04	14.36	15.18	14.79	15.60	16.04
	6H	14.33	15.04	14.80	15.49	15.95	14.33	15.04	14.80	15.49	15.95
	8H	14.31	14.97	14.78	15.42	15.89	14.31	14.97	14.78	15.42	15.89
	12H	14.29	14.88	14.78	15.36	15.83	14.29	14.88	14.78	15.36	15.83
8H	4H	14.25	14.91	14.72	15.36	15.83	14.25	14.91	14.72	15.36	15.83
	6H	14.22	14.77	14.72	15.26	15.74	14.22	14.77	14.72	15.26	15.74
	8H	14.20	14.70	14.72	15.21	15.70	14.20	14.70	14.72	15.21	15.70
	12H	14.20	14.64	14.71	15.14	15.71	14.20	14.64	14.71	15.14	15.71
12H	4H	14.21	14.80	14.69	15.28	15.75	14.21	14.80	14.69	15.28	15.75
	6H	14.17	14.66	14.69	15.18	15.67	14.17	14.66	14.69	15.18	15.67
	8H	14.17	14.62	14.68	15.11	15.68	14.17	14.62	14.68	15.11	15.68