

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P866749

Luminaire Tested: PRLX-2001-L-930-15L-L-X-X-BRSS-X

Issue Date: 8/20/2024

Test Information

Test Method: LM-79-2019
Report Number: P866749
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2304-993-77)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 8/20/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: Prenalux
Catalog Number: PRLX-2001-L-930-15L-L-X-X-BRSS-X
Description: PRENTALUX 3D PRINTED PENDANT LED LUMINAIRE, LARGE LIGHT ENGINE, FLAT LENS,
TAPERED DRUM WITH BRASS INTERIOR SHADE.
LIGHT LEVEL 1
Light Source: 3000K CCT, 90 CRI LEDS
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 1210.5 lumens
Efficiency: N/A
Efficacy: 73.8 lumens/watt
Spacing Criteria (0/90/45): 1.17 / 1.17 / 1.26
Luminous Opening: Circular (Dia: 1.58' x H: 0')
CIE Type: Direct

Input Watts (W): 16.4
Input Voltage (V): 120
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: 0.333 HR
Operation Time: 3 HR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P866749

CATALOG NUMBER: PRLX-2001-L-930-15L-L-X-X-BRSS-X

Luminous Intensity Polar Plot

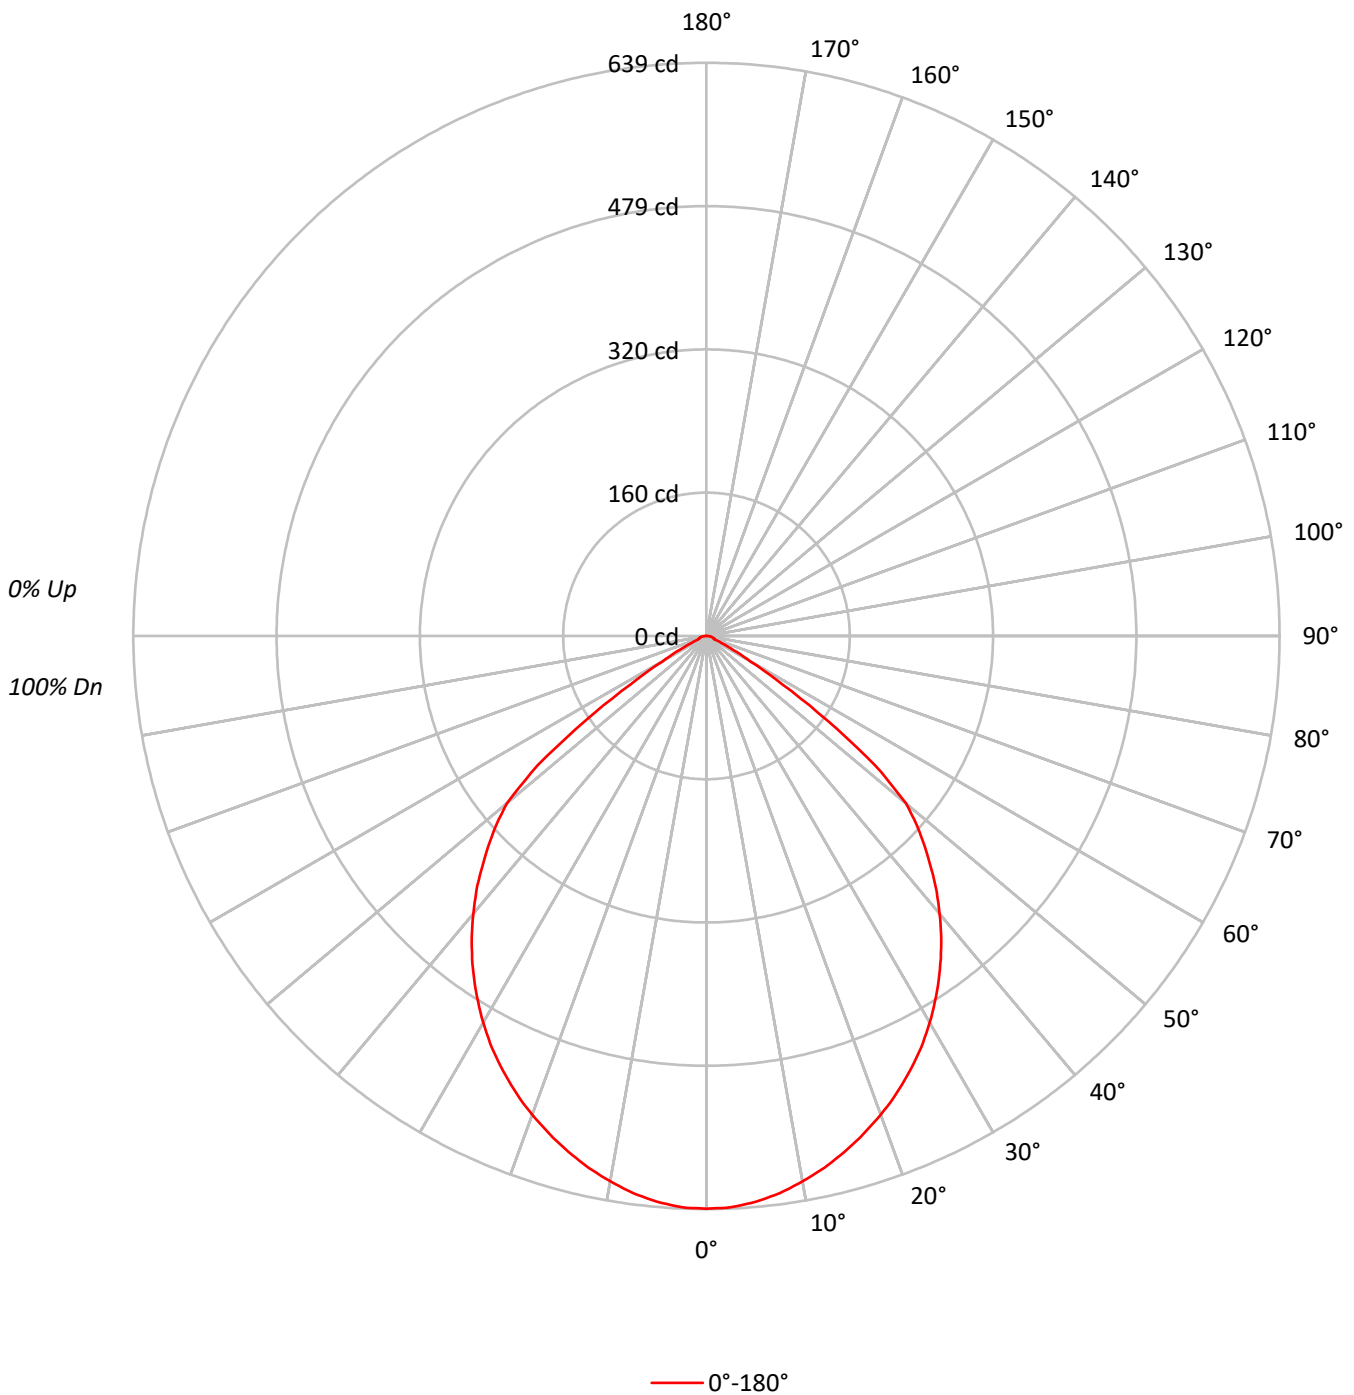



TEST NUMBER: P866749

CATALOG NUMBER: PRLX-2001-L-930-15L-L-X-X-BRSS-X

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10	0		
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50	30	10	0
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102	102	102	100
1	112	108	105	102	109	106	103	101	102	100	97		98	96	94		95	93	92	90
2	104	98	92	88	102	96	91	87	92	88	85		89	86	83		87	84	81	80
3	97	88	82	76	94	87	81	76	84	79	75		81	77	73		79	75	72	70
4	90	80	73	67	88	79	72	67	76	70	66		74	69	65		72	68	64	62
5	83	72	65	59	81	71	64	59	69	63	58		68	62	58		66	61	57	55
6	78	66	58	53	76	65	58	53	63	57	52		62	56	52		60	55	51	50
7	72	60	53	47	71	60	52	47	58	52	47		57	51	47		56	50	46	45
8	68	56	48	43	66	55	48	43	54	47	42		52	47	42		51	46	42	40
9	63	51	44	39	62	51	44	39	50	43	39		49	43	38		48	42	38	37
10	59	47	40	35	58	47	40	35	46	40	35		45	39	35		44	39	35	33

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	3491
5°	3475
10°	3427
15°	3369
20°	3305
25°	3232
30°	3142
35°	3029
40°	2887
45°	2701
50°	2470
55°	1567
60°	621
65°	238
70°	144
75°	156
80°	176
85°	194

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 2701 cd/sqm

TEST NUMBER: P866749

CATALOG NUMBER: PRLX-2001-L-930-15L-L-X-X-BRSS-X

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	59.9	5.0
10°-20°	167.8	13.9
20°-30°	246.6	20.4
30°-40°	283.4	23.4
40°-50°	269.2	22.2
50°-60°	149.3	12.3
60°-70°	23.3	1.9
70°-80°	7.8	0.6
80°-90°	3.2	0.3
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	474.3	39.2
0°-40°	757.7	62.6
0°-60°	1176.1	97.2
0°-90°	1210.5	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1210.5	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	639	
5°	633	60
15°	595	168
25°	536	247
35°	454	283
45°	349	269
55°	164	149
65°	18	23
75°	7	8
85°	3	3
90°	0	

TEST NUMBER: P866749

CATALOG NUMBER: PRLX-2001-L-930-15L-L-X-X-BRSS-X

CANDELA DISTRIBUTION (FULL):

	0°
0°	638.6
2.5°	637.6
5°	633.2
7.5°	626.5
10°	617.4
12.5°	607.3
15°	595.3
17.5°	582.2
20°	568.1
22.5°	552.8
25°	535.8
27.5°	517.8
30°	497.8
32.5°	476.4
35°	453.9
37.5°	430.0
40°	404.6
42.5°	378.1
45°	349.4
47.5°	321.7
50°	290.4
52.5°	237.0
55°	164.4
57.5°	100.0
60°	56.8
62.5°	33.8
65°	18.4
67.5°	10.0
70°	9.0
72.5°	8.2
75°	7.4
77.5°	6.6
80°	5.6
82.5°	4.4
85°	3.1
87.5°	1.6
90°	0.0

TEST NUMBER: P866749
 CATALOG NUMBER: PRLX-2001-L-930-15L-L-X-X-BRSS-X

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	9.97	11.35	10.34	11.66	11.97	9.97	11.35	10.34	11.66	11.97
	3H	9.91	11.12	10.29	11.45	11.81	9.91	11.12	10.29	11.45	11.81
	4H	9.88	11.01	10.29	11.36	11.74	9.88	11.01	10.29	11.36	11.74
	6H	9.87	10.90	10.28	11.27	11.66	9.87	10.90	10.28	11.27	11.66
	8H	9.86	10.84	10.29	11.23	11.63	9.86	10.84	10.29	11.23	11.63
	12H	9.85	10.78	10.28	11.16	11.59	9.85	10.78	10.28	11.16	11.59
4H	2H	9.84	10.96	10.24	11.31	11.70	9.84	10.96	10.24	11.31	11.70
	3H	9.81	10.71	10.22	11.12	11.52	9.81	10.71	10.22	11.12	11.52
	4H	9.80	10.60	10.23	11.02	11.47	9.80	10.60	10.23	11.02	11.47
	6H	9.82	10.52	10.29	10.96	11.43	9.82	10.52	10.29	10.96	11.43
	8H	9.82	10.47	10.29	10.92	11.39	9.82	10.47	10.29	10.92	11.39
	12H	9.83	10.40	10.31	10.89	11.36	9.83	10.40	10.31	10.89	11.36
8H	4H	9.71	10.36	10.18	10.80	11.27	9.71	10.36	10.18	10.80	11.27
	6H	9.75	10.28	10.25	10.78	11.26	9.75	10.28	10.25	10.78	11.26
	8H	9.77	10.25	10.29	10.77	11.26	9.77	10.25	10.29	10.77	11.26
	12H	9.80	10.24	10.32	10.73	11.30	9.80	10.24	10.32	10.73	11.30
12H	4H	9.67	10.25	10.16	10.73	11.20	9.67	10.25	10.16	10.73	11.20
	6H	9.70	10.19	10.23	10.71	11.20	9.70	10.19	10.23	10.71	11.20
	8H	9.75	10.19	10.27	10.68	11.25	9.75	10.19	10.27	10.68	11.25