

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P866769

Luminaire Tested: PRLX-2001-L-930-48L-G-X-X-BRSS-X

Issue Date: 8/20/2024

Test Information

Test Method: LM-79-2019
Report Number: P866769
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2304-993-65)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 8/20/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: Prenalux
Catalog Number: PRLX-2001-L-930-48L-G-X-X-BRSS-X
Description: PRENTALUX 3D PRINTED PENDANT LED LUMINAIRE, LARGE LIGHT ENGINE, GLOBE LENS,
TAPERED DRUM WITH BRASS INTERIOR SHADE.
LIGHT LEVEL 3
Light Source: 3000K CCT, 90 CRI LEDS
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 1712.1 lumens
Efficiency: N/A
Efficacy: 45.7 lumens/watt
Spacing Criteria (0/90/45): 1.37 / 1.37 / 1.51
Luminous Opening: Circular (Dia: 1.58' x H: 0')
CIE Type: Direct

Input Watts (W): 37.5
Input Voltage (V): 120
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: 0.333 HR
Operation Time: 3 HR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P866769

CATALOG NUMBER: PRLX-2001-L-930-48L-G-X-X-BRSS-X

Luminous Intensity Polar Plot

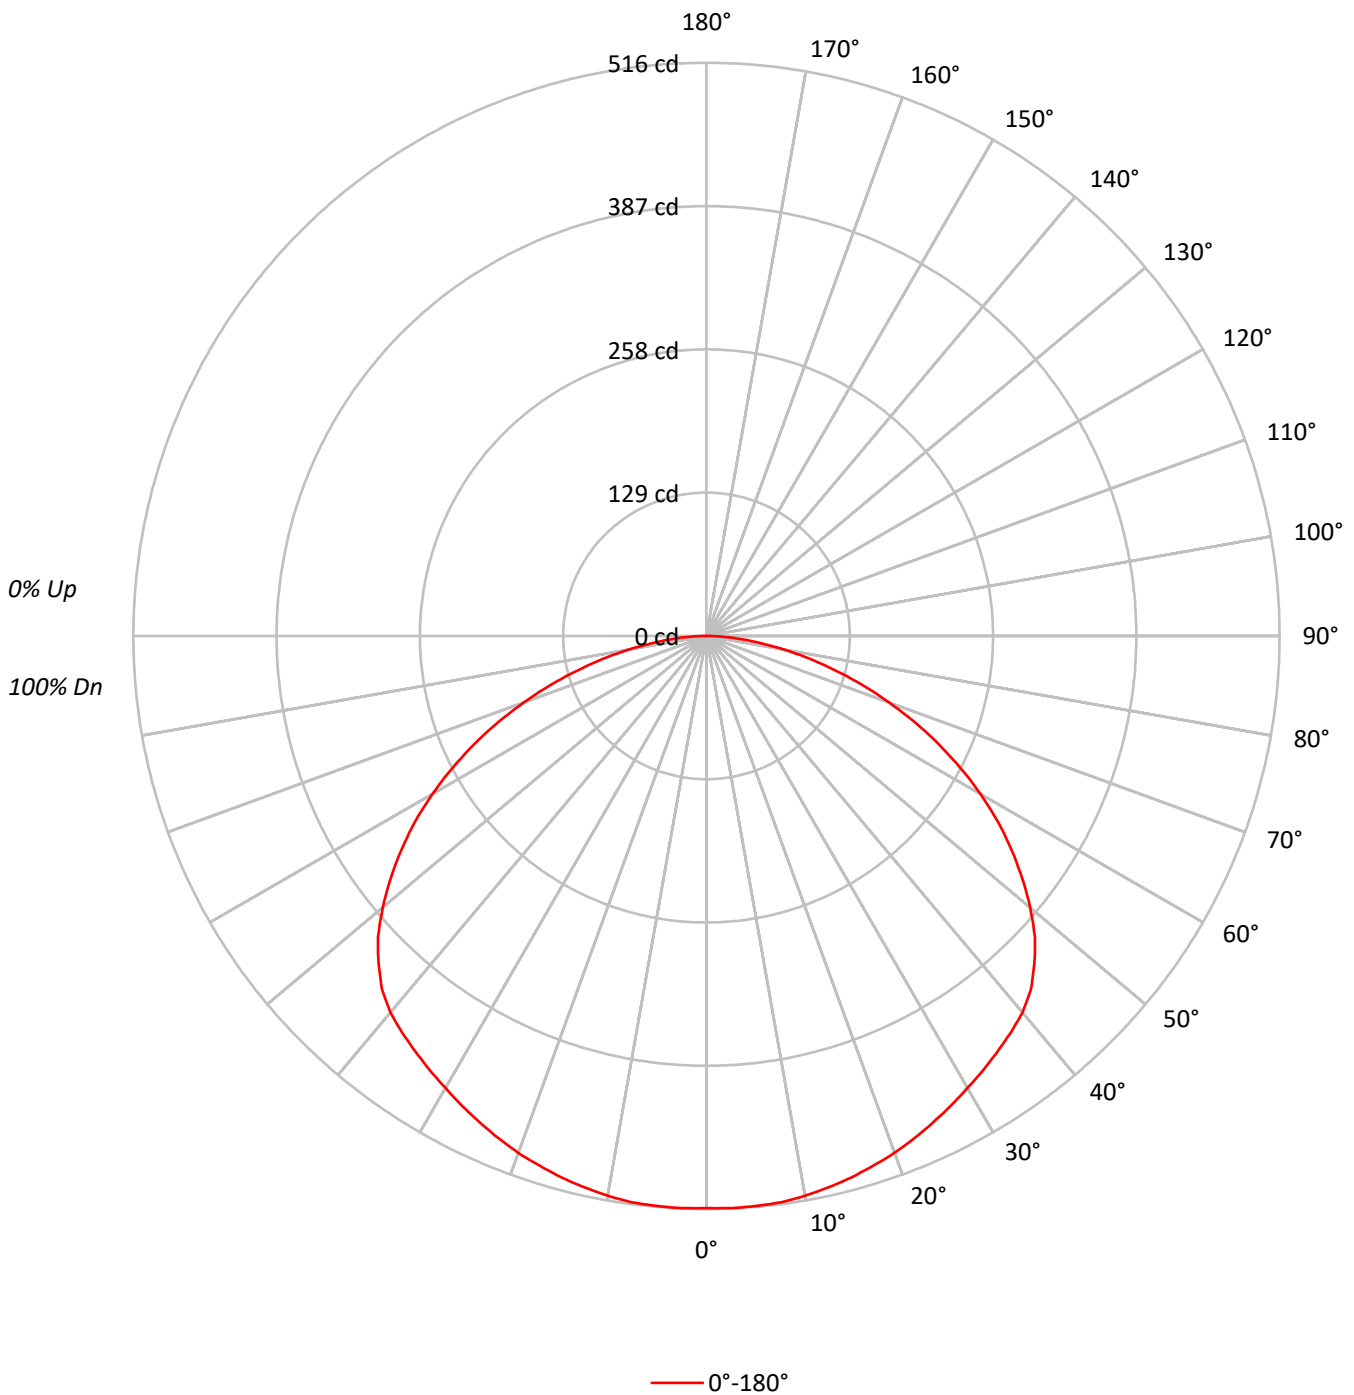



TEST NUMBER: P866769

CATALOG NUMBER: PRLX-2001-L-930-48L-G-X-X-BRSS-X

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10	0		
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50	30	10	0
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102	102	102	100
1	108	103	99	95	106	101	97	93	97	93	90		93	90	88		89	87	85	83
2	98	90	82	76	95	88	81	76	84	79	74		81	76	72		78	74	70	68
3	89	78	70	63	87	77	69	62	74	67	61		71	65	60		68	63	59	57
4	81	69	60	53	79	67	59	52	65	58	52		63	56	51		60	55	50	48
5	74	61	52	45	72	60	51	45	58	50	44		56	49	44		54	48	43	41
6	69	55	46	39	67	54	45	39	52	44	38		50	43	38		49	43	38	36
7	63	50	40	34	62	49	40	34	47	39	34		46	39	34		44	38	33	31
8	59	45	36	30	57	44	36	30	43	35	30		42	35	30		40	34	30	28
9	55	41	33	27	53	41	33	27	39	32	27		38	32	27		37	31	27	25
10	51	38	30	24	50	37	30	24	36	29	24		35	29	24		34	28	24	22

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	2817
5°	2827
10°	2841
15°	2856
20°	2882
25°	2914
30°	2966
35°	3049
40°	3158
45°	3228
50°	3235
55°	3194
60°	3114
65°	2984
70°	2789
75°	2535
80°	2248
85°	1832

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 47.5°
 Luminance: 3246 cd/sqm

TEST NUMBER: P866769

CATALOG NUMBER: PRLX-2001-L-930-48L-G-X-X-BRSS-X

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	49.1	2.9
10°-20°	142.7	8.3
20°-30°	223.2	13.0
30°-40°	286.5	16.7
40°-50°	321.2	18.8
50°-60°	299.1	17.5
60°-70°	228.0	13.3
70°-80°	128.0	7.5
80°-90°	34.3	2.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	414.9	24.2
0°-40°	701.5	41.0
0°-60°	1321.8	77.2
0°-90°	1712.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1712.1	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	515	
5°	515	49
15°	505	143
25°	483	223
35°	457	287
45°	418	321
55°	335	299
65°	231	228
75°	120	128
85°	29	34
90°	0	

TEST NUMBER: P866769

CATALOG NUMBER: PRLX-2001-L-930-48L-G-X-X-BRSS-X

CANDELA DISTRIBUTION (FULL):

	0°
0°	515.2
2.5°	515.6
5°	515.2
7.5°	514.3
10°	511.8
12.5°	508.4
15°	504.6
17.5°	500.0
20°	495.3
22.5°	489.4
25°	483.1
27.5°	476.7
30°	469.9
32.5°	463.6
35°	456.8
37.5°	450.1
40°	442.5
42.5°	432.3
45°	417.5
47.5°	401.1
50°	380.4
52.5°	358.4
55°	335.1
57.5°	311.0
60°	284.8
62.5°	258.2
65°	230.7
67.5°	202.9
70°	174.5
72.5°	147.5
75°	120.0
77.5°	95.1
80°	71.4
82.5°	48.6
85°	29.2
87.5°	12.7
90°	0.0

TEST NUMBER: P866769
 CATALOG NUMBER: PRLX-2001-L-930-48L-G-X-X-BRSS-X

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	16.44	18.12	16.80	18.44	18.75	16.44	18.12	16.80	18.44	18.75
	3H	18.22	19.75	18.60	20.08	20.44	18.22	19.75	18.60	20.08	20.44
	4H	18.87	20.31	19.27	20.66	21.03	18.87	20.31	19.27	20.66	21.03
	6H	19.33	20.67	19.75	21.04	21.43	19.33	20.67	19.75	21.04	21.43
	8H	19.48	20.76	19.90	21.15	21.54	19.48	20.76	19.90	21.15	21.54
	12H	19.57	20.80	20.00	21.18	21.61	19.57	20.80	20.00	21.18	21.61
4H	2H	17.08	18.52	17.48	18.87	19.24	17.08	18.52	17.48	18.87	19.24
	3H	19.08	20.29	19.49	20.69	21.09	19.08	20.29	19.49	20.69	21.09
	4H	19.85	20.94	20.28	21.36	21.79	19.85	20.94	20.28	21.36	21.79
	6H	20.44	21.40	20.89	21.84	22.29	20.44	21.40	20.89	21.84	22.29
	8H	20.63	21.53	21.09	21.97	22.43	20.63	21.53	21.09	21.97	22.43
	12H	20.76	21.57	21.24	22.04	22.51	20.76	21.57	21.24	22.04	22.51
8H	4H	20.15	21.05	20.61	21.49	21.96	20.15	21.05	20.61	21.49	21.96
	6H	20.86	21.61	21.35	22.10	22.57	20.86	21.61	21.35	22.10	22.57
	8H	21.12	21.79	21.62	22.29	22.78	21.12	21.79	21.62	22.29	22.78
	12H	21.32	21.91	21.82	22.40	22.96	21.32	21.91	21.82	22.40	22.96
12H	4H	20.19	21.00	20.67	21.47	21.94	20.19	21.00	20.67	21.47	21.94
	6H	20.91	21.59	21.42	22.09	22.58	20.91	21.59	21.42	22.09	22.58
	8H	21.22	21.82	21.73	22.31	22.87	21.22	21.82	21.73	22.31	22.87