

Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P866821

Luminaire Tested: PRLX-2001-L-935-32L-L-X-X-BRSS-X

Issue Date: 8/20/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P866821  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2304-993-77)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 8/20/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: Prenalux  
Catalog Number: PRLX-2001-L-935-32L-L-X-X-BRSS-X  
Description: PRENTALUX 3D PRINTED PENDANT LED LUMINAIRE, LARGE LIGHT ENGINE, FLAT LENS,  
TAPERED DRUM WITH BRASS INTERIOR SHADE.  
LIGHT LEVEL 2  
Light Source: 3500K CCT, 90 CRI LEDS  
Ballast/Driver: -


**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 2652.4 lumens  
Efficiency: N/A  
Efficacy: 101.6 lumens/watt  
Spacing Criteria (0/90/45): 1.17 / 1.17 / 1.26  
Luminous Opening: Circular (Dia: 1.58' x H: 0')  
CIE Type: Direct  
  
Input Watts (W): 26.1  
Input Voltage (V): 120  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: 0.333 HR  
Operation Time: 3 HR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P866821

CATALOG NUMBER: PRLX-2001-L-935-32L-L-X-X-BRSS-X

### Luminous Intensity Polar Plot

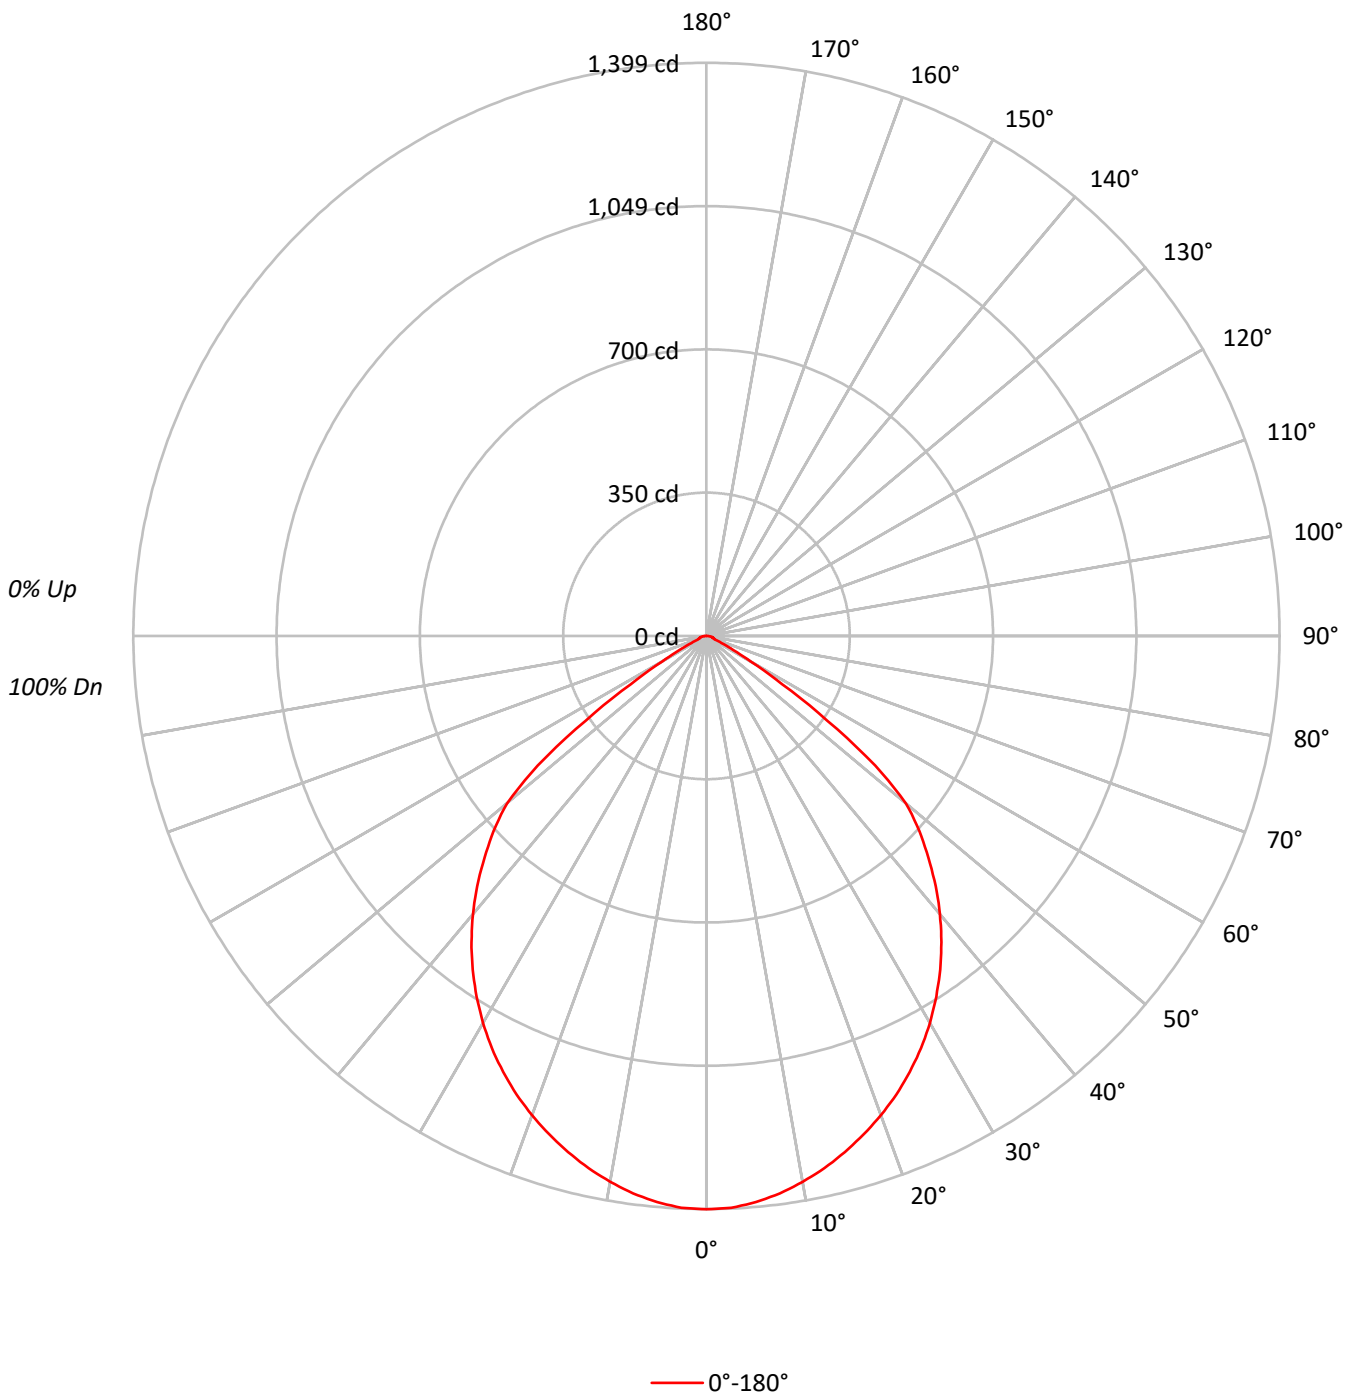



TEST NUMBER: P866821

CATALOG NUMBER: PRLX-2001-L-935-32L-L-X-X-BRSS-X

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20			
RC	80				70				50				30				10	0		
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50	30	10	0
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102	102	102	100
1	112	108	105	102	109	106	103	101	102	100	97		98	96	94		95	93	92	90
2	104	98	92	88	102	96	91	87	92	88	85		89	86	83		87	84	81	80
3	97	88	82	76	94	87	81	76	84	79	75		81	77	73		79	75	72	70
4	90	80	73	67	88	79	72	67	76	70	66		74	69	65		72	68	64	62
5	83	72	65	59	81	71	64	59	69	63	58		68	62	58		66	61	57	55
6	78	66	58	53	76	65	58	53	63	57	52		62	56	52		60	55	51	50
7	72	60	53	47	71	60	52	47	58	52	47		57	51	47		56	50	46	45
8	68	56	48	43	66	55	48	43	54	47	42		52	47	42		51	46	42	40
9	63	51	44	39	62	51	44	39	50	43	39		49	43	38		48	42	38	37
10	59	47	40	35	58	47	40	35	46	40	35		45	39	35		44	39	35	33

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	7650
5°	7613
10°	7510
15°	7383
20°	7242
25°	7081
30°	6886
35°	6637
40°	6326
45°	5920
50°	5411
55°	3434
60°	1362
65°	521
70°	315
75°	344
80°	387
85°	433

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 5920 cd/sqm

TEST NUMBER: P866821

CATALOG NUMBER: PRLX-2001-L-935-32L-L-X-X-BRSS-X

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	131.3	5.0
10°-20°	367.6	13.9
20°-30°	540.3	20.4
30°-40°	620.9	23.4
40°-50°	589.9	22.2
50°-60°	327.1	12.3
60°-70°	51.1	1.9
70°-80°	17.1	0.6
80°-90°	7.1	0.3
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1039.3	39.2
0°-40°	1660.2	62.6
0°-60°	2577.1	97.2
0°-90°	2652.4	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2652.4	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	1399	
5°	1387	131
15°	1304	368
25°	1174	540
35°	994	621
45°	766	590
55°	360	327
65°	40	51
75°	16	17
85°	7	7
90°	0	

TEST NUMBER: P866821

CATALOG NUMBER: PRLX-2001-L-935-32L-L-X-X-BRSS-X

**CANDELA DISTRIBUTION (FULL):**

0°	
0°	1399.3
2.5°	1397.0
5°	1387.3
7.5°	1372.7
10°	1352.8
12.5°	1330.8
15°	1304.5
17.5°	1275.6
20°	1244.8
22.5°	1211.3
25°	1173.9
27.5°	1134.5
30°	1090.8
32.5°	1043.9
35°	994.5
37.5°	942.2
40°	886.5
42.5°	828.5
45°	765.7
47.5°	704.8
50°	636.2
52.5°	519.4
55°	360.3
57.5°	219.1
60°	124.6
62.5°	74.0
65°	40.3
67.5°	22.0
70°	19.7
72.5°	18.0
75°	16.3
77.5°	14.6
80°	12.3
82.5°	9.7
85°	6.9
87.5°	3.4
90°	0.0



TEST NUMBER: P866821  
 CATALOG NUMBER: PRLX-2001-L-935-32L-L-X-X-BRSS-X

**CIE UGR TABLE:**

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.70	14.07	13.06	14.38	14.70	12.70	14.07	13.06	14.38	14.70
	3H	12.63	13.84	13.01	14.17	14.54	12.63	13.84	13.01	14.17	14.54
	4H	12.61	13.73	13.01	14.08	14.47	12.61	13.73	13.01	14.08	14.47
	6H	12.60	13.63	13.01	14.00	14.39	12.60	13.63	13.01	14.00	14.39
	8H	12.59	13.56	13.02	13.95	14.36	12.59	13.56	13.02	13.95	14.36
	12H	12.58	13.51	13.01	13.89	14.32	12.58	13.51	13.01	13.89	14.32
4H	2H	12.57	13.69	12.97	14.04	14.42	12.57	13.69	12.97	14.04	14.42
	3H	12.53	13.44	12.95	13.84	14.25	12.53	13.44	12.95	13.84	14.25
	4H	12.53	13.33	12.96	13.75	14.19	12.53	13.33	12.96	13.75	14.19
	6H	12.55	13.24	13.01	13.69	14.16	12.55	13.24	13.01	13.69	14.16
	8H	12.55	13.20	13.02	13.65	14.12	12.55	13.20	13.02	13.65	14.12
	12H	12.56	13.13	13.04	13.61	14.09	12.56	13.13	13.04	13.61	14.09
8H	4H	12.43	13.08	12.90	13.53	14.00	12.43	13.08	12.90	13.53	14.00
	6H	12.48	13.01	12.98	13.51	13.99	12.48	13.01	12.98	13.51	13.99
	8H	12.50	12.98	13.02	13.50	13.99	12.50	12.98	13.02	13.50	13.99
	12H	12.53	12.97	13.05	13.47	14.04	12.53	12.97	13.05	13.47	14.04
12H	4H	12.40	12.97	12.88	13.46	13.93	12.40	12.97	12.88	13.46	13.93
	6H	12.43	12.92	12.95	13.43	13.93	12.43	12.92	12.95	13.43	13.93
	8H	12.48	12.92	13.00	13.41	13.98	12.48	12.92	13.00	13.41	13.98