

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P865984

Luminaire Tested: PRLX-2001-M-930-35L-L-U-S-X-X-BLAK-X

Issue Date: 8/20/2024

Test Information

Test Method: LM-79-2019
Report Number: P865984
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2304-993-49)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 8/20/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: Prenalux
Catalog Number: PRLX-2001-M-930-35L-L-U-S-X-X-BLAK-X
Description: PRENTALUX 3D PRINTED PENDANT LED LUMINAIRE, MEDIUM LIGHT ENGINE, FLAT LENS,
TAPERED DRUM WITH BLACK INTERIOR SHADE.
LIGHT LEVEL 4
Light Source: 3000K CCT, 90 CRI LEDS
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 2571.1 lumens
Efficiency: N/A
Efficacy: 85.7 lumens/watt
Spacing Criteria (0/90/45): 1.16 / 1.16 / 1.27
Luminous Opening: Circular (Dia: 1.27' x H: 0')
CIE Type: Direct

Input Watts (W): 30
Input Voltage (V): 120
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: 0.5 HR
Operation Time: 3 HR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P865984

CATALOG NUMBER: PRLX-2001-M-930-35L-L-U-S-X-X-BLAK-X

Luminous Intensity Polar Plot

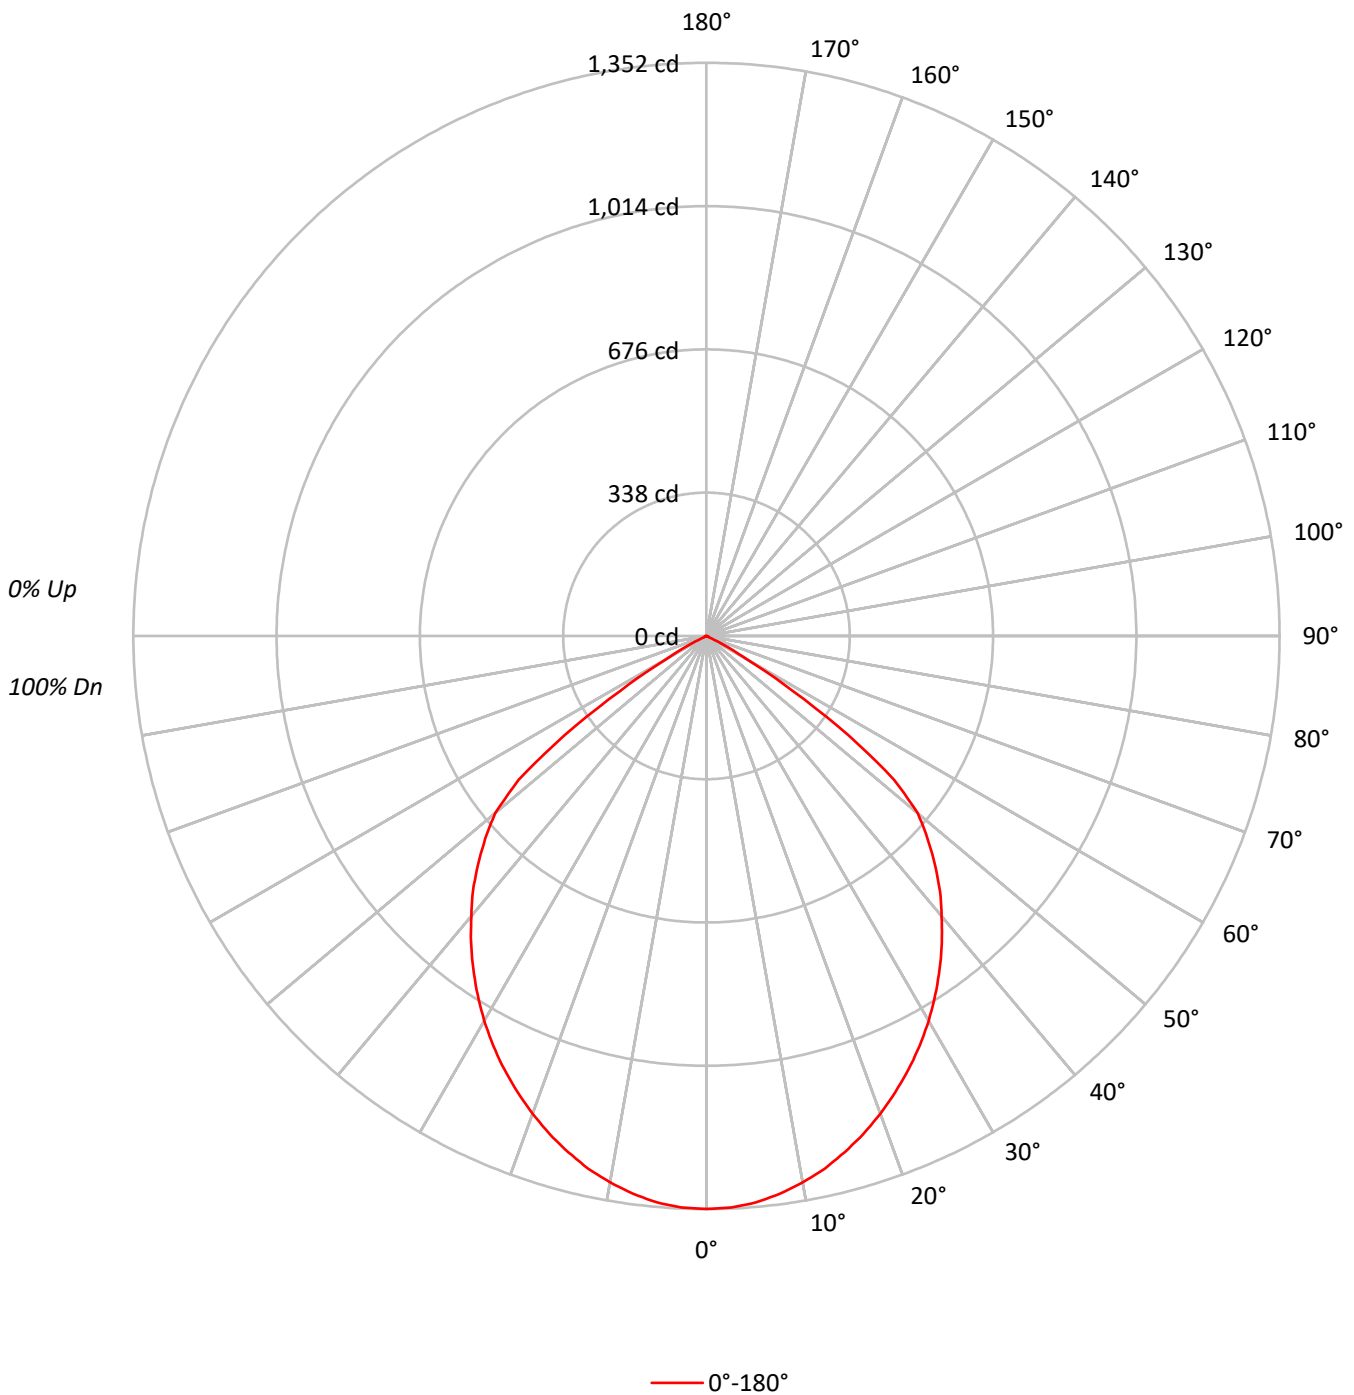



TEST NUMBER: P865984

CATALOG NUMBER: PRLX-2001-M-930-35L-L-U-S-X-X-BLAK-X

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	112	108	105	103	109	106	103	101	102	100	98	98	97	95	95	93	92	90
2	104	98	93	88	102	96	91	87	93	89	86	90	86	84	87	84	82	80
3	97	88	82	77	95	87	81	76	84	79	75	82	77	74	79	76	73	71
4	90	80	73	67	88	79	72	67	76	71	66	74	69	65	72	68	64	63
5	83	73	65	60	82	72	65	59	70	63	59	68	62	58	66	61	58	56
6	78	66	58	53	76	65	58	53	64	57	52	62	56	52	61	55	52	50
7	72	60	53	47	71	60	52	47	58	52	47	57	51	47	56	50	46	45
8	68	56	48	43	66	55	48	43	54	47	42	52	47	42	51	46	42	40
9	63	51	44	39	62	51	44	39	50	43	39	49	43	38	48	42	38	37
10	59	47	40	35	58	47	40	35	46	40	35	45	39	35	44	39	35	33

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	11470
5°	11427
10°	11278
15°	11073
20°	10828
25°	10564
30°	10271
35°	9933
40°	9559
45°	9139
50°	8590
55°	6060
60°	1911
65°	131
70°	92
75°	92
80°	93
85°	88

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 9139 cd/sqm

TEST NUMBER: P865984

CATALOG NUMBER: PRLX-2001-M-930-35L-L-U-S-X-X-BLAK-X

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	127.0	4.9
10°-20°	355.1	13.8
20°-30°	519.3	20.2
30°-40°	599.4	23.3
40°-50°	586.6	22.8
50°-60°	351.9	13.7
60°-70°	27.4	1.1
70°-80°	3.2	0.1
80°-90°	1.3	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1001.4	38.9
0°-40°	1600.8	62.3
0°-60°	2539.3	98.8
0°-90°	2571.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2571.1	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1352	
5°	1341	127
15°	1260	355
25°	1128	519
35°	959	599
45°	762	587
55°	410	352
65°	6	27
75°	3	3
85°	1	1
90°	0	

TEST NUMBER: P865984

CATALOG NUMBER: PRLX-2001-M-930-35L-L-U-S-X-X-BLAK-X

CANDELA DISTRIBUTION (FULL):

	0°
0°	1351.6
2.5°	1349.8
5°	1341.4
7.5°	1327.4
10°	1308.8
12.5°	1287.4
15°	1260.4
17.5°	1231.6
20°	1199.0
22.5°	1164.5
25°	1128.2
27.5°	1089.1
30°	1048.2
32.5°	1004.4
35°	958.8
37.5°	912.3
40°	862.9
42.5°	815.5
45°	761.5
47.5°	707.5
50°	650.7
52.5°	558.5
55°	409.6
57.5°	241.1
60°	112.6
62.5°	44.7
65°	6.5
67.5°	3.7
70°	3.7
72.5°	3.7
75°	2.8
77.5°	2.8
80°	1.9
82.5°	1.9
85°	0.9
87.5°	0.9
90°	0.0



TEST NUMBER: P865984

CATALOG NUMBER: PRLX-2001-M-930-35L-L-U-S-X-X-BLAK-X

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	14.94	16.32	15.31	16.63	16.94	14.94	16.32	15.31	16.63	16.94
	3H	14.82	16.03	15.20	16.36	16.72	14.82	16.03	15.20	16.36	16.72
	4H	14.75	15.87	15.15	16.22	16.60	14.75	15.87	15.15	16.22	16.60
	6H	14.68	15.70	15.09	16.07	16.47	14.68	15.70	15.09	16.07	16.47
	8H	14.64	15.61	15.07	16.00	16.40	14.64	15.61	15.07	16.00	16.40
	12H	14.60	15.52	15.03	15.91	16.34	14.60	15.52	15.03	15.91	16.34
4H	2H	14.75	15.87	15.15	16.22	16.60	14.75	15.87	15.15	16.22	16.60
	3H	14.63	15.53	15.05	15.93	16.34	14.63	15.53	15.05	15.93	16.34
	4H	14.55	15.34	14.98	15.76	16.21	14.55	15.34	14.98	15.76	16.21
	6H	14.47	15.15	14.93	15.60	16.07	14.47	15.15	14.93	15.60	16.07
	8H	14.41	15.05	14.88	15.50	15.97	14.41	15.05	14.88	15.50	15.97
	12H	14.37	14.93	14.85	15.42	15.89	14.37	14.93	14.85	15.42	15.89
8H	4H	14.41	15.05	14.88	15.50	15.97	14.41	15.05	14.88	15.50	15.97
	6H	14.31	14.83	14.81	15.33	15.81	14.31	14.83	14.81	15.33	15.81
	8H	14.24	14.72	14.76	15.24	15.73	14.24	14.72	14.76	15.24	15.73
	12H	14.19	14.62	14.70	15.12	15.69	14.19	14.62	14.70	15.12	15.69
12H	4H	14.36	14.93	14.85	15.41	15.89	14.36	14.93	14.85	15.41	15.89
	6H	14.24	14.72	14.76	15.23	15.72	14.24	14.72	14.76	15.23	15.72
	8H	14.19	14.62	14.70	15.11	15.68	14.19	14.62	14.70	15.11	15.68