

Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P866022

Luminaire Tested: PRLX-2001-M-935-07L-G-U-S-X-X-GREY-X

Issue Date: 8/20/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P866022  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2304-993-36)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 8/20/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: Prenalux  
Catalog Number: PRLX-2001-M-935-07L-G-U-S-X-X-GREY-X  
Description: PRENTALUX 3D PRINTED PENDANT LED LUMINAIRE, MEDIUM LIGHT ENGINE, GLOBE LENS,  
TAPERED DRUM WITH GRAY INTERIOR SHADE.  
LIGHT LEVEL 1  
Light Source: 3500K CCT, 90 CRI LEDS  
Ballast/Driver: -


**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 260.2 lumens  
Efficiency: N/A  
Efficacy: 31.7 lumens/watt  
Spacing Criteria (0/90/45): 1.33 / 1.33 / 1.49  
Luminous Opening: Circular (Dia: 1.27' x H: 0')  
CIE Type: Direct  
  
Input Watts (W): 8.2  
Input Voltage (V): 120  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: 0.5 HR  
Operation Time: 3 HR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P866022

CATALOG NUMBER: PRLX-2001-M-935-07L-G-U-S-X-X-GREY-X

### Luminous Intensity Polar Plot

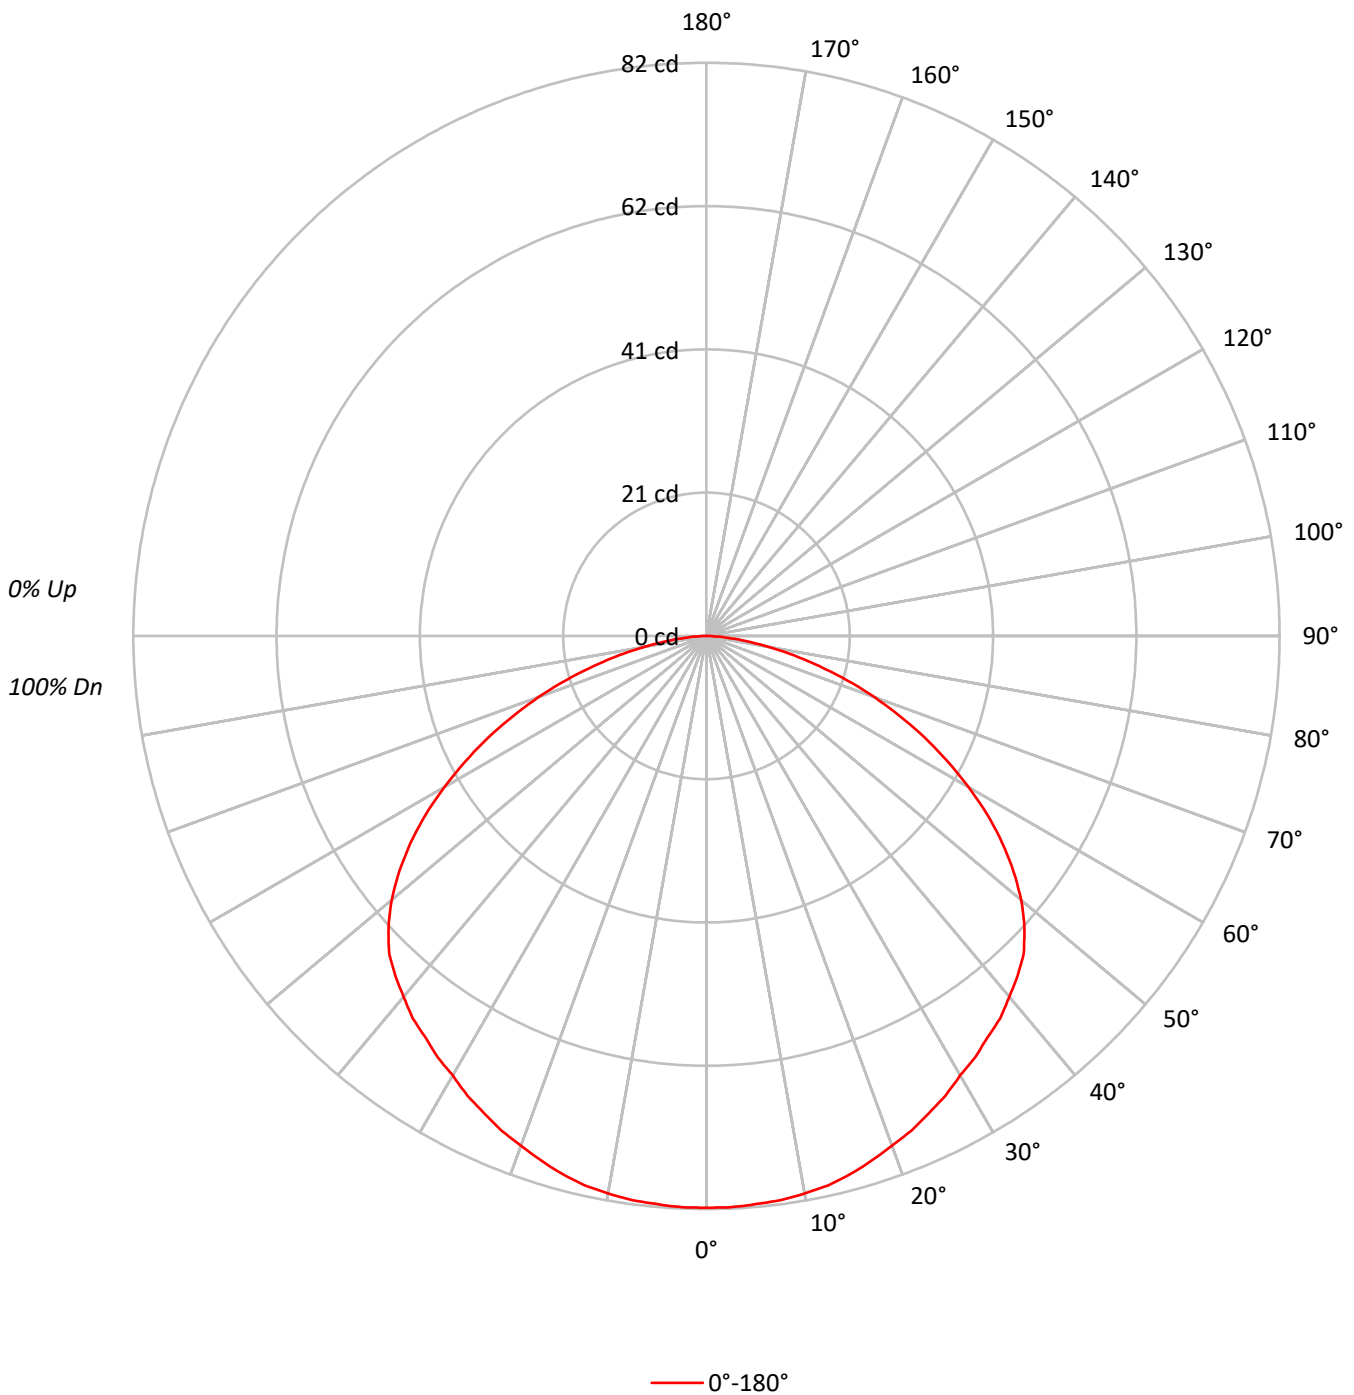



TEST NUMBER: P866022

CATALOG NUMBER: PRLX-2001-M-935-07L-G-U-S-X-X-GREY-X

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20			
RC	80				70				50				30				10	0		
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50	30	10	0
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102	102	102	100
1	109	104	100	96	106	102	98	94	97	94	91		93	91	88		90	88	86	84
2	99	90	83	77	96	88	82	76	85	79	75		81	77	73		78	75	71	69
3	90	79	70	64	87	77	69	63	74	68	62		71	66	61		69	64	60	58
4	82	69	60	54	79	68	60	53	66	58	52		63	57	52		61	56	51	49
5	75	62	53	46	73	61	52	46	59	51	45		57	50	45		55	49	44	42
6	69	55	46	40	67	54	46	40	53	45	39		51	44	39		49	43	38	36
7	64	50	41	35	62	49	41	35	48	40	34		46	39	34		45	39	34	32
8	59	46	37	31	58	45	37	31	44	36	31		42	35	30		41	35	30	28
9	55	42	33	28	54	41	33	28	40	33	27		39	32	27		38	32	27	25
10	52	38	30	25	51	38	30	25	37	30	25		36	29	25		35	29	25	23

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	694
5°	695
10°	698
15°	700
20°	701
25°	705
30°	711
35°	726
40°	747
45°	770
50°	776
55°	765
60°	735
65°	693
70°	633
75°	548
80°	440
85°	302

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 50°  
 Luminance: 776 cd/sqm

TEST NUMBER: P866022

CATALOG NUMBER: PRLX-2001-M-935-07L-G-U-S-X-X-GREY-X

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	7.8	3.0
10°-20°	22.5	8.6
20°-30°	34.8	13.4
30°-40°	44.0	16.9
40°-50°	49.3	18.9
50°-60°	46.0	17.7
60°-70°	34.1	13.1
70°-80°	17.9	6.9
80°-90°	3.9	1.5
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	65.0	25.0
0°-40°	109.1	41.9
0°-60°	204.4	78.5
0°-90°	260.2	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	260.2	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	82	
5°	82	8
15°	80	22
25°	75	35
35°	70	44
45°	64	49
55°	52	46
65°	34	34
75°	17	18
85°	3	4
90°	0	

TEST NUMBER: P866022

CATALOG NUMBER: PRLX-2001-M-935-07L-G-U-S-X-X-GREY-X

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	81.8
2.5°	81.8
5°	81.6
7.5°	81.4
10°	81.0
12.5°	80.5
15°	79.7
17.5°	78.7
20°	77.6
22.5°	76.6
25°	75.3
27.5°	74.1
30°	72.6
32.5°	71.5
35°	70.1
37.5°	69.0
40°	67.4
42.5°	65.9
45°	64.2
47.5°	61.7
50°	58.8
52.5°	55.4
55°	51.7
57.5°	47.7
60°	43.3
62.5°	38.9
65°	34.5
67.5°	29.9
70°	25.5
72.5°	21.1
75°	16.7
77.5°	12.8
80°	9.0
82.5°	5.7
85°	3.1
87.5°	1.0
90°	0.0



TEST NUMBER: P866022  
 CATALOG NUMBER: PRLX-2001-M-935-07L-G-U-S-X-X-GREY-X

**CIE UGR TABLE:**

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.50	13.17	11.86	13.49	13.80	11.50	13.17	11.86	13.49	13.80
	3H	13.16	14.67	13.54	15.00	15.36	13.16	14.67	13.54	15.00	15.36
	4H	13.72	15.15	14.12	15.50	15.87	13.72	15.15	14.12	15.50	15.87
	6H	14.08	15.41	14.50	15.77	16.16	14.08	15.41	14.50	15.77	16.16
	8H	14.17	15.43	14.60	15.82	16.22	14.17	15.43	14.60	15.82	16.22
	12H	14.22	15.43	14.65	15.81	16.24	14.22	15.43	14.65	15.81	16.24
4H	2H	12.11	13.53	12.51	13.88	14.25	12.11	13.53	12.51	13.88	14.25
	3H	13.98	15.17	14.39	15.57	15.97	13.98	15.17	14.39	15.57	15.97
	4H	14.65	15.73	15.08	16.14	16.58	14.65	15.73	15.08	16.14	16.58
	6H	15.12	16.06	15.57	16.50	16.95	15.12	16.06	15.57	16.50	16.95
	8H	15.24	16.12	15.70	16.56	17.02	15.24	16.12	15.70	16.56	17.02
	12H	15.31	16.10	15.79	16.58	17.04	15.31	16.10	15.79	16.58	17.04
8H	4H	14.91	15.79	15.37	16.24	16.70	14.91	15.79	15.37	16.24	16.70
	6H	15.47	16.20	15.96	16.68	17.16	15.47	16.20	15.96	16.68	17.16
	8H	15.63	16.29	16.14	16.79	17.28	15.63	16.29	16.14	16.79	17.28
	12H	15.75	16.33	16.25	16.82	17.38	15.75	16.33	16.25	16.82	17.38
12H	4H	14.93	15.72	15.41	16.20	16.67	14.93	15.72	15.41	16.20	16.67
	6H	15.49	16.15	16.00	16.66	17.14	15.49	16.15	16.00	16.66	17.14
	8H	15.70	16.28	16.21	16.77	17.33	15.70	16.28	16.21	16.77	17.33