

Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P866025

Luminaire Tested: PRLX-2001-M-935-07L-L-U-S-X-X-BRSS-X

Issue Date: 8/20/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P866025  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2304-993-47)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 8/20/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: Prenalux  
Catalog Number: PRLX-2001-M-935-07L-L-U-S-X-X-BRSS-X  
Description: PRENTALUX 3D PRINTED PENDANT LED LUMINAIRE, MEDIUM LIGHT ENGINE, FLAT LENS,  
TAPERED DRUM WITH BRASS INTERIOR SHADE.  
LIGHT LEVEL 1  
Light Source: 3500K CCT, 90 CRI LEDS  
Ballast/Driver: -


**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 567.3 lumens  
Efficiency: N/A  
Efficacy: 69.2 lumens/watt  
Spacing Criteria (0/90/45): 1.15 / 1.15 / 1.27  
Luminous Opening: Circular (Dia: 1.27' x H: 0')  
CIE Type: Direct  
  
Input Watts (W): 8.2  
Input Voltage (V): 120  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: 0.333 HR  
Operation Time: 3 HR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P866025

CATALOG NUMBER: PRLX-2001-M-935-07L-L-U-S-X-X-BRSS-X

### Luminous Intensity Polar Plot

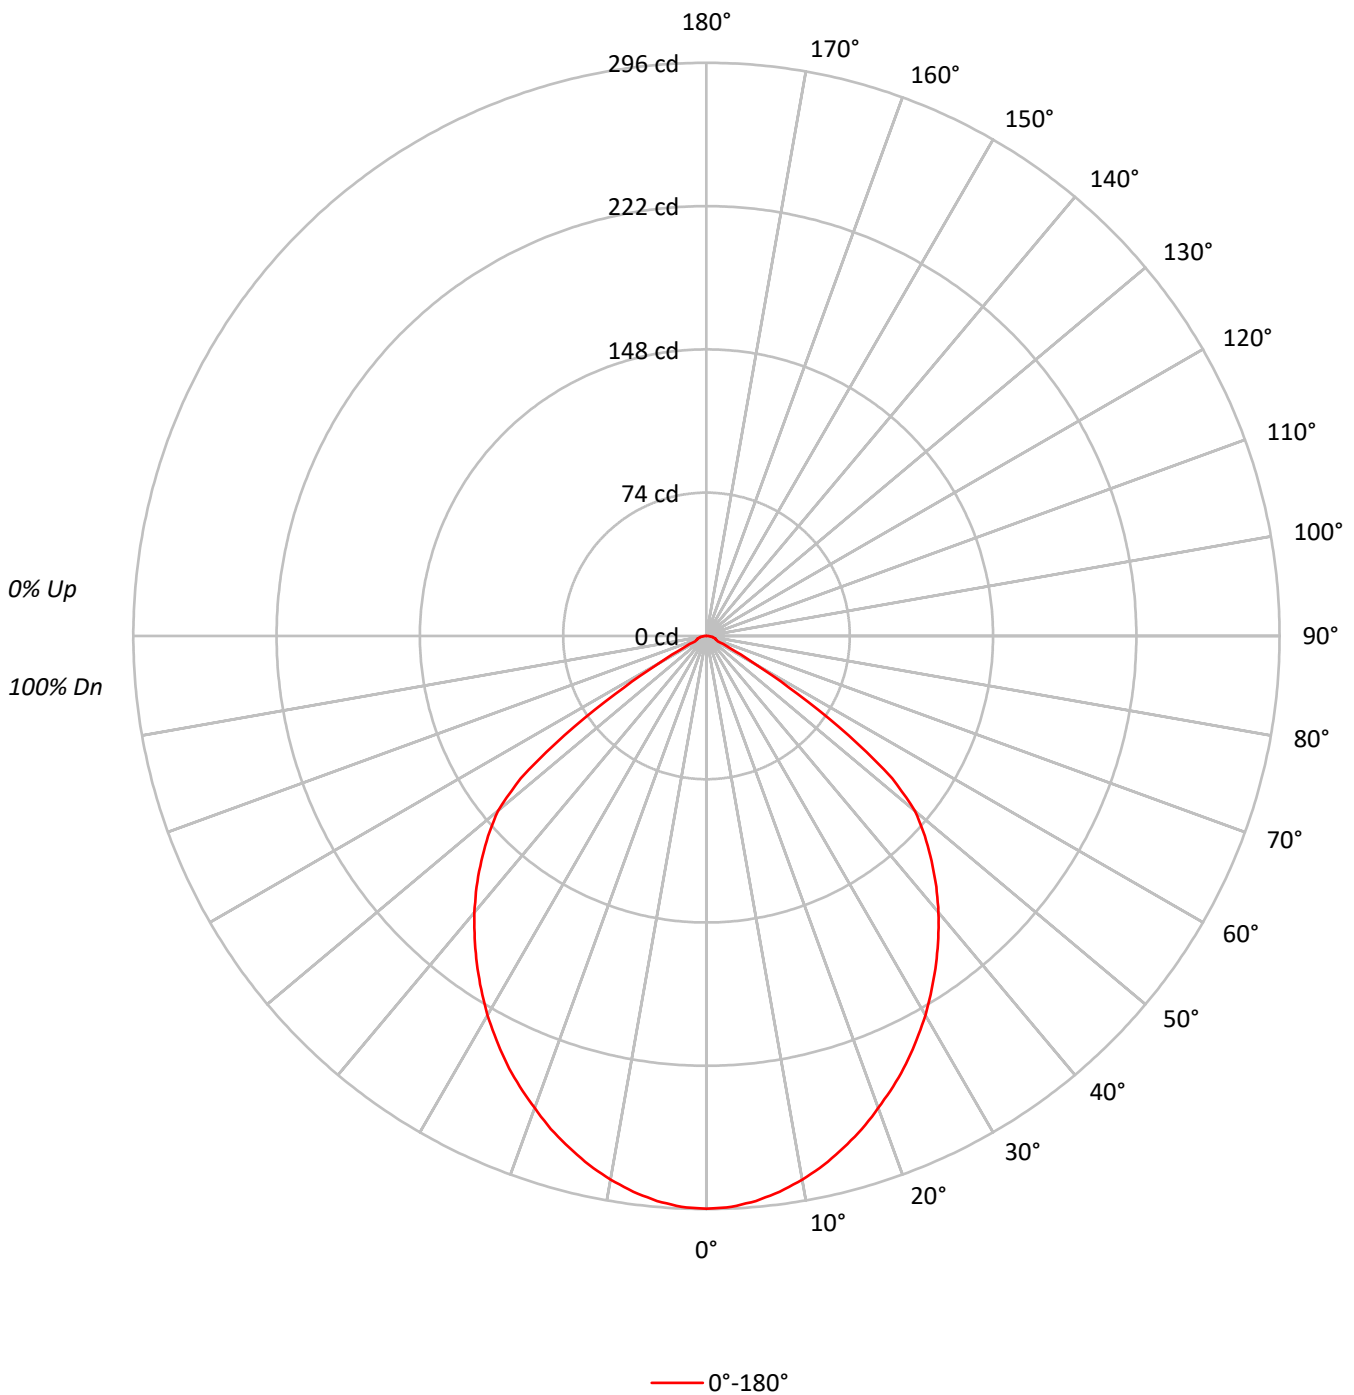



TEST NUMBER: P866025

CATALOG NUMBER: PRLX-2001-M-935-07L-L-U-S-X-X-BRSS-X

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	112	108	105	102	109	106	103	100	102	99	97	98	96	94	94	93	92	90
2	104	97	92	88	101	96	91	87	92	88	85	89	86	83	86	83	81	79
3	96	88	81	76	94	86	80	75	83	78	74	81	76	73	78	75	72	70
4	89	79	72	66	87	78	71	66	76	70	65	74	68	64	71	67	64	62
5	83	72	64	59	81	71	64	58	69	63	58	67	61	57	65	60	57	55
6	77	65	58	52	75	65	57	52	63	56	51	61	56	51	60	55	51	49
7	72	60	52	47	70	59	52	47	58	51	46	56	50	46	55	50	46	44
8	67	55	47	42	66	54	47	42	53	46	42	52	46	42	51	45	41	40
9	63	51	43	38	62	50	43	38	49	42	38	48	42	38	47	42	38	36
10	59	47	40	35	58	46	39	35	45	39	35	45	39	35	44	38	34	33

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	2510
5°	2495
10°	2457
15°	2404
20°	2343
25°	2284
30°	2216
35°	2141
40°	2065
45°	1973
50°	1856
55°	1327
60°	494
65°	131
70°	129
75°	138
80°	151
85°	146

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 1973 cd/sqm

TEST NUMBER: P866025

CATALOG NUMBER: PRLX-2001-M-935-07L-L-U-S-X-X-BRSS-X

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	27.7	4.9
10°-20°	77.1	13.6
20°-30°	112.2	19.8
30°-40°	129.2	22.8
40°-50°	126.6	22.3
50°-60°	77.7	13.7
60°-70°	10.6	1.9
70°-80°	4.4	0.8
80°-90°	1.7	0.3
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	217.0	38.3
0°-40°	346.2	61.0
0°-60°	550.6	97.1
0°-90°	567.3	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	567.3	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	296	
5°	293	28
15°	274	77
25°	244	112
35°	207	129
45°	164	127
55°	90	78
65°	6	11
75°	4	4
85°	2	2
90°	0	



TEST NUMBER: P866025

CATALOG NUMBER: PRLX-2001-M-935-07L-L-U-S-X-X-BRSS-X

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	295.8
2.5°	295.2
5°	292.9
7.5°	289.5
10°	285.1
12.5°	279.9
15°	273.6
17.5°	267.1
20°	259.4
22.5°	251.9
25°	243.9
27.5°	235.1
30°	226.1
32.5°	216.5
35°	206.7
37.5°	196.6
40°	186.4
42.5°	175.7
45°	164.4
47.5°	152.9
50°	140.6
52.5°	120.9
55°	89.7
57.5°	55.7
60°	29.1
62.5°	14.2
65°	6.5
67.5°	5.4
70°	5.2
72.5°	4.8
75°	4.2
77.5°	3.6
80°	3.1
82.5°	2.3
85°	1.5
87.5°	0.8
90°	0.0



TEST NUMBER: P866025  
 CATALOG NUMBER: PRLX-2001-M-935-07L-L-U-S-X-X-BRSS-X

**CIE UGR TABLE:**

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	10.01	11.41	10.38	11.72	12.04	10.01	11.41	10.38	11.72	12.04
	3H	9.96	11.18	10.33	11.51	11.88	9.96	11.18	10.33	11.51	11.88
	4H	9.94	11.08	10.34	11.43	11.81	9.94	11.08	10.34	11.43	11.81
	6H	9.92	10.97	10.34	11.34	11.73	9.92	10.97	10.34	11.34	11.73
	8H	9.91	10.90	10.34	11.29	11.70	9.91	10.90	10.34	11.29	11.70
	12H	9.89	10.84	10.33	11.22	11.65	9.89	10.84	10.33	11.22	11.65
4H	2H	9.85	10.99	10.25	11.34	11.72	9.85	10.99	10.25	11.34	11.72
	3H	9.83	10.75	10.24	11.15	11.55	9.83	10.75	10.24	11.15	11.55
	4H	9.82	10.64	10.26	11.06	11.50	9.82	10.64	10.26	11.06	11.50
	6H	9.85	10.55	10.31	11.00	11.47	9.85	10.55	10.31	11.00	11.47
	8H	9.84	10.50	10.31	10.95	11.42	9.84	10.50	10.31	10.95	11.42
	12H	9.84	10.43	10.33	10.91	11.38	9.84	10.43	10.33	10.91	11.38
8H	4H	9.74	10.40	10.21	10.84	11.31	9.74	10.40	10.21	10.84	11.31
	6H	9.78	10.32	10.28	10.82	11.30	9.78	10.32	10.28	10.82	11.30
	8H	9.79	10.28	10.31	10.80	11.29	9.79	10.28	10.31	10.80	11.29
	12H	9.81	10.25	10.32	10.75	11.32	9.81	10.25	10.32	10.75	11.32
12H	4H	9.70	10.29	10.19	10.77	11.24	9.70	10.29	10.19	10.77	11.24
	6H	9.73	10.23	10.25	10.74	11.23	9.73	10.23	10.25	10.74	11.23
	8H	9.77	10.22	10.28	10.71	11.28	9.77	10.22	10.28	10.71	11.28