

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P866027

Luminaire Tested: PRLX-2001-M-935-07L-L-U-S-X-X-WHHR-X

Issue Date: 8/20/2024

Test Information

Test Method: LM-79-2019
Report Number: P866027
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2304-993-46)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 8/20/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: Prenalux
Catalog Number: PRLX-2001-M-935-07L-L-U-S-X-X-WHHR-X
Description: PRENTALUX 3D PRINTED PENDANT LED LUMINAIRE, MEDIUM LIGHT ENGINE, FLAT LENS,
TAPERED DRUM WITH WHITE INTERIOR SHADE.
LIGHT LEVEL 1
Light Source: 3500K CCT, 90 CRI LEDS
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 706.0 lumens
Efficiency: N/A
Efficacy: 86.1 lumens/watt
Spacing Criteria (0/90/45): 1.18 / 1.18 / 1.31
Luminous Opening: Circular (Dia: 1.27' x H: 0')
CIE Type: Direct

Input Watts (W): 8.2
Input Voltage (V): 120
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: 0.333 HR
Operation Time: 3 HR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P866027

CATALOG NUMBER: PRLX-2001-M-935-07L-L-U-S-X-X-WHHR-X

Luminous Intensity Polar Plot

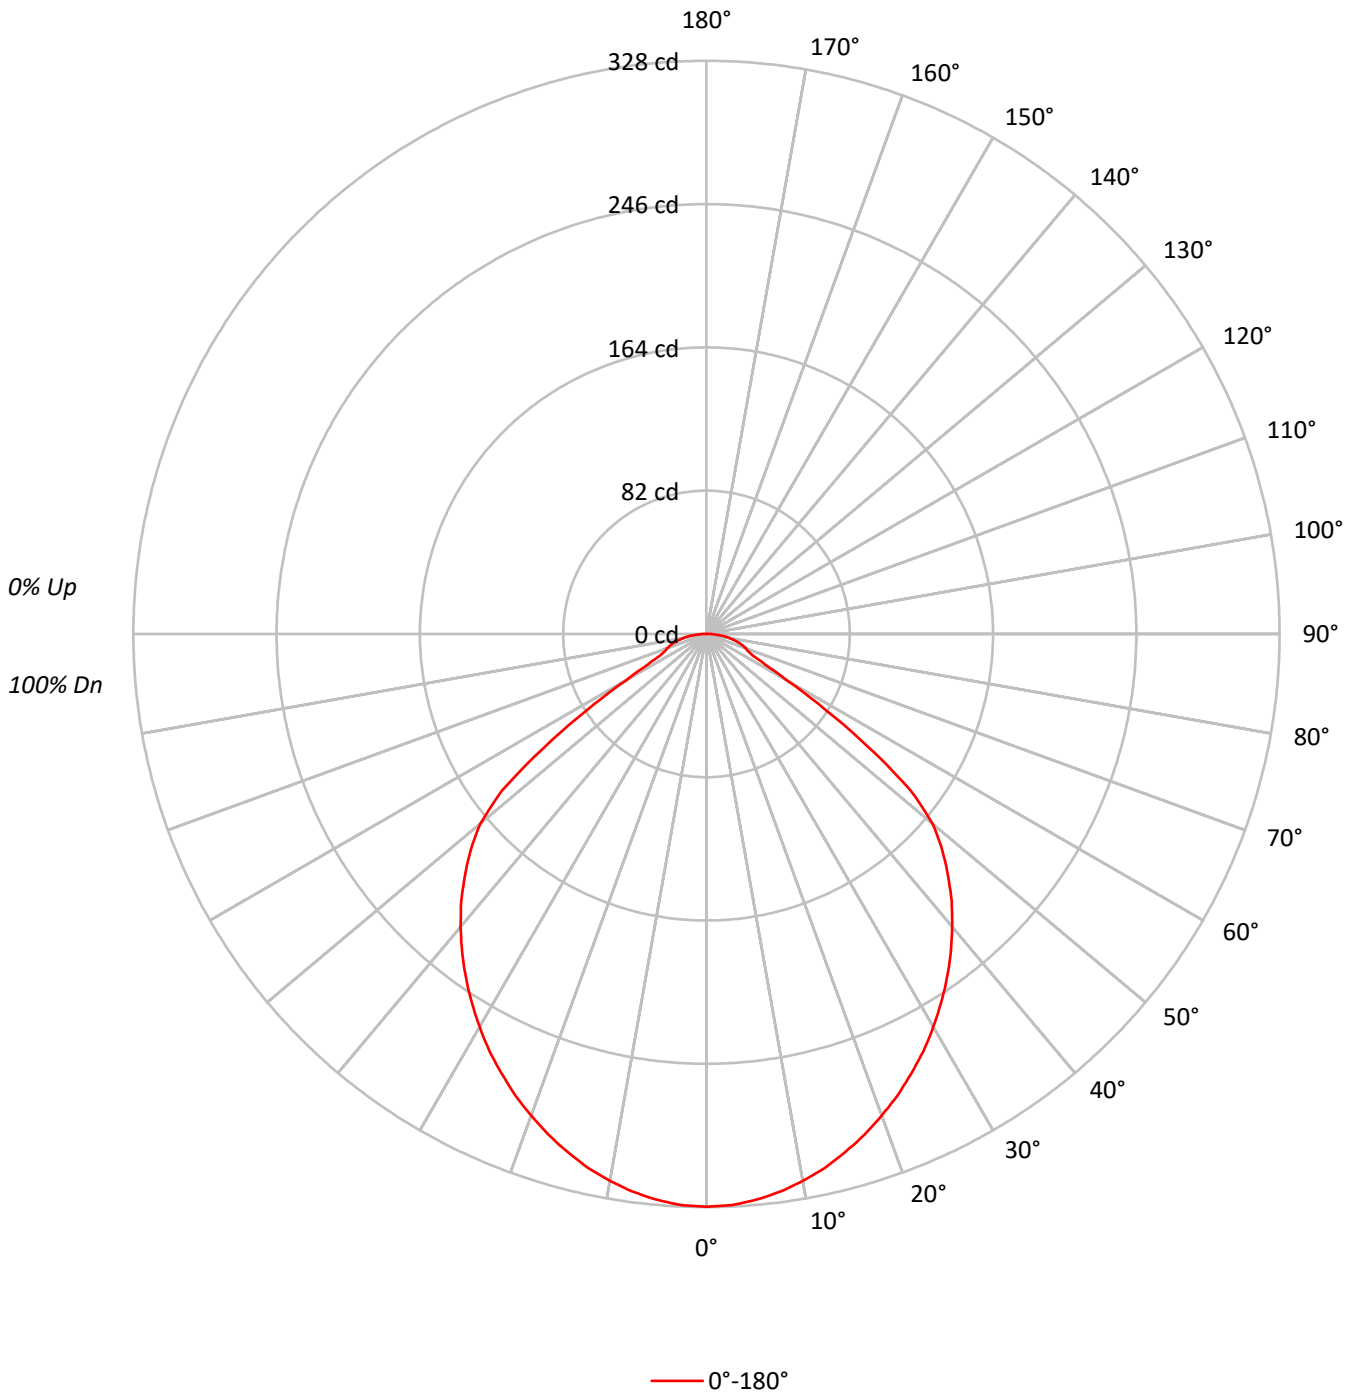



TEST NUMBER: P866027

CATALOG NUMBER: PRLX-2001-M-935-07L-L-U-S-X-X-WHHR-X

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	111	107	103	100	108	104	101	98	100	98	95	96	94	92	93	91	90	88
2	102	95	89	84	100	93	88	83	90	85	82	87	83	80	84	81	78	76
3	94	85	78	72	92	84	77	72	81	75	71	78	73	69	76	72	68	66
4	87	77	69	63	85	75	68	62	73	67	62	71	65	61	69	64	60	58
5	81	69	61	55	79	68	60	55	66	59	54	64	58	54	62	57	53	51
6	75	63	55	49	73	62	54	48	60	53	48	58	52	48	57	52	47	45
7	70	57	49	43	68	56	49	43	55	48	43	54	47	43	52	47	42	41
8	65	52	44	39	64	52	44	39	50	44	39	49	43	38	48	42	38	37
9	61	48	41	35	59	48	40	35	47	40	35	46	39	35	45	39	35	33
10	57	45	37	32	56	44	37	32	43	37	32	42	36	32	41	36	32	30

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	2782
5°	2769
10°	2738
15°	2696
20°	2649
25°	2597
30°	2544
35°	2486
40°	2424
45°	2345
50°	2231
55°	1690
60°	906
65°	584
70°	591
75°	623
80°	645
85°	652

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 2345 cd/sqm

TEST NUMBER: P866027

CATALOG NUMBER: PRLX-2001-M-935-07L-L-U-S-X-X-WHHR-X

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	30.8	4.4
10°-20°	86.5	12.3
20°-30°	127.8	18.1
30°-40°	150.1	21.3
40°-50°	150.5	21.3
50°-60°	100.8	14.3
60°-70°	32.4	4.6
70°-80°	19.8	2.8
80°-90°	7.3	1.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	245.2	34.7
0°-40°	395.3	56.0
0°-60°	646.5	91.6
0°-90°	706.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	706.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	328	
5°	325	31
15°	307	87
25°	277	128
35°	240	150
45°	195	150
55°	114	101
65°	29	32
75°	19	20
85°	7	7
90°	0	

TEST NUMBER: P866027

CATALOG NUMBER: PRLX-2001-M-935-07L-L-U-S-X-X-WHHR-X

CANDELA DISTRIBUTION (FULL):

0°	
0°	327.8
2.5°	327.2
5°	325.1
7.5°	322.0
10°	317.8
12.5°	313.0
15°	306.9
17.5°	300.6
20°	293.3
22.5°	285.8
25°	277.4
27.5°	269.0
30°	259.6
32.5°	250.0
35°	240.0
37.5°	229.7
40°	218.8
42.5°	207.7
45°	195.4
47.5°	183.0
50°	169.0
52.5°	147.5
55°	114.2
57.5°	81.0
60°	53.4
62.5°	37.7
65°	29.1
67.5°	25.7
70°	23.8
72.5°	21.5
75°	19.0
77.5°	16.1
80°	13.2
82.5°	10.2
85°	6.7
87.5°	3.4
90°	0.0

TEST NUMBER: P866027

CATALOG NUMBER: PRLX-2001-M-935-07L-L-U-S-X-X-WHHR-X

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	11.83	13.31	12.20	13.62	13.93	11.83	13.31	12.20	13.62	13.93
	3H	12.31	13.62	12.69	13.95	14.31	12.31	13.62	12.69	13.95	14.31
	4H	12.64	13.86	13.04	14.21	14.59	12.64	13.86	13.04	14.21	14.59
	6H	12.96	14.09	13.38	14.46	14.85	12.96	14.09	13.38	14.46	14.85
	8H	13.10	14.17	13.53	14.56	14.97	13.10	14.17	13.53	14.56	14.97
	12H	13.21	14.23	13.64	14.62	15.05	13.21	14.23	13.64	14.62	15.05
4H	2H	11.87	13.09	12.27	13.44	13.82	11.87	13.09	12.27	13.44	13.82
	3H	12.58	13.58	12.99	13.98	14.38	12.58	13.58	12.99	13.98	14.38
	4H	13.05	13.95	13.49	14.37	14.81	13.05	13.95	13.49	14.37	14.81
	6H	13.55	14.33	14.01	14.77	15.24	13.55	14.33	14.01	14.77	15.24
	8H	13.76	14.49	14.23	14.94	15.40	13.76	14.49	14.23	14.94	15.40
	12H	13.93	14.59	14.42	15.07	15.54	13.93	14.59	14.42	15.07	15.54
8H	4H	13.22	13.95	13.68	14.39	14.86	13.22	13.95	13.68	14.39	14.86
	6H	13.85	14.45	14.35	14.95	15.43	13.85	14.45	14.35	14.95	15.43
	8H	14.15	14.70	14.66	15.21	15.70	14.15	14.70	14.66	15.21	15.70
	12H	14.41	14.91	14.92	15.40	15.96	14.41	14.91	14.92	15.40	15.96
12H	4H	13.23	13.88	13.72	14.36	14.83	13.23	13.88	13.72	14.36	14.83
	6H	13.89	14.44	14.41	14.95	15.44	13.89	14.44	14.41	14.95	15.44
	8H	14.25	14.75	14.76	15.24	15.80	14.25	14.75	14.76	15.24	15.80