

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P866112

Luminaire Tested: PRLX-2001-M-940-35L-L-U-S-X-X-BLAK-X

Issue Date: 8/20/2024

Test Information

Test Method: LM-79-2019
Report Number: P866112
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2304-993-49)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 8/20/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: Prenalux
Catalog Number: PRLX-2001-M-940-35L-L-U-S-X-X-BLAK-X
Description: PRENTALUX 3D PRINTED PENDANT LED LUMINAIRE, MEDIUM LIGHT ENGINE, FLAT LENS,
TAPERED DRUM WITH BLACK INTERIOR SHADE.
LIGHT LEVEL 4
Light Source: 4000K CCT, 90 CRI LEDS
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 2776.4 lumens
Efficiency: N/A
Efficacy: 92.5 lumens/watt
Spacing Criteria (0/90/45): 1.16 / 1.16 / 1.27
Luminous Opening: Circular (Dia: 1.27' x H: 0')
CIE Type: Direct

Input Watts (W): 30
Input Voltage (V): 120
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: 0.5 HR
Operation Time: 3 HR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P866112

CATALOG NUMBER: PRLX-2001-M-940-35L-L-U-S-X-X-BLAK-X

Luminous Intensity Polar Plot

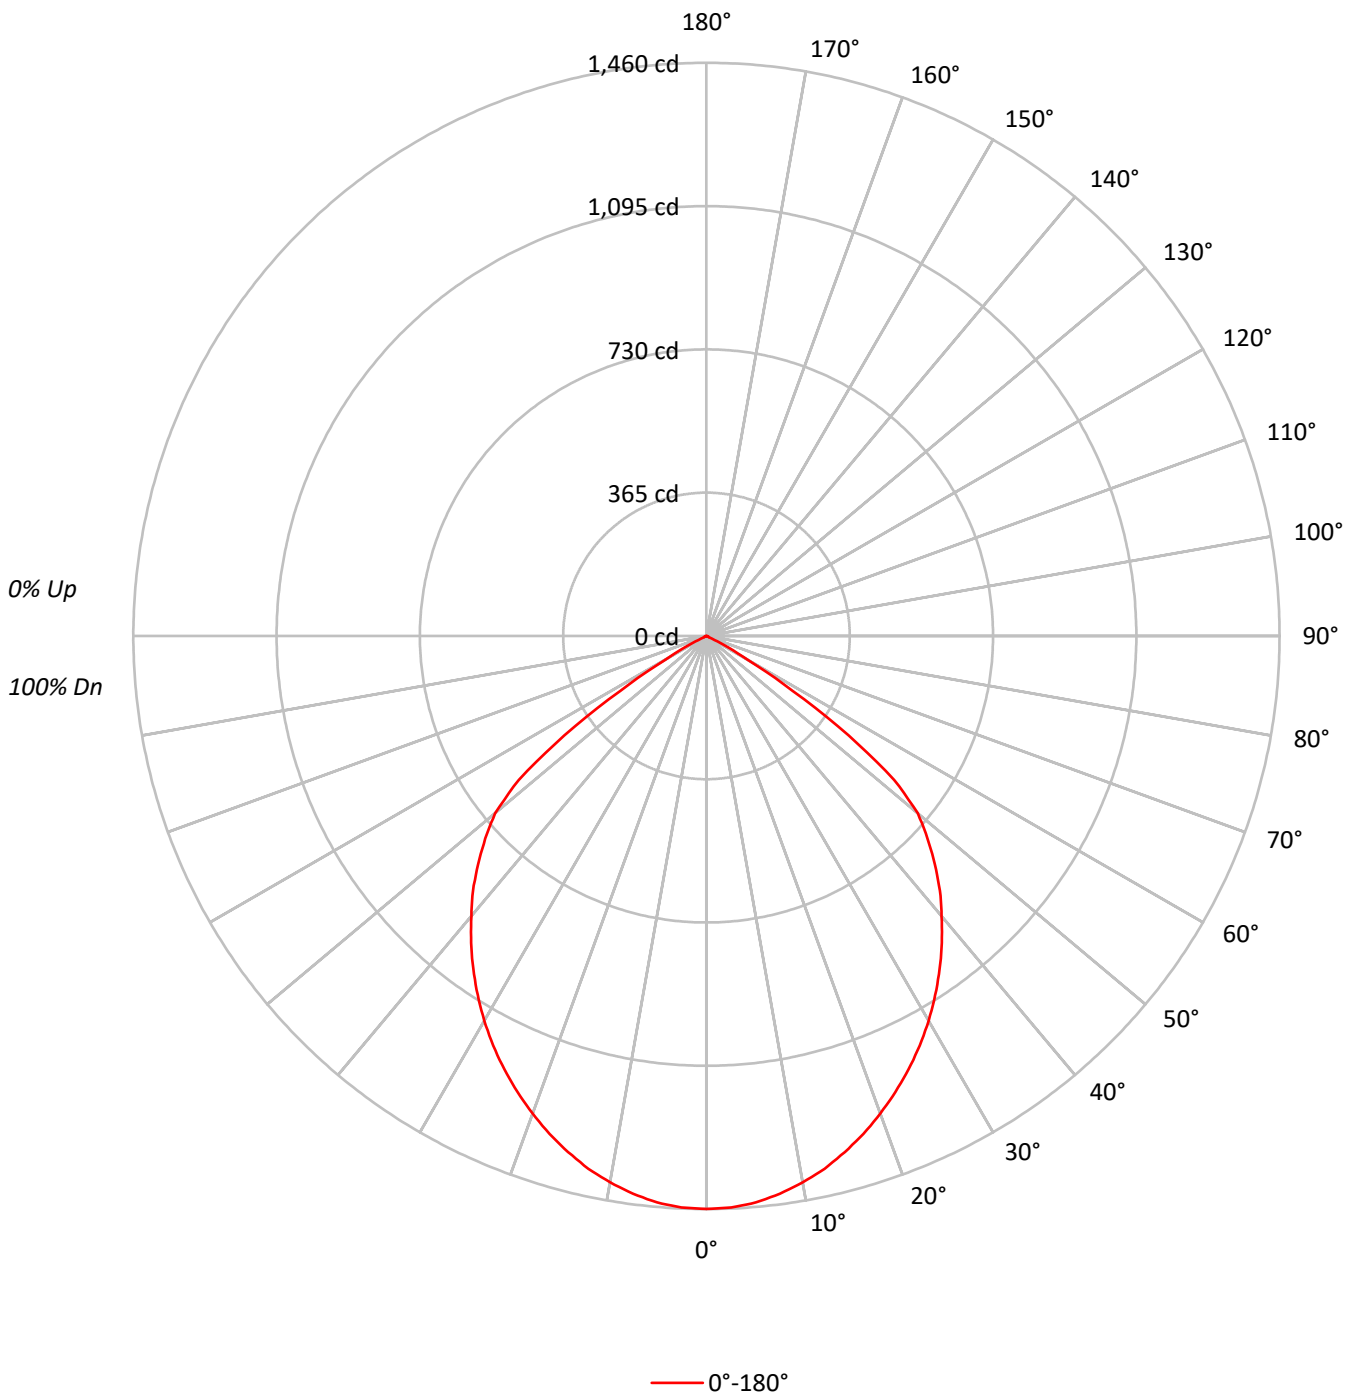



TEST NUMBER: P866112

CATALOG NUMBER: PRLX-2001-M-940-35L-L-U-S-X-X-BLAK-X

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	112	108	105	103	109	106	103	101	102	100	98	98	97	95	95	93	92	90
2	104	98	93	88	102	96	91	87	93	89	86	90	86	84	87	84	82	80
3	97	88	82	77	95	87	81	76	84	79	75	82	77	74	79	76	73	71
4	90	80	73	67	88	79	72	67	76	71	66	74	69	65	72	68	64	63
5	83	73	65	60	82	72	65	59	70	63	59	68	62	58	66	61	58	56
6	78	66	58	53	76	65	58	53	64	57	52	62	56	52	61	55	52	50
7	72	60	53	47	71	60	52	47	58	52	47	57	51	47	56	50	46	45
8	68	56	48	43	66	55	48	43	54	47	42	52	47	42	51	46	42	40
9	63	51	44	39	62	51	44	39	50	43	39	49	43	38	48	42	38	37
10	59	47	40	35	58	47	40	35	46	40	35	45	39	35	44	39	35	33

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	12386
5°	12339
10°	12178
15°	11958
20°	11692
25°	11407
30°	11091
35°	10726
40°	10322
45°	9868
50°	9276
55°	6544
60°	2064
65°	141
70°	99
75°	98
80°	98
85°	97

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 9868 cd/sqm

TEST NUMBER: P866112

CATALOG NUMBER: PRLX-2001-M-940-35L-L-U-S-X-X-BLAK-X

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	137.1	4.9
10°-20°	383.5	13.8
20°-30°	560.8	20.2
30°-40°	647.3	23.3
40°-50°	633.4	22.8
50°-60°	380.0	13.7
60°-70°	29.6	1.1
70°-80°	3.4	0.1
80°-90°	1.4	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1081.4	38.9
0°-40°	1728.6	62.3
0°-60°	2742.0	98.8
0°-90°	2776.4	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2776.4	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1460	
5°	1448	137
15°	1361	383
25°	1218	561
35°	1035	647
45°	822	633
55°	442	380
65°	7	30
75°	3	3
85°	1	1
90°	0	

TEST NUMBER: P866112

CATALOG NUMBER: PRLX-2001-M-940-35L-L-U-S-X-X-BLAK-X

CANDELA DISTRIBUTION (FULL):

0°	
0°	1459.6
2.5°	1457.6
5°	1448.5
7.5°	1433.4
10°	1413.3
12.5°	1390.2
15°	1361.1
17.5°	1329.9
20°	1294.7
22.5°	1257.5
25°	1218.3
27.5°	1176.1
30°	1131.9
32.5°	1084.6
35°	1035.4
37.5°	985.1
40°	931.8
42.5°	880.6
45°	822.3
47.5°	764.0
50°	702.6
52.5°	603.1
55°	442.3
57.5°	260.3
60°	121.6
62.5°	48.2
65°	7.0
67.5°	4.0
70°	4.0
72.5°	4.0
75°	3.0
77.5°	3.0
80°	2.0
82.5°	2.0
85°	1.0
87.5°	1.0
90°	0.0



TEST NUMBER: P866112
 CATALOG NUMBER: PRLX-2001-M-940-35L-L-U-S-X-X-BLAK-X

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	15.21	16.58	15.57	16.90	17.21	15.21	16.58	15.57	16.90	17.21
	3H	15.09	16.29	15.47	16.62	16.99	15.09	16.29	15.47	16.62	16.99
	4H	15.02	16.14	15.42	16.49	16.87	15.02	16.14	15.42	16.49	16.87
	6H	14.94	15.97	15.36	16.34	16.73	14.94	15.97	15.36	16.34	16.73
	8H	14.90	15.87	15.33	16.26	16.67	14.90	15.87	15.33	16.26	16.67
	12H	14.86	15.79	15.30	16.17	16.60	14.86	15.79	15.30	16.17	16.60
4H	2H	15.02	16.14	15.42	16.49	16.87	15.02	16.14	15.42	16.49	16.87
	3H	14.90	15.79	15.31	16.20	16.60	14.90	15.79	15.31	16.20	16.60
	4H	14.81	15.61	15.25	16.03	16.47	14.81	15.61	15.25	16.03	16.47
	6H	14.74	15.42	15.20	15.87	16.33	14.74	15.42	15.20	15.87	16.33
	8H	14.68	15.32	15.15	15.77	16.24	14.68	15.32	15.15	15.77	16.24
	12H	14.63	15.20	15.12	15.68	16.16	14.63	15.20	15.12	15.68	16.16
8H	4H	14.68	15.32	15.15	15.76	16.23	14.68	15.32	15.15	15.76	16.23
	6H	14.57	15.10	15.07	15.60	16.08	14.57	15.10	15.07	15.60	16.08
	8H	14.50	14.99	15.03	15.50	15.99	14.50	14.99	15.03	15.50	15.99
	12H	14.45	14.89	14.97	15.38	15.95	14.45	14.89	14.97	15.38	15.95
12H	4H	14.63	15.20	15.12	15.68	16.15	14.63	15.20	15.12	15.68	16.15
	6H	14.50	14.98	15.02	15.50	15.99	14.50	14.98	15.02	15.50	15.99
	8H	14.45	14.89	14.97	15.38	15.95	14.45	14.89	14.97	15.38	15.95