

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P865449

Luminaire Tested: PRLX-2001-S-927-25L-L-U-S-X-X-BRSS-X

Issue Date: 8/20/2024

Test Information

Test Method: LM-79-2019
Report Number: P865449
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2304-993-16)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 8/20/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: Prenalux
Catalog Number: PRLX-2001-S-927-25L-L-U-S-X-X-BRSS-X
Description: PRENTALUX 3D PRINTED PENDANT LED LUMINAIRE, SMALL LIGHT ENGINE, FLAT LENS, TAPERED DRUM WITH BRASS INTERIOR SHADE.
LIGHT LEVEL 5
Light Source: 2700K CCT, 90 CRI LEDS
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 1872.0 lumens
Efficiency: N/A
Efficacy: 64.3 lumens/watt
Spacing Criteria (0/90/45): 1.17 / 1.17 / 1.28
Luminous Opening: Circular (Dia: 0.92' x H: 0')
CIE Type: Direct

Input Watts (W): 29.1
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: 0.5 HR
Operation Time: 3 HR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P865449

CATALOG NUMBER: PRLX-2001-S-927-25L-L-U-S-X-X-BRSS-X

Luminous Intensity Polar Plot

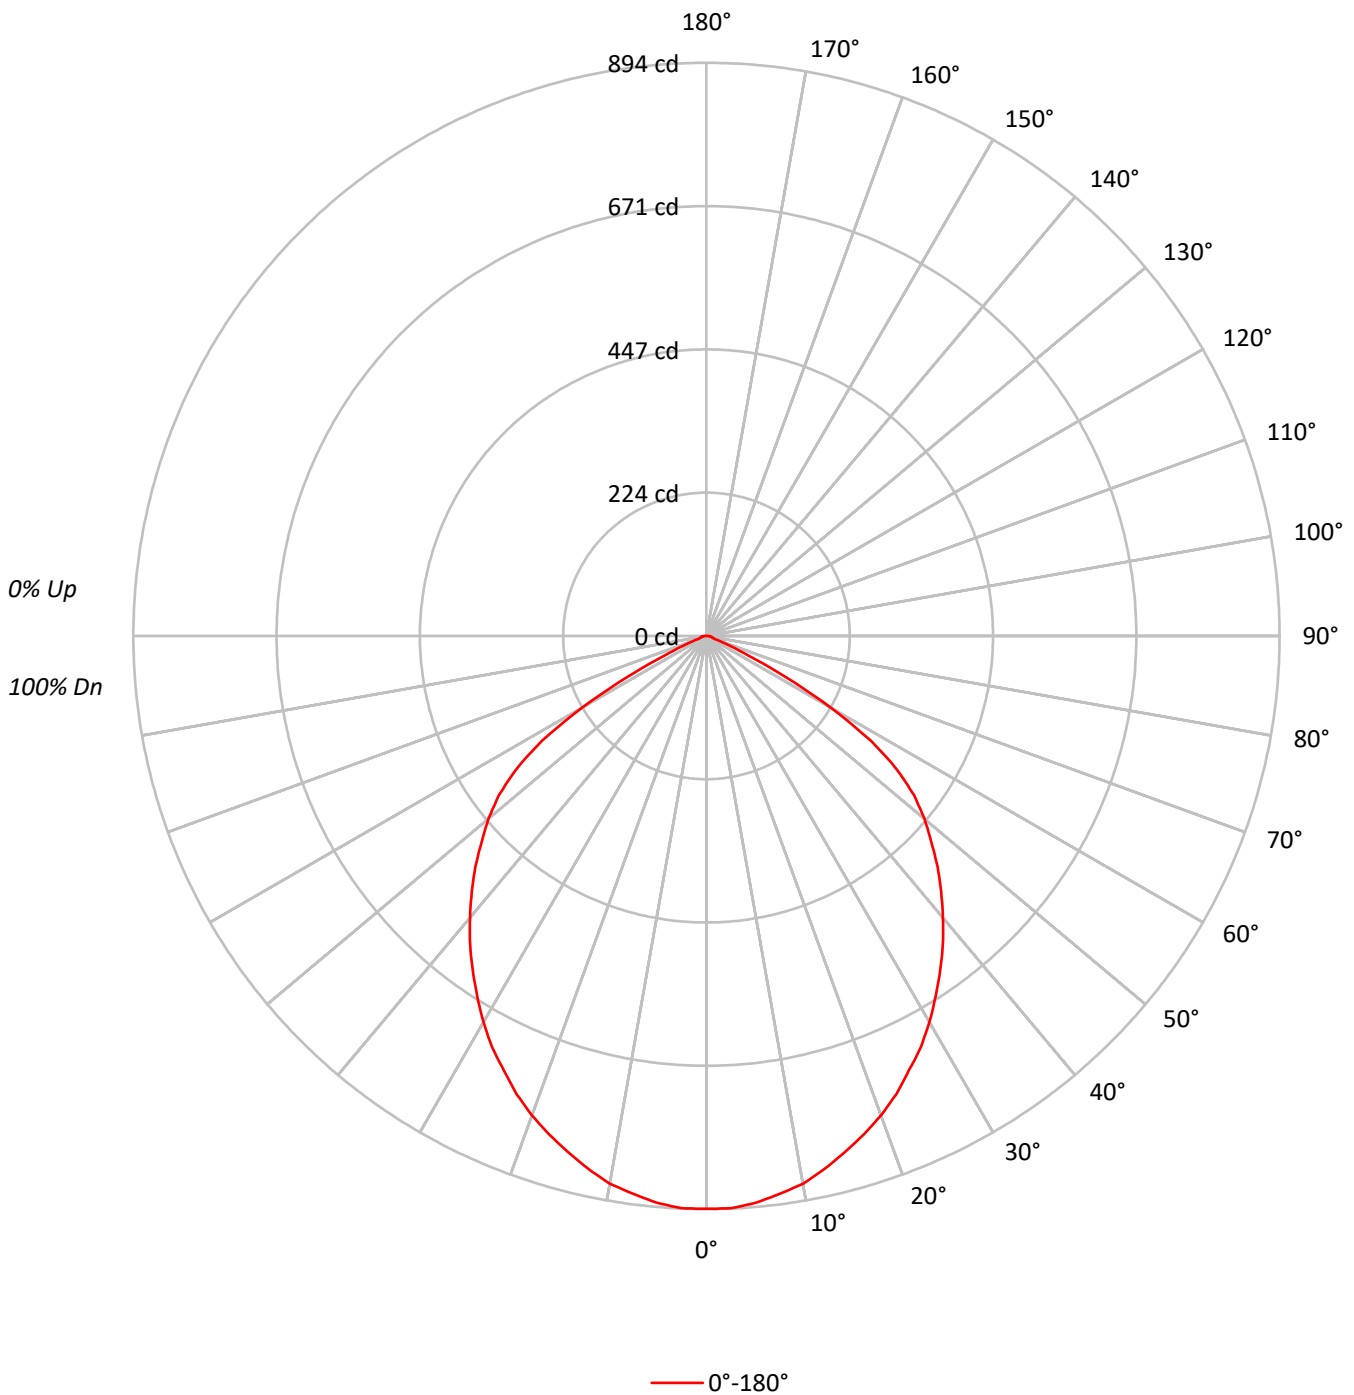



TEST NUMBER: P865449

CATALOG NUMBER: PRLX-2001-S-927-25L-L-U-S-X-X-BRSS-X

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	111	108	104	101	109	105	102	100	101	99	96	97	95	94	94	92	91	89
2	103	96	91	86	101	94	89	85	91	87	83	88	84	81	85	82	80	78
3	95	86	79	74	93	85	78	73	82	76	72	79	75	71	77	73	70	68
4	88	77	70	64	86	76	69	64	74	68	63	72	66	62	70	65	61	59
5	81	70	62	56	79	69	61	56	67	60	55	65	59	55	63	58	54	52
6	75	63	55	50	74	62	55	49	61	54	49	59	53	49	58	52	48	46
7	70	58	50	44	68	57	49	44	56	49	44	54	48	43	53	47	43	41
8	65	53	45	40	64	52	45	40	51	44	39	50	44	39	49	43	39	37
9	61	49	41	36	60	48	41	36	47	40	36	46	40	35	45	39	35	34
10	57	45	38	33	56	45	37	33	44	37	32	43	37	32	42	36	32	31

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	14573
5°	14531
10°	14367
15°	14074
20°	13809
25°	13454
30°	13100
35°	12657
40°	12215
45°	11757
50°	11261
55°	10288
60°	7304
65°	2779
70°	668
75°	630
80°	751
85°	1123

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 11757 cd/sqm

TEST NUMBER: P865449

CATALOG NUMBER: PRLX-2001-S-927-25L-L-U-S-X-X-BRSS-X

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	84.0	4.5
10°-20°	235.1	12.6
20°-30°	344.7	18.4
30°-40°	397.7	21.2
40°-50°	392.8	21.0
50°-60°	313.8	16.8
60°-70°	88.7	4.7
70°-80°	10.3	0.5
80°-90°	4.9	0.3
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	663.8	35.5
0°-40°	1061.5	56.7
0°-60°	1768.1	94.5
0°-90°	1872.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1872.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	894	
5°	888	84
15°	834	235
25°	748	345
35°	636	398
45°	510	393
55°	362	314
65°	72	89
75°	10	10
85°	6	5
90°	0	

TEST NUMBER: P865449

CATALOG NUMBER: PRLX-2001-S-927-25L-L-U-S-X-X-BRSS-X

CANDELA DISTRIBUTION (FULL):

	0°
0°	893.5
2.5°	893.5
5°	887.5
7.5°	877.5
10°	867.5
12.5°	851.5
15°	833.5
17.5°	815.6
20°	795.6
22.5°	773.6
25°	747.6
27.5°	723.6
30°	695.6
32.5°	665.6
35°	635.7
37.5°	605.7
40°	573.7
42.5°	541.7
45°	509.7
47.5°	475.7
50°	443.8
52.5°	407.8
55°	361.8
57.5°	303.8
60°	223.9
62.5°	139.9
65°	72.0
67.5°	32.0
70°	14.0
72.5°	10.0
75°	10.0
77.5°	8.0
80°	8.0
82.5°	6.0
85°	6.0
87.5°	2.0
90°	0.0



TEST NUMBER: P865449
 CATALOG NUMBER: PRLX-2001-S-927-25L-L-U-S-X-X-BRSS-X

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	19.96	21.42	20.33	21.73	22.05	19.96	21.42	20.33	21.73	22.05
	3H	19.89	21.17	20.27	21.50	21.87	19.89	21.17	20.27	21.50	21.87
	4H	19.83	21.03	20.23	21.38	21.76	19.83	21.03	20.23	21.38	21.76
	6H	19.77	20.87	20.19	21.24	21.63	19.77	20.87	20.19	21.24	21.63
	8H	19.74	20.78	20.17	21.17	21.58	19.74	20.78	20.17	21.17	21.58
	12H	19.71	20.71	20.14	21.09	21.52	19.71	20.71	20.14	21.09	21.52
4H	2H	19.89	21.09	20.29	21.44	21.82	19.89	21.09	20.29	21.44	21.82
	3H	19.83	20.79	20.24	21.20	21.60	19.83	20.79	20.24	21.20	21.60
	4H	19.76	20.62	20.20	21.04	21.48	19.76	20.62	20.20	21.04	21.48
	6H	19.71	20.45	20.17	20.90	21.36	19.71	20.45	20.17	20.90	21.36
	8H	19.67	20.37	20.14	20.81	21.28	19.67	20.37	20.14	20.81	21.28
	12H	19.65	20.26	20.13	20.74	21.22	19.65	20.26	20.13	20.74	21.22
8H	4H	19.65	20.34	20.11	20.79	21.26	19.65	20.34	20.11	20.79	21.26
	6H	19.58	20.15	20.08	20.65	21.13	19.58	20.15	20.08	20.65	21.13
	8H	19.54	20.05	20.06	20.57	21.06	19.54	20.05	20.06	20.57	21.06
	12H	19.52	19.98	20.03	20.48	21.05	19.52	19.98	20.03	20.48	21.05
12H	4H	19.61	20.23	20.09	20.71	21.18	19.61	20.23	20.09	20.71	21.18
	6H	19.52	20.04	20.04	20.55	21.04	19.52	20.04	20.04	20.55	21.04
	8H	19.50	19.96	20.01	20.46	21.03	19.50	19.96	20.01	20.46	21.03