

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P865453

Luminaire Tested: PRLX-2001-S-930-05L-G-U-S-X-X-BRSS-X

Issue Date: 8/20/2024

Test Information

Test Method: LM-79-2019
Report Number: P865453
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2304-993-4)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 8/20/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: Prenalux
Catalog Number: PRLX-2001-S-930-05L-G-U-S-X-X-BRSS-X
Description: PRENTALUX 3D PRINTED PENDANT LED LUMINAIRE, SMALL LIGHT ENGINE, GLOBE LENS,
TAPERED DRUM WITH BRASS INTERIOR SHADE.
LIGHT LEVEL 1
Light Source: 3000K CCT, 90 CRI LEDS
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 174.0 lumens
Efficiency: N/A
Efficacy: 28.1 lumens/watt
Spacing Criteria (0/90/45): 1.37 / 1.37 / 1.55
Luminous Opening: Circular (Dia: 0.92' x H: 0')
CIE Type: Direct

Input Watts (W): 6.2
Input Voltage (V): 120
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: 0.5 HR
Operation Time: 3 HR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P865453

CATALOG NUMBER: PRLX-2001-S-930-05L-G-U-S-X-X-BRSS-X

Luminous Intensity Polar Plot

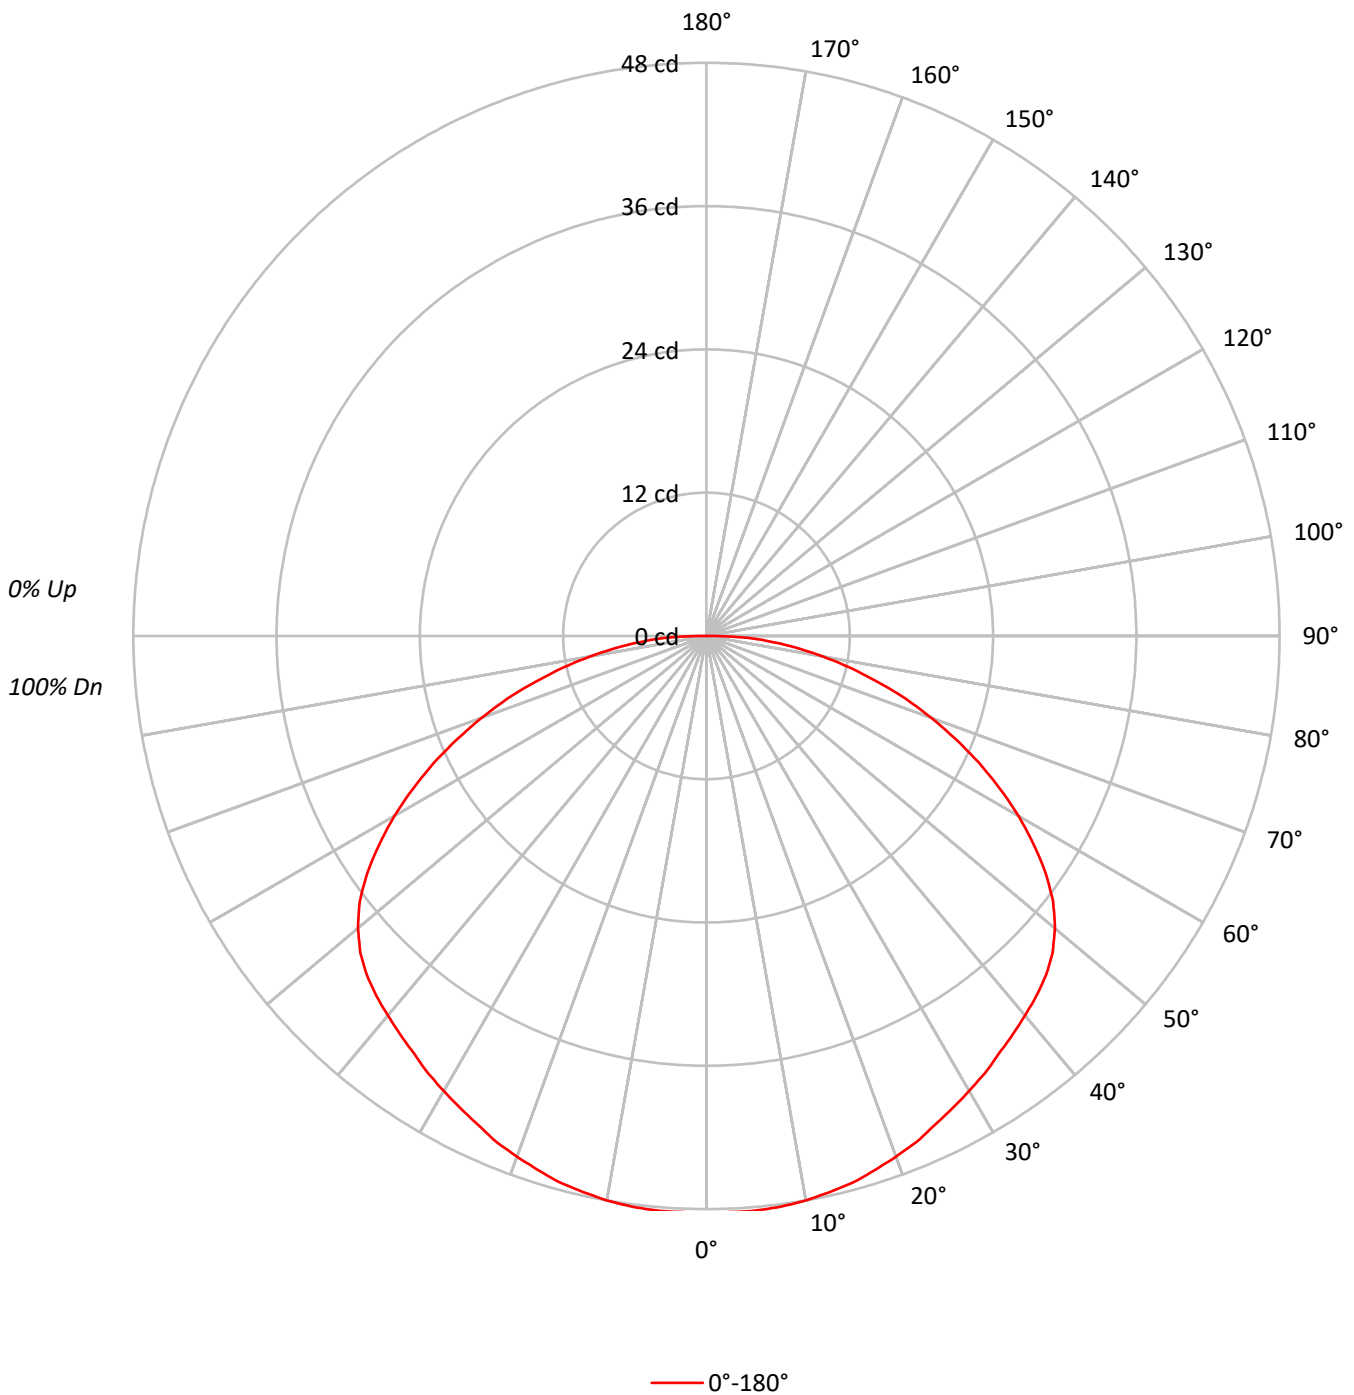



TEST NUMBER: P865453

CATALOG NUMBER: PRLX-2001-S-930-05L-G-U-S-X-X-BRSS-X

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10	0		
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50	30	10	0
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102	102	102	100
1	107	102	97	93	105	100	95	91	95	92	89		91	89	86		88	85	83	81
2	97	88	80	74	94	86	79	73	82	76	71		79	74	70		76	72	68	66
3	88	76	67	60	85	75	66	60	72	64	59		69	63	58		66	61	57	54
4	80	67	57	50	77	66	57	50	63	55	49		61	54	48		58	53	48	45
5	73	59	50	43	71	58	49	42	56	48	42		54	47	41		52	46	41	39
6	67	53	44	37	65	52	43	37	50	42	36		48	41	36		47	41	36	33
7	62	48	39	32	60	47	38	32	45	38	32		44	37	31		43	36	31	29
8	58	43	35	28	56	43	34	28	41	34	28		40	33	28		39	32	28	26
9	54	40	31	25	52	39	31	25	38	30	25		37	30	25		36	29	25	23
10	50	37	28	23	49	36	28	23	35	28	23		34	27	23		33	27	22	21

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	788
5°	791
10°	795
15°	800
20°	805
25°	813
30°	829
35°	850
40°	884
45°	927
50°	967
55°	987
60°	985
65°	973
70°	954
75°	933
80°	930
85°	1011

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 87.5°
 Luminance: 1309 cd/sqm

TEST NUMBER: P865453

CATALOG NUMBER: PRLX-2001-S-930-05L-G-U-S-X-X-BRSS-X

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	4.6	2.6
10°-20°	13.4	7.7
20°-30°	20.9	12.0
30°-40°	26.8	15.4
40°-50°	31.0	17.8
50°-60°	30.9	17.7
60°-70°	24.9	14.3
70°-80°	15.7	9.0
80°-90°	5.8	3.3
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	38.9	22.4
0°-40°	65.7	37.8
0°-60°	127.6	73.3
0°-90°	174.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	174.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	48	
5°	48	5
15°	47	13
25°	45	21
35°	43	27
45°	40	31
55°	35	31
65°	25	25
75°	15	16
85°	5	6
90°	0	

TEST NUMBER: P865453

CATALOG NUMBER: PRLX-2001-S-930-05L-G-U-S-X-X-BRSS-X

CANDELA DISTRIBUTION (FULL):

0°	
0°	48.3
2.5°	48.3
5°	48.3
7.5°	48.2
10°	48.0
12.5°	47.7
15°	47.4
17.5°	46.9
20°	46.4
22.5°	45.9
25°	45.2
27.5°	44.6
30°	44.0
32.5°	43.4
35°	42.7
37.5°	42.1
40°	41.5
42.5°	40.9
45°	40.2
47.5°	39.3
50°	38.1
52.5°	36.6
55°	34.7
57.5°	32.5
60°	30.2
62.5°	27.7
65°	25.2
67.5°	22.6
70°	20.0
72.5°	17.5
75°	14.8
77.5°	12.3
80°	9.9
82.5°	7.5
85°	5.4
87.5°	3.5
90°	0.0



TEST NUMBER: P865453
 CATALOG NUMBER: PRLX-2001-S-930-05L-G-U-S-X-X-BRSS-X

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.43	14.17	12.80	14.48	14.79	12.43	14.17	12.80	14.48	14.79
	3H	14.44	16.02	14.82	16.35	16.70	14.44	16.02	14.82	16.35	16.70
	4H	15.25	16.75	15.65	17.09	17.47	15.25	16.75	15.65	17.09	17.47
	6H	15.93	17.32	16.33	17.68	18.07	15.93	17.32	16.33	17.68	18.07
	8H	16.19	17.52	16.61	17.90	18.30	16.19	17.52	16.61	17.90	18.30
	12H	16.41	17.69	16.84	18.07	18.50	16.41	17.69	16.84	18.07	18.50
4H	2H	13.13	14.63	13.53	14.97	15.35	13.13	14.63	13.53	14.97	15.35
	3H	15.38	16.64	15.78	17.04	17.44	15.38	16.64	15.78	17.04	17.44
	4H	16.33	17.48	16.76	17.89	18.32	16.33	17.48	16.76	17.89	18.32
	6H	17.15	18.17	17.60	18.60	19.06	17.15	18.17	17.60	18.60	19.06
	8H	17.48	18.43	17.94	18.87	19.33	17.48	18.43	17.94	18.87	19.33
	12H	17.78	18.64	18.25	19.11	19.58	17.78	18.64	18.25	19.11	19.58
8H	4H	16.72	17.68	17.18	18.12	18.58	16.72	17.68	17.18	18.12	18.58
	6H	17.71	18.50	18.19	18.99	19.46	17.71	18.50	18.19	18.99	19.46
	8H	18.14	18.85	18.64	19.36	19.84	18.14	18.85	18.64	19.36	19.84
	12H	18.55	19.19	19.05	19.68	20.23	18.55	19.19	19.05	19.68	20.23
12H	4H	16.79	17.65	17.27	18.12	18.59	16.79	17.65	17.27	18.12	18.59
	6H	17.81	18.53	18.31	19.03	19.51	17.81	18.53	18.31	19.03	19.51
	8H	18.31	18.95	18.82	19.44	19.99	18.31	18.95	18.82	19.44	19.99