

Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P865462

Luminaire Tested: PRLX-2001-S-930-10L-G-U-S-X-X-GREY-X

Issue Date: 8/20/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P865462  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2304-993-5)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 8/20/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: Prenalux  
Catalog Number: PRLX-2001-S-930-10L-G-U-S-X-X-GREY-X  
Description: PRENTALUX 3D PRINTED PENDANT LED LUMINAIRE, SMALL LIGHT ENGINE, GLOBE LENS,  
TAPERED DRUM WITH GRAY INTERIOR SHADE.  
LIGHT LEVEL 2  
Light Source: 3000K CCT, 90 CRI LEDS  
Ballast/Driver: -


**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 346.3 lumens  
Efficiency: N/A  
Efficacy: 33.0 lumens/watt  
Spacing Criteria (0/90/45): 1.37 / 1.37 / 1.55  
Luminous Opening: Circular (Dia: 0.92' x H: 0')  
CIE Type: Direct  
  
Input Watts (W): 10.5  
Input Voltage (V): 120  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: 0.5 HR  
Operation Time: 3 HR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P865462

CATALOG NUMBER: PRLX-2001-S-930-10L-G-U-S-X-X-GREY-X

### Luminous Intensity Polar Plot

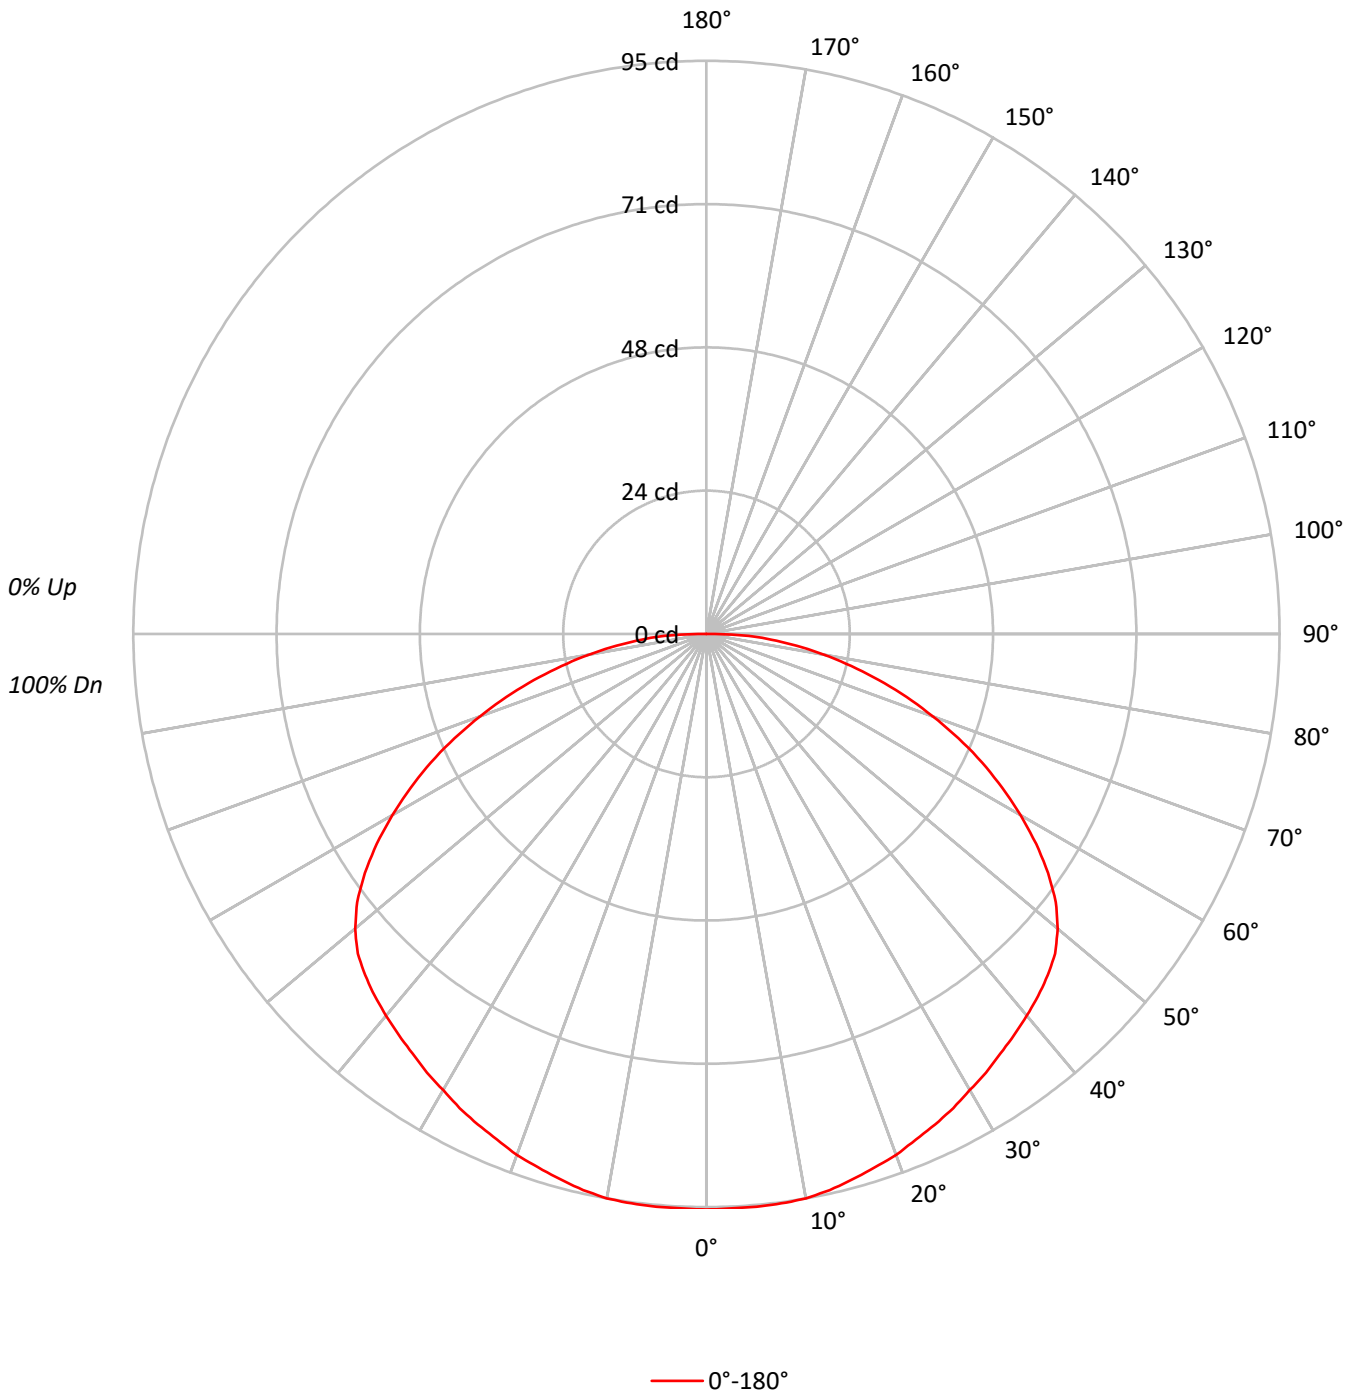



TEST NUMBER: P865462

CATALOG NUMBER: PRLX-2001-S-930-10L-G-U-S-X-X-GREY-X

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20			
RC	80				70				50				30				10	0		
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50	30	10	0
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102	102	102	100
1	107	102	97	93	105	100	95	91	95	92	88		91	88	86		88	85	83	81
2	97	88	80	74	94	86	79	73	82	76	71		79	74	70		76	72	68	66
3	88	76	67	60	85	75	66	60	71	64	59		69	63	58		66	61	56	54
4	80	67	57	50	77	65	57	50	63	55	49		60	54	48		58	52	48	45
5	73	59	50	43	71	58	49	42	56	48	42		54	47	41		52	46	41	39
6	67	53	44	37	65	52	43	37	50	42	36		48	41	36		47	40	35	33
7	62	48	39	32	60	47	38	32	45	37	32		44	37	31		42	36	31	29
8	58	43	34	28	56	43	34	28	41	34	28		40	33	28		39	32	28	26
9	54	40	31	25	52	39	31	25	38	30	25		37	30	25		36	29	25	23
10	50	36	28	23	49	36	28	23	35	28	23		34	27	22		33	27	22	21

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	1556
5°	1560
10°	1573
15°	1580
20°	1595
25°	1614
30°	1644
35°	1690
40°	1759
45°	1845
50°	1928
55°	1965
60°	1960
65°	1945
70°	1903
75°	1865
80°	1860
85°	2021

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 87.5°  
 Luminance: 2617 cd/sqm

TEST NUMBER: P865462

CATALOG NUMBER: PRLX-2001-S-930-10L-G-U-S-X-X-GREY-X

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	9.1	2.6
10°-20°	26.5	7.6
20°-30°	41.4	12.0
30°-40°	53.3	15.4
40°-50°	61.7	17.8
50°-60°	61.5	17.8
60°-70°	49.7	14.4
70°-80°	31.4	9.1
80°-90°	11.7	3.4
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	77.0	22.2
0°-40°	130.3	37.6
0°-60°	253.6	73.2
0°-90°	346.3	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	346.3	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	95	
5°	95	9
15°	94	26
25°	90	41
35°	85	53
45°	80	62
55°	69	62
65°	50	50
75°	30	31
85°	11	12
90°	0	

TEST NUMBER: P865462

CATALOG NUMBER: PRLX-2001-S-930-10L-G-U-S-X-X-GREY-X

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	95.4
2.5°	95.3
5°	95.3
7.5°	95.2
10°	95.0
12.5°	94.4
15°	93.6
17.5°	92.7
20°	91.9
22.5°	90.7
25°	89.7
27.5°	88.6
30°	87.3
32.5°	86.2
35°	84.9
37.5°	83.8
40°	82.6
42.5°	81.4
45°	80.0
47.5°	78.4
50°	76.0
52.5°	73.0
55°	69.1
57.5°	64.8
60°	60.1
62.5°	55.3
65°	50.4
67.5°	45.2
70°	39.9
72.5°	34.8
75°	29.6
77.5°	24.6
80°	19.8
82.5°	15.1
85°	10.8
87.5°	7.0
90°	0.0



TEST NUMBER: P865462  
 CATALOG NUMBER: PRLX-2001-S-930-10L-G-U-S-X-X-GREY-X

**CIE UGR TABLE:**

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	14.83	16.57	15.20	16.88	17.20	14.83	16.57	15.20	16.88	17.20
	3H	16.85	18.43	17.23	18.75	19.11	16.85	18.43	17.23	18.75	19.11
	4H	17.66	19.16	18.06	19.50	19.87	17.66	19.16	18.06	19.50	19.87
	6H	18.34	19.73	18.75	20.09	20.48	18.34	19.73	18.75	20.09	20.48
	8H	18.60	19.93	19.02	20.32	20.72	18.60	19.93	19.02	20.32	20.72
	12H	18.83	20.11	19.26	20.49	20.92	18.83	20.11	19.26	20.49	20.92
4H	2H	15.54	17.04	15.94	17.38	17.75	15.54	17.04	15.94	17.38	17.75
	3H	17.78	19.05	18.19	19.45	19.84	17.78	19.05	18.19	19.45	19.84
	4H	18.74	19.89	19.17	20.30	20.74	18.74	19.89	19.17	20.30	20.74
	6H	19.57	20.58	20.02	21.02	21.47	19.57	20.58	20.02	21.02	21.47
	8H	19.90	20.85	20.35	21.29	21.75	19.90	20.85	20.35	21.29	21.75
	12H	20.20	21.06	20.67	21.53	22.00	20.20	21.06	20.67	21.53	22.00
8H	4H	19.13	20.09	19.59	20.53	20.99	19.13	20.09	19.59	20.53	20.99
	6H	20.12	20.92	20.61	21.40	21.88	20.12	20.92	20.61	21.40	21.88
	8H	20.56	21.27	21.06	21.78	22.26	20.56	21.27	21.06	21.78	22.26
	12H	20.97	21.61	21.47	22.10	22.65	20.97	21.61	21.47	22.10	22.65
12H	4H	19.20	20.06	19.68	20.53	21.00	19.20	20.06	19.68	20.53	21.00
	6H	20.22	20.94	20.72	21.44	21.93	20.22	20.94	20.72	21.44	21.93
	8H	20.73	21.37	21.24	21.86	22.42	20.73	21.37	21.24	21.86	22.42