

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P865500

Luminaire Tested: PRLX-2001-S-935-10L-G-U-S-X-X-BLAK-X

Issue Date: 8/20/2024

Test Information

Test Method: LM-79-2019
Report Number: P865500
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2304-993-6)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 8/20/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: Prenalux
Catalog Number: PRLX-2001-S-935-10L-G-U-S-X-X-BLAK-X
Description: PRENTALUX 3D PRINTED PENDANT LED LUMINAIRE, SMALL LIGHT ENGINE, GLOBE LENS,
TAPERED DRUM WITH BLACK INTERIOR SHADE.
LIGHT LEVEL 2
Light Source: 3500K CCT, 90 CRI LEDS
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 304.0 lumens
Efficiency: N/A
Efficacy: 29.0 lumens/watt
Spacing Criteria (0/90/45): 1.52 / 1.52 / 1.69
Luminous Opening: Circular (Dia: 0.92' x H: 0')
CIE Type: Direct

Input Watts (W): 10.5
Input Voltage (V): 120
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: 0.5 HR
Operation Time: 3 HR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P865500

CATALOG NUMBER: PRLX-2001-S-935-10L-G-U-S-X-X-BLAK-X

Luminous Intensity Polar Plot

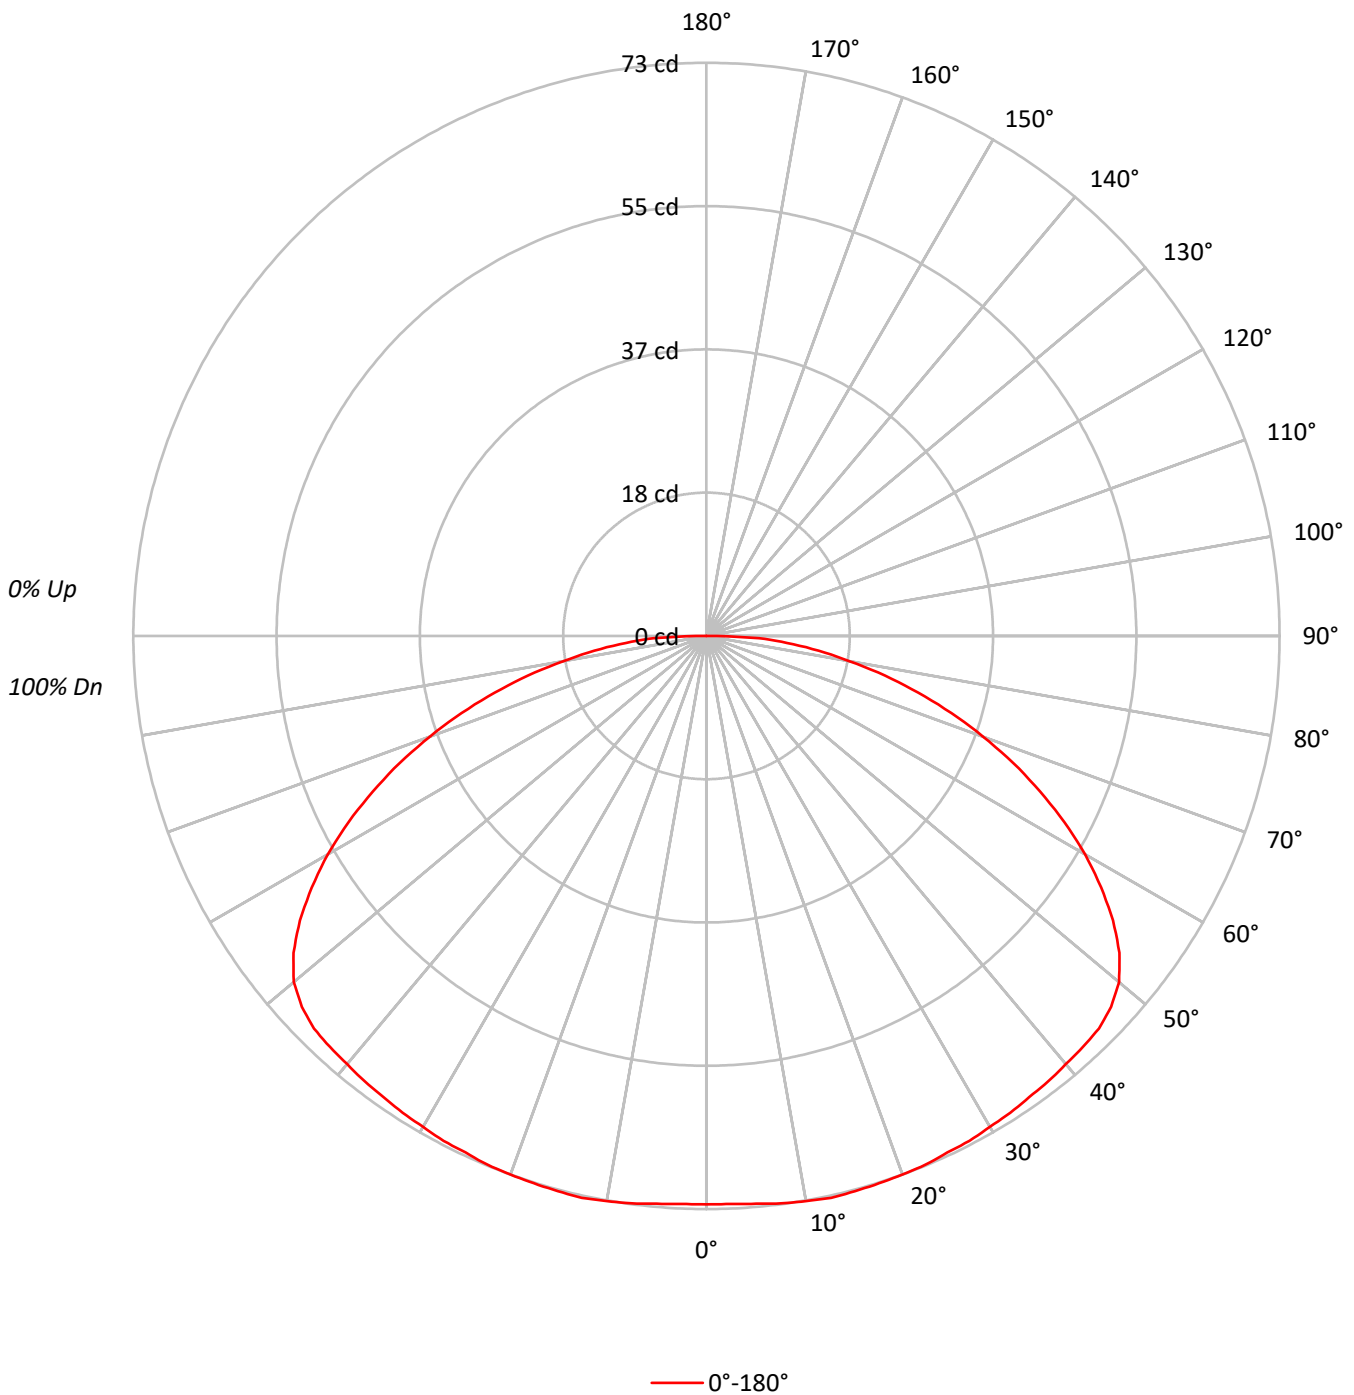



TEST NUMBER: P865500

CATALOG NUMBER: PRLX-2001-S-935-10L-G-U-S-X-X-BLAK-X

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10	0		
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50	30	10	0
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102	102	102	100
1	107	102	97	92	104	99	95	91	95	91	88		91	88	85		87	85	82	80
2	96	87	79	73	93	85	78	72	81	75	70		78	73	68		75	71	67	64
3	87	75	66	59	84	73	65	58	70	63	57		67	61	56		65	60	55	53
4	79	66	56	49	76	64	55	48	62	54	47		59	52	47		57	51	46	44
5	72	58	48	41	70	57	48	41	55	46	40		53	45	40		51	44	39	37
6	66	52	42	35	64	51	42	35	49	41	35		47	40	34		45	39	34	32
7	61	46	37	30	59	46	37	30	44	36	30		43	35	30		41	35	30	27
8	57	42	33	27	55	41	33	27	40	32	27		39	32	26		37	31	26	24
9	53	38	30	24	51	38	29	24	37	29	24		35	28	23		34	28	23	21
10	49	35	27	21	48	35	27	21	34	26	21		33	26	21		32	25	21	19

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1181
5°	1189
10°	1211
15°	1236
20°	1267
25°	1307
30°	1360
35°	1428
40°	1516
45°	1631
50°	1741
55°	1797
60°	1817
65°	1810
70°	1788
75°	1758
80°	1738
85°	1928

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 87.5°
 Luminance: 2505 cd/sqm

TEST NUMBER: P865500

CATALOG NUMBER: PRLX-2001-S-935-10L-G-U-S-X-X-BLAK-X

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	6.9	2.3
10°-20°	20.7	6.8
20°-30°	33.6	11.1
30°-40°	45.0	14.8
40°-50°	54.5	17.9
50°-60°	56.2	18.5
60°-70°	46.3	15.2
70°-80°	29.5	9.7
80°-90°	11.1	3.6
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	61.3	20.2
0°-40°	106.3	35.0
0°-60°	217.1	71.4
0°-90°	304.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	304.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	72	
5°	73	7
15°	73	21
25°	73	34
35°	72	45
45°	71	54
55°	63	56
65°	47	46
75°	28	30
85°	10	11
90°	0	

TEST NUMBER: P865500

CATALOG NUMBER: PRLX-2001-S-935-10L-G-U-S-X-X-BLAK-X

CANDELA DISTRIBUTION (FULL):

	0°
0°	72.4
2.5°	72.4
5°	72.6
7.5°	72.9
10°	73.1
12.5°	73.3
15°	73.2
17.5°	73.1
20°	73.0
22.5°	72.9
25°	72.6
27.5°	72.5
30°	72.2
32.5°	72.0
35°	71.7
37.5°	71.5
40°	71.2
42.5°	71.0
45°	70.7
47.5°	69.9
50°	68.6
52.5°	66.3
55°	63.2
57.5°	59.6
60°	55.7
62.5°	51.4
65°	46.9
67.5°	42.3
70°	37.5
72.5°	32.7
75°	27.9
77.5°	23.3
80°	18.5
82.5°	14.4
85°	10.3
87.5°	6.7
90°	0.0



TEST NUMBER: P865500
 CATALOG NUMBER: PRLX-2001-S-935-10L-G-U-S-X-X-BLAK-X

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	14.67	16.43	15.03	16.75	17.06	14.67	16.43	15.03	16.75	17.06
	3H	16.74	18.36	17.12	18.68	19.04	16.74	18.36	17.12	18.68	19.04
	4H	17.58	19.11	17.97	19.45	19.82	17.58	19.11	17.97	19.45	19.82
	6H	18.27	19.69	18.68	20.06	20.44	18.27	19.69	18.68	20.06	20.44
	8H	18.54	19.91	18.97	20.30	20.69	18.54	19.91	18.97	20.30	20.69
	12H	18.78	20.09	19.21	20.47	20.90	18.78	20.09	19.21	20.47	20.90
4H	2H	15.39	16.92	15.79	17.27	17.64	15.39	16.92	15.79	17.27	17.64
	3H	17.70	19.00	18.11	19.39	19.79	17.70	19.00	18.11	19.39	19.79
	4H	18.68	19.86	19.11	20.27	20.70	18.68	19.86	19.11	20.27	20.70
	6H	19.52	20.56	19.97	21.00	21.45	19.52	20.56	19.97	21.00	21.45
	8H	19.86	20.84	20.32	21.28	21.74	19.86	20.84	20.32	21.28	21.74
	12H	20.18	21.06	20.65	21.53	22.00	20.18	21.06	20.65	21.53	22.00
8H	4H	19.09	20.07	19.54	20.50	20.97	19.09	20.07	19.54	20.50	20.97
	6H	20.09	20.91	20.58	21.39	21.86	20.09	20.91	20.58	21.39	21.86
	8H	20.54	21.28	21.04	21.78	22.26	20.54	21.28	21.04	21.78	22.26
	12H	20.97	21.63	21.47	22.11	22.67	20.97	21.63	21.47	22.11	22.67
12H	4H	19.15	20.04	19.63	20.51	20.98	19.15	20.04	19.63	20.51	20.98
	6H	20.19	20.93	20.69	21.44	21.92	20.19	20.93	20.69	21.44	21.92
	8H	20.72	21.38	21.22	21.87	22.42	20.72	21.38	21.22	21.87	22.42