

Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P865545

Luminaire Tested: PRLX-2001-S-940-10L-L-U-S-X-X-BRSS-X

Issue Date: 8/20/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P865545  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2304-993-16)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 8/20/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: Prenalux  
Catalog Number: PRLX-2001-S-940-10L-L-U-S-X-X-BRSS-X  
Description: PRENTALUX 3D PRINTED PENDANT LED LUMINAIRE, SMALL LIGHT ENGINE, FLAT LENS, TAPERED DRUM WITH BRASS INTERIOR SHADE.  
LIGHT LEVEL 2  
Light Source: 4000K CCT, 90 CRI LEDS  
Ballast/Driver: -


**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 876.3 lumens  
Efficiency: N/A  
Efficacy: 83.5 lumens/watt  
Spacing Criteria (0/90/45): 1.17 / 1.17 / 1.28  
Luminous Opening: Circular (Dia: 0.92' x H: 0')  
CIE Type: Direct  
  
Input Watts (W): 10.5  
Input Voltage (V): 120  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: 0.5 HR  
Operation Time: 3 HR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P865545

CATALOG NUMBER: PRLX-2001-S-940-10L-L-U-S-X-X-BRSS-X

### Luminous Intensity Polar Plot

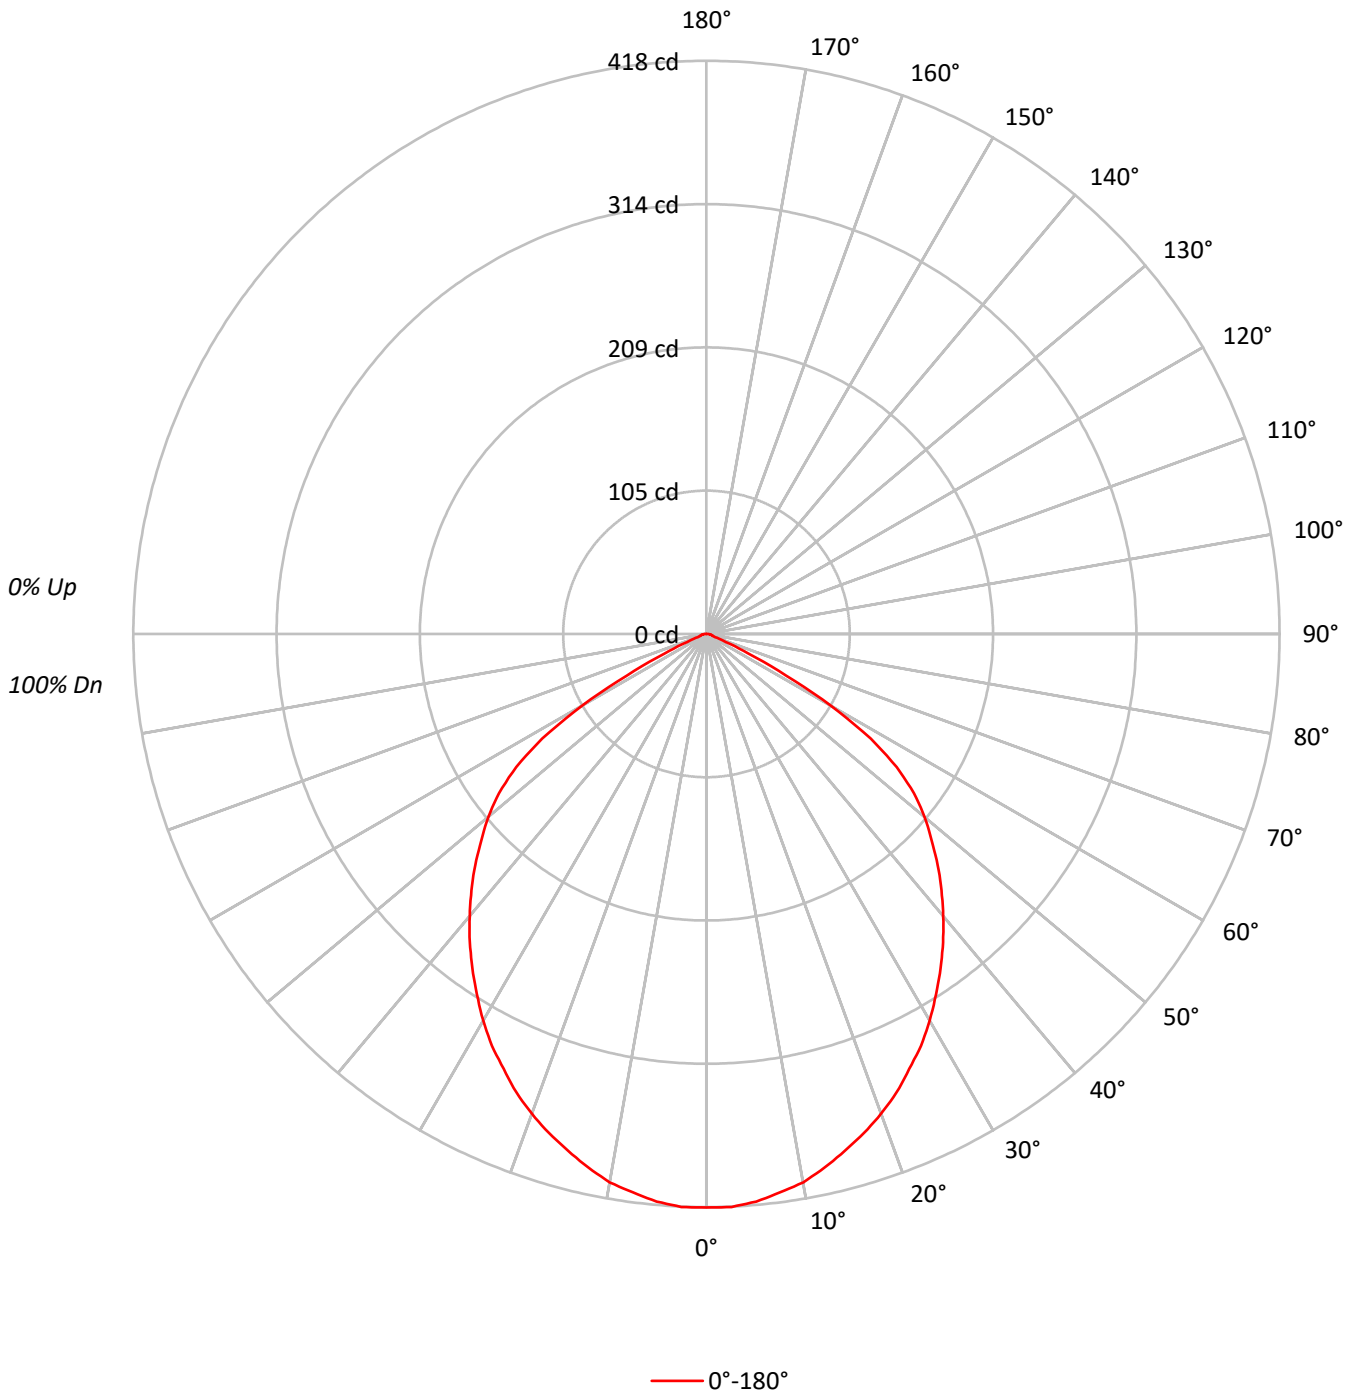



TEST NUMBER: P865545

CATALOG NUMBER: PRLX-2001-S-940-10L-L-U-S-X-X-BRSS-X

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	111	108	104	101	109	105	102	100	101	99	96	97	95	94	94	92	91	89
2	103	96	91	86	101	94	89	85	91	87	83	88	84	81	85	82	80	78
3	95	86	79	74	93	85	78	73	82	76	72	79	75	71	77	73	70	68
4	88	77	70	64	86	76	69	64	74	68	63	72	66	62	70	65	61	59
5	81	70	62	56	79	69	61	56	67	60	55	65	59	55	63	58	54	52
6	75	63	55	50	74	62	55	49	61	54	49	59	53	49	58	52	48	46
7	70	58	50	44	68	57	49	44	56	49	44	54	48	43	53	47	43	41
8	65	53	45	40	64	52	45	40	51	44	39	50	44	39	49	43	39	37
9	61	49	41	36	60	48	41	36	47	40	36	46	40	35	45	39	35	34
10	57	45	38	33	56	45	37	33	44	37	32	43	37	32	42	36	32	31

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	6823
5°	6803
10°	6726
15°	6589
20°	6464
25°	6299
30°	6132
35°	5926
40°	5719
45°	5504
50°	5270
55°	4817
60°	3419
65°	1301
70°	315
75°	296
80°	348
85°	524

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 5504 cd/sqm

TEST NUMBER: P865545

CATALOG NUMBER: PRLX-2001-S-940-10L-L-U-S-X-X-BRSS-X

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	39.3	4.5
10°-20°	110.1	12.6
20°-30°	161.3	18.4
30°-40°	186.2	21.2
40°-50°	183.9	21.0
50°-60°	146.9	16.8
60°-70°	41.5	4.7
70°-80°	4.8	0.5
80°-90°	2.3	0.3
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	310.7	35.5
0°-40°	496.9	56.7
0°-60°	827.7	94.5
0°-90°	876.3	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	876.3	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	418	
5°	416	39
15°	390	110
25°	350	161
35°	298	186
45°	239	184
55°	169	147
65°	34	42
75°	5	5
85°	3	2
90°	0	

TEST NUMBER: P865545

CATALOG NUMBER: PRLX-2001-S-940-10L-L-U-S-X-X-BRSS-X

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	418.3
2.5°	418.3
5°	415.5
7.5°	410.8
10°	406.1
12.5°	398.6
15°	390.2
17.5°	381.8
20°	372.4
22.5°	362.1
25°	350.0
27.5°	338.7
30°	325.6
32.5°	311.6
35°	297.6
37.5°	283.5
40°	268.6
42.5°	253.6
45°	238.6
47.5°	222.7
50°	207.7
52.5°	190.9
55°	169.4
57.5°	142.2
60°	104.8
62.5°	65.5
65°	33.7
67.5°	15.0
70°	6.6
72.5°	4.7
75°	4.7
77.5°	3.7
80°	3.7
82.5°	2.8
85°	2.8
87.5°	0.9
90°	0.0



TEST NUMBER: P865545  
 CATALOG NUMBER: PRLX-2001-S-940-10L-L-U-S-X-X-BRSS-X

**CIE UGR TABLE:**

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	17.32	18.78	17.69	19.10	19.41	17.32	18.78	17.69	19.10	19.41
	3H	17.25	18.54	17.63	18.87	19.23	17.25	18.54	17.63	18.87	19.23
	4H	17.19	18.39	17.59	18.74	19.12	17.19	18.39	17.59	18.74	19.12
	6H	17.13	18.24	17.55	18.60	19.00	17.13	18.24	17.55	18.60	19.00
	8H	17.10	18.15	17.53	18.54	18.94	17.10	18.15	17.53	18.54	18.94
	12H	17.08	18.07	17.51	18.46	18.88	17.08	18.07	17.51	18.46	18.88
4H	2H	17.25	18.45	17.65	18.80	19.18	17.25	18.45	17.65	18.80	19.18
	3H	17.19	18.16	17.60	18.56	18.96	17.19	18.16	17.60	18.56	18.96
	4H	17.12	17.99	17.56	18.40	18.85	17.12	17.99	17.56	18.40	18.85
	6H	17.07	17.82	17.53	18.26	18.73	17.07	17.82	17.53	18.26	18.73
	8H	17.03	17.73	17.50	18.17	18.64	17.03	17.73	17.50	18.17	18.64
	12H	17.01	17.63	17.49	18.11	18.58	17.01	17.63	17.49	18.11	18.58
8H	4H	17.01	17.70	17.48	18.15	18.62	17.01	17.70	17.48	18.15	18.62
	6H	16.94	17.51	17.44	18.01	18.49	16.94	17.51	17.44	18.01	18.49
	8H	16.90	17.42	17.42	17.93	18.42	16.90	17.42	17.42	17.93	18.42
	12H	16.88	17.35	17.40	17.84	18.41	16.88	17.35	17.40	17.84	18.41
12H	4H	16.97	17.59	17.46	18.07	18.54	16.97	17.59	17.46	18.07	18.54
	6H	16.88	17.40	17.40	17.92	18.41	16.88	17.40	17.40	17.92	18.41
	8H	16.86	17.33	17.38	17.82	18.39	16.86	17.33	17.38	17.82	18.39