

Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P866992

Luminaire Tested: PRLX-2002-L-930-117L-G-X-X-BLAK-X

Issue Date: 8/20/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P866992  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2304-993-71)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 8/20/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: Pentalux  
Catalog Number: PRLX-2002-L-930-117L-G-X-X-BLAK-X  
Description: PRENTALUX 3D PRINTED PENDANT LED LUMINAIRE, LARGE LIGHT ENGINE, GLOBE LENS,  
TRUNCATED DOME WITH BLACK INTERIOR SHADE.  
LIGHT LEVEL 7  
Light Source: 3000K CCT, 90 CRI LEDS  
Ballast/Driver: -


**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 3344.0 lumens  
Efficiency: N/A  
Efficacy: 35.1 lumens/watt  
Spacing Criteria (0/90/45): 1.52 / 1.52 / 1.65  
Luminous Opening: Circular (Dia: 1.67' x H: 0')  
CIE Type: Direct  
  
Input Watts (W): 95.2  
Input Voltage (V): 120  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: 0.5 HR  
Operation Time: 3 HR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P866992

CATALOG NUMBER: PRLX-2002-L-930-117L-G-X-X-BLAK-X

### Luminous Intensity Polar Plot

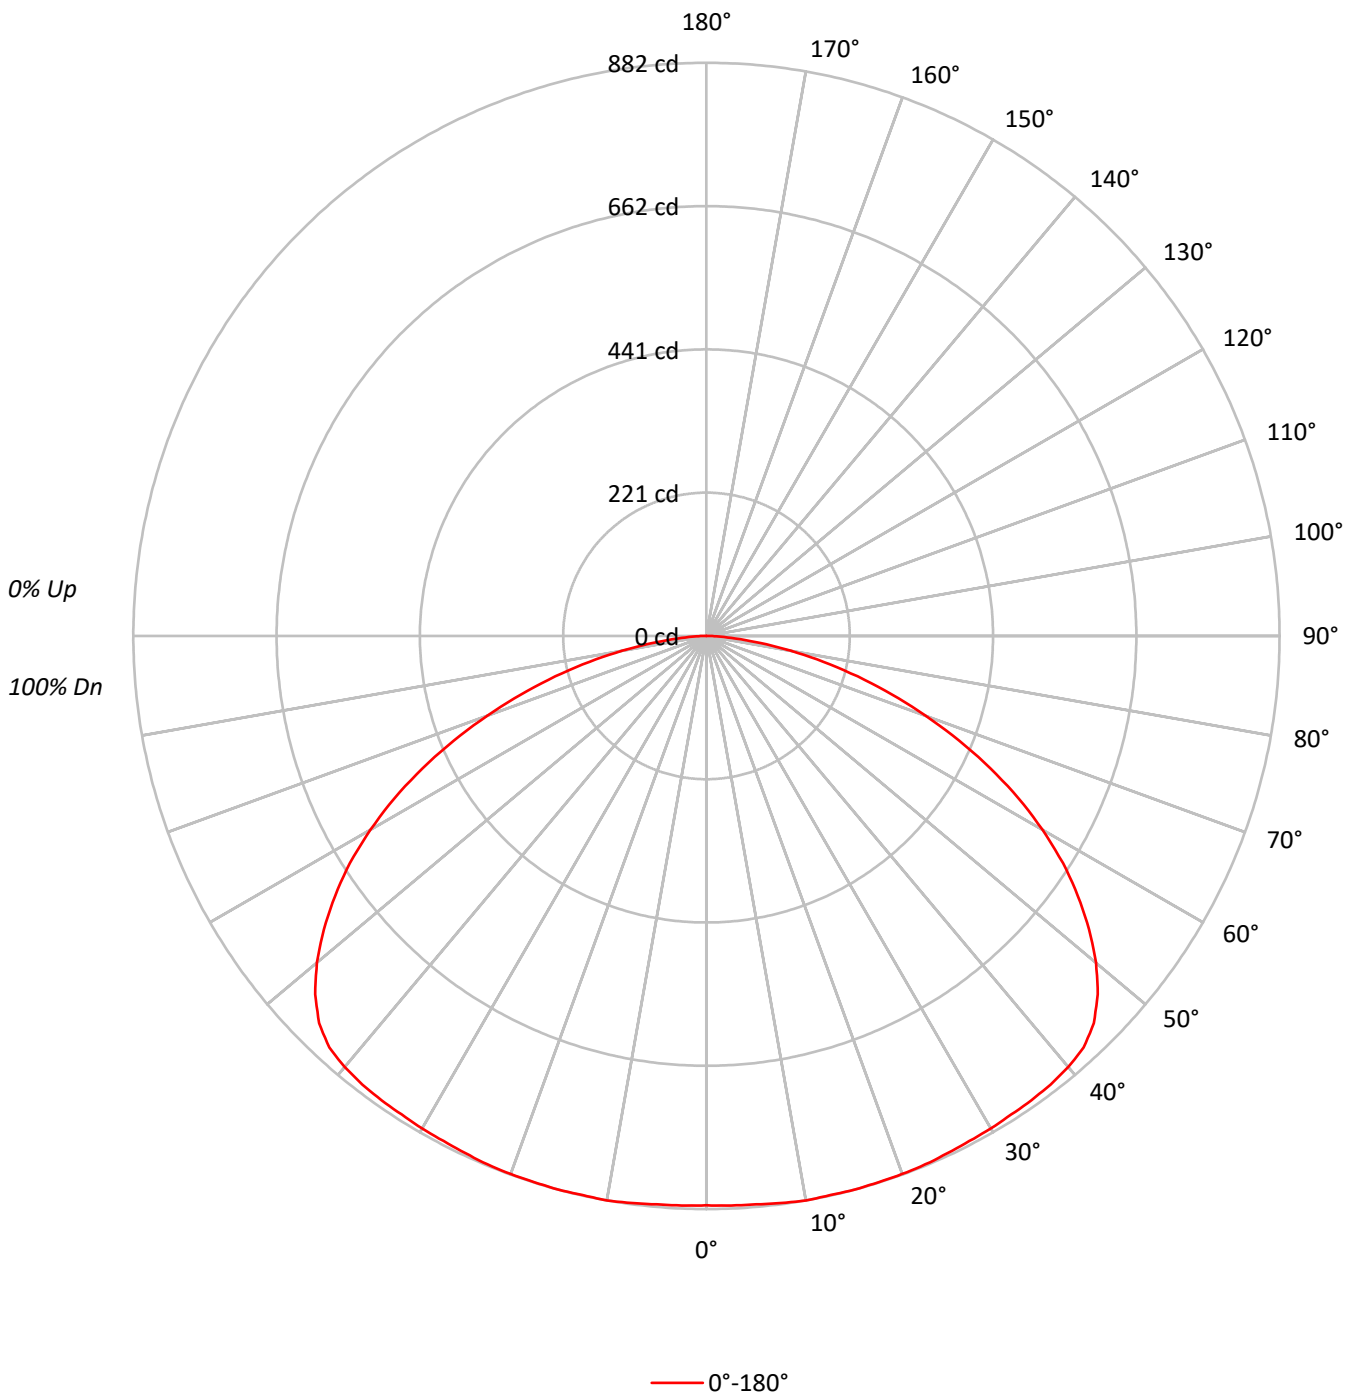



TEST NUMBER: P866992

CATALOG NUMBER: PRLX-2002-L-930-117L-G-X-X-BLAK-X

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20			
RC	80				70				50				30				10	0		
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50	30	10	0
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102	102	102	100
1	108	103	99	95	105	101	97	93	97	93	90		93	90	87		89	87	85	83
2	98	89	82	76	95	87	81	75	84	78	73		80	76	71		77	73	70	68
3	89	77	69	62	86	76	68	61	73	66	60		70	64	59		67	62	58	56
4	81	68	59	52	78	67	58	51	64	56	51		62	55	50		59	54	49	47
5	74	60	51	44	72	59	50	44	57	49	43		55	48	43		53	47	42	40
6	68	54	44	38	66	53	44	37	51	43	37		49	42	37		48	41	36	34
7	63	48	39	33	61	48	39	33	46	38	32		44	37	32		43	37	32	30
8	58	44	35	29	56	43	35	29	42	34	29		41	34	28		39	33	28	26
9	54	40	32	26	53	39	31	26	38	31	26		37	30	25		36	30	25	23
10	50	37	29	23	49	36	28	23	35	28	23		34	28	23		33	27	23	21

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	4323
5°	4349
10°	4420
15°	4506
20°	4627
25°	4781
30°	4986
35°	5253
40°	5578
45°	5881
50°	6006
55°	6003
60°	5893
65°	5632
70°	5172
75°	4588
80°	3748
85°	2508

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 52.5°  
 Luminance: 6015 cd/sqm

TEST NUMBER: P866992

CATALOG NUMBER: PRLX-2002-L-930-117L-G-X-X-BLAK-X

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	84.0	2.5
10°-20°	249.9	7.5
20°-30°	406.4	12.2
30°-40°	547.4	16.4
40°-50°	646.3	19.3
50°-60°	622.1	18.6
60°-70°	475.7	14.2
70°-80°	255.5	7.6
80°-90°	56.8	1.7
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	740.3	22.1
0°-40°	1287.6	38.5
0°-60°	2556.0	76.4
0°-90°	3344.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3344.0	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	876	
5°	878	84
15°	882	250
25°	878	406
35°	872	547
45°	843	646
55°	698	622
65°	482	476
75°	241	255
85°	44	57
90°	0	

TEST NUMBER: P866992

CATALOG NUMBER: PRLX-2002-L-930-117L-G-X-X-BLAK-X

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	876.2
2.5°	877.2
5°	878.2
7.5°	880.2
10°	882.2
12.5°	881.2
15°	882.2
17.5°	881.2
20°	881.2
22.5°	880.2
25°	878.2
27.5°	876.2
30°	875.2
32.5°	873.1
35°	872.1
37.5°	870.1
40°	866.1
42.5°	859.0
45°	842.9
47.5°	816.7
50°	782.5
52.5°	742.2
55°	697.9
57.5°	650.6
60°	597.2
62.5°	541.8
65°	482.4
67.5°	421.0
70°	358.5
72.5°	299.1
75°	240.7
77.5°	184.3
80°	131.9
82.5°	83.6
85°	44.3
87.5°	15.1
90°	0.0



TEST NUMBER: P866992  
 CATALOG NUMBER: PRLX-2002-L-930-117L-G-X-X-BLAK-X

**CIE UGR TABLE:**

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	18.85	20.56	19.21	20.88	21.19	18.85	20.56	19.21	20.88	21.19
	3H	20.60	22.16	20.98	22.48	22.84	20.60	22.16	20.98	22.48	22.84
	4H	21.21	22.67	21.61	23.02	23.39	21.21	22.67	21.61	23.02	23.39
	6H	21.60	22.97	22.01	23.33	23.72	21.60	22.97	22.01	23.33	23.72
	8H	21.71	23.01	22.13	23.39	23.79	21.71	23.01	22.13	23.39	23.79
	12H	21.76	23.00	22.18	23.38	23.81	21.76	23.00	22.18	23.38	23.81
4H	2H	19.50	20.96	19.89	21.31	21.68	19.50	20.96	19.89	21.31	21.68
	3H	21.45	22.68	21.86	23.08	23.48	21.45	22.68	21.86	23.08	23.48
	4H	22.17	23.29	22.60	23.70	24.14	22.17	23.29	22.60	23.70	24.14
	6H	22.68	23.66	23.13	24.10	24.55	22.68	23.66	23.13	24.10	24.55
	8H	22.82	23.73	23.27	24.17	24.63	22.82	23.73	23.27	24.17	24.63
	12H	22.90	23.72	23.38	24.19	24.66	22.90	23.72	23.38	24.19	24.66
8H	4H	22.46	23.37	22.92	23.81	24.28	22.46	23.37	22.92	23.81	24.28
	6H	23.06	23.82	23.55	24.31	24.78	23.06	23.82	23.55	24.31	24.78
	8H	23.25	23.93	23.75	24.43	24.92	23.25	23.93	23.75	24.43	24.92
	12H	23.37	23.97	23.88	24.46	25.02	23.37	23.97	23.88	24.46	25.02
12H	4H	22.49	23.31	22.96	23.78	24.25	22.49	23.31	22.96	23.78	24.25
	6H	23.10	23.78	23.60	24.28	24.77	23.10	23.78	23.60	24.28	24.77
	8H	23.33	23.93	23.83	24.42	24.98	23.33	23.93	23.83	24.42	24.98