

Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P867013

Luminaire Tested: PRLX-2002-L-930-32L-L-X-X-BRSS-X

Issue Date: 8/20/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P867013  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2304-993-81)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 8/20/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: Pentalux  
Catalog Number: PRLX-2002-L-930-32L-L-X-X-BRSS-X  
Description: PRENTALUX 3D PRINTED PENDANT LED LUMINAIRE, LARGE LIGHT ENGINE, FLAT LENS, TRUNCATED DOME WITH BRASS INTERIOR SHADE.  
LIGHT LEVEL 2  
Light Source: 3000K CCT, 90 CRI LEDS  
Ballast/Driver: -


**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 2610.1 lumens  
Efficiency: N/A  
Efficacy: 100.0 lumens/watt  
Spacing Criteria (0/90/45): 1.17 / 1.17 / 1.27  
Luminous Opening: Circular (Dia: 1.67' x H: 0')  
CIE Type: Direct  
  
Input Watts (W): 26.1  
Input Voltage (V): 120  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: 0.5 HR  
Operation Time: 3 HR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P867013

CATALOG NUMBER: PRLX-2002-L-930-32L-L-X-X-BRSS-X

### Luminous Intensity Polar Plot

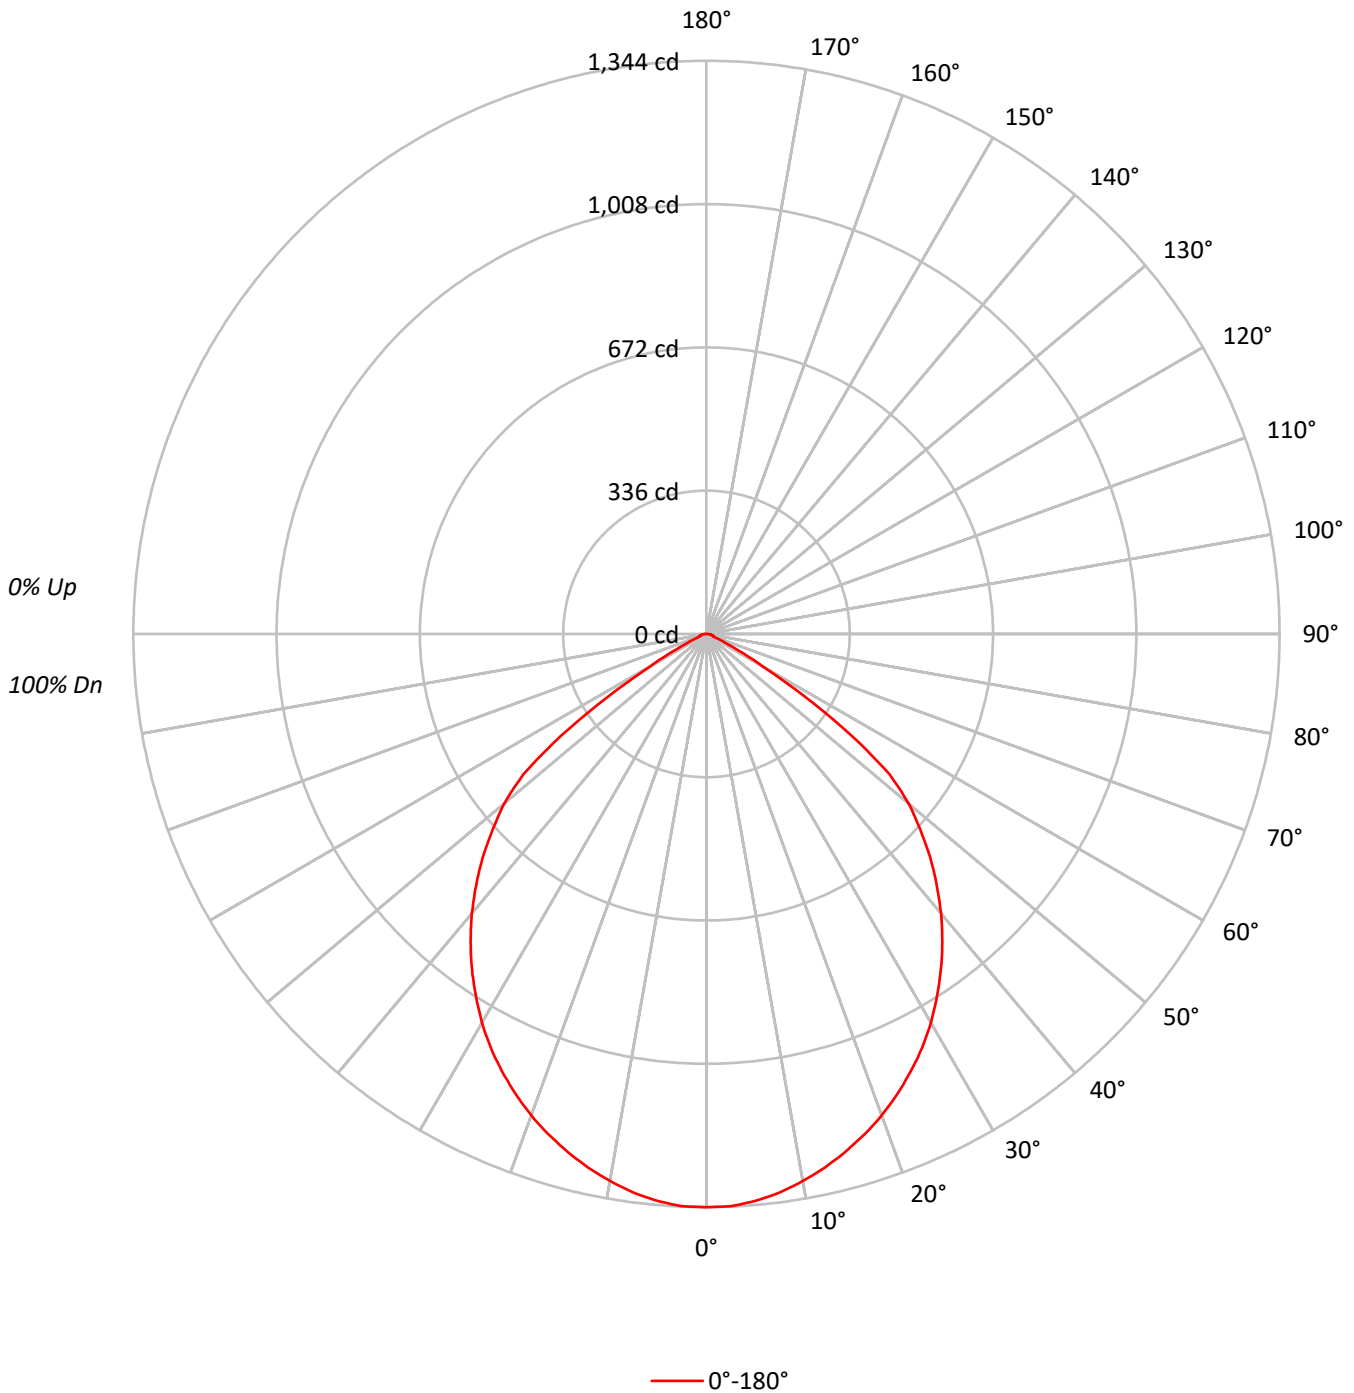



TEST NUMBER: P867013

CATALOG NUMBER: PRLX-2002-L-930-32L-L-X-X-BRSS-X

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20			
RC	80				70				50				30				10	0		
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50	30	10	0
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102	102	102	100
1	112	108	105	102	109	106	103	100	102	99	97		98	96	94		94	93	92	90
2	104	97	92	88	101	96	91	87	92	88	85		89	86	83		86	83	81	79
3	96	88	81	76	94	86	80	75	83	78	74		81	77	73		78	75	72	70
4	89	79	72	66	87	78	71	66	76	70	65		74	68	64		72	67	64	62
5	83	72	64	59	81	71	64	58	69	63	58		67	62	57		65	60	57	55
6	77	65	58	52	75	65	57	52	63	56	51		61	56	51		60	55	51	49
7	72	60	52	47	70	59	52	47	58	51	46		56	50	46		55	50	46	44
8	67	55	47	42	66	54	47	42	53	46	42		52	46	42		51	45	41	40
9	63	51	43	38	62	50	43	38	49	43	38		48	42	38		47	42	38	36
10	59	47	40	35	58	46	39	35	46	39	35		45	39	35		44	38	34	33

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	6633
5°	6609
10°	6526
15°	6423
20°	6308
25°	6167
30°	5997
35°	5776
40°	5512
45°	5177
50°	4756
55°	3578
60°	1506
65°	556
70°	255
75°	280
80°	321
85°	374

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 5177 cd/sqm

TEST NUMBER: P867013

CATALOG NUMBER: PRLX-2002-L-930-32L-L-X-X-BRSS-X

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	126.4	4.8
10°-20°	354.5	13.6
20°-30°	521.4	20.0
30°-40°	598.8	22.9
40°-50°	570.5	21.9
50°-60°	357.3	13.7
60°-70°	59.1	2.3
70°-80°	15.4	0.6
80°-90°	6.7	0.3
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1002.2	38.4
0°-40°	1601.1	61.3
0°-60°	2528.8	96.9
0°-90°	2610.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2610.1	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	1344	
5°	1334	126
15°	1258	354
25°	1133	521
35°	959	599
45°	742	570
55°	416	357
65°	48	59
75°	15	15
85°	7	7
90°	0	

TEST NUMBER: P867013

CATALOG NUMBER: PRLX-2002-L-930-32L-L-X-X-BRSS-X

**CANDELA DISTRIBUTION (FULL):**

0°	
0°	1344.3
2.5°	1343.0
5°	1334.4
7.5°	1320.8
10°	1302.6
12.5°	1281.9
15°	1257.5
17.5°	1231.0
20°	1201.4
22.5°	1168.5
25°	1132.8
27.5°	1094.9
30°	1052.6
32.5°	1006.7
35°	958.9
37.5°	908.6
40°	855.8
42.5°	799.6
45°	741.9
47.5°	680.2
50°	619.6
52.5°	541.1
55°	415.9
57.5°	268.8
60°	152.6
62.5°	86.5
65°	47.6
67.5°	22.4
70°	17.7
72.5°	16.3
75°	14.7
77.5°	13.0
80°	11.3
82.5°	9.1
85°	6.6
87.5°	3.3
90°	0.0



TEST NUMBER: P867013  
 CATALOG NUMBER: PRLX-2002-L-930-32L-L-X-X-BRSS-X

**CIE UGR TABLE:**

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.79	15.19	14.16	15.50	15.81	13.79	15.19	14.16	15.50	15.81
	3H	13.71	14.93	14.09	15.26	15.63	13.71	14.93	14.09	15.26	15.63
	4H	13.67	14.80	14.07	15.15	15.54	13.67	14.80	14.07	15.15	15.54
	6H	13.63	14.67	14.04	15.04	15.43	13.63	14.67	14.04	15.04	15.43
	8H	13.60	14.59	14.03	14.98	15.39	13.60	14.59	14.03	14.98	15.39
	12H	13.58	14.53	14.01	14.91	15.34	13.58	14.53	14.01	14.91	15.34
4H	2H	13.66	14.80	14.06	15.15	15.53	13.66	14.80	14.06	15.15	15.53
	3H	13.60	14.51	14.01	14.92	15.32	13.60	14.51	14.01	14.92	15.32
	4H	13.55	14.37	13.99	14.79	15.23	13.55	14.37	13.99	14.79	15.23
	6H	13.53	14.24	14.00	14.68	15.15	13.53	14.24	14.00	14.68	15.15
	8H	13.51	14.17	13.98	14.62	15.09	13.51	14.17	13.98	14.62	15.09
	12H	13.50	14.08	13.99	14.56	15.04	13.50	14.08	13.99	14.56	15.04
8H	4H	13.44	14.10	13.91	14.55	15.02	13.44	14.10	13.91	14.55	15.02
	6H	13.42	13.97	13.93	14.46	14.94	13.42	13.97	13.93	14.46	14.94
	8H	13.41	13.90	13.93	14.42	14.91	13.41	13.90	13.93	14.42	14.91
	12H	13.42	13.86	13.93	14.35	14.92	13.42	13.86	13.93	14.35	14.92
12H	4H	13.40	13.99	13.89	14.47	14.94	13.40	13.99	13.89	14.47	14.94
	6H	13.37	13.86	13.89	14.38	14.87	13.37	13.86	13.89	14.38	14.87
	8H	13.38	13.83	13.90	14.32	14.89	13.38	13.83	13.90	14.32	14.89