

Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P867046

Luminaire Tested: PRLX-2002-L-935-100L-L-X-X-GREY-X

Issue Date: 8/20/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P867046  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2304-993-82)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 8/20/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: Prenalux  
Catalog Number: PRLX-2002-L-935-100L-L-X-X-GREY-X  
Description: PRENTALUX 3D PRINTED PENDANT LED LUMINAIRE, LARGE LIGHT ENGINE, FLAT LENS, TRUNCATED DOME WITH GRAY INTERIOR SHADE.  
LIGHT LEVEL 6  
Light Source: 3500K CCT, 90 CRI LEDS  
Ballast/Driver: -


**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 8474.5 lumens  
Efficiency: N/A  
Efficacy: 106.7 lumens/watt  
Spacing Criteria (0/90/45): 1.17 / 1.17 / 1.27  
Luminous Opening: Circular (Dia: 1.67' x H: 0')  
CIE Type: Direct  
  
Input Watts (W): 79.4  
Input Voltage (V): 120  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: 0.5 HR  
Operation Time: 3 HR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P867046

CATALOG NUMBER: PRLX-2002-L-935-100L-L-X-X-GREY-X

### Luminous Intensity Polar Plot

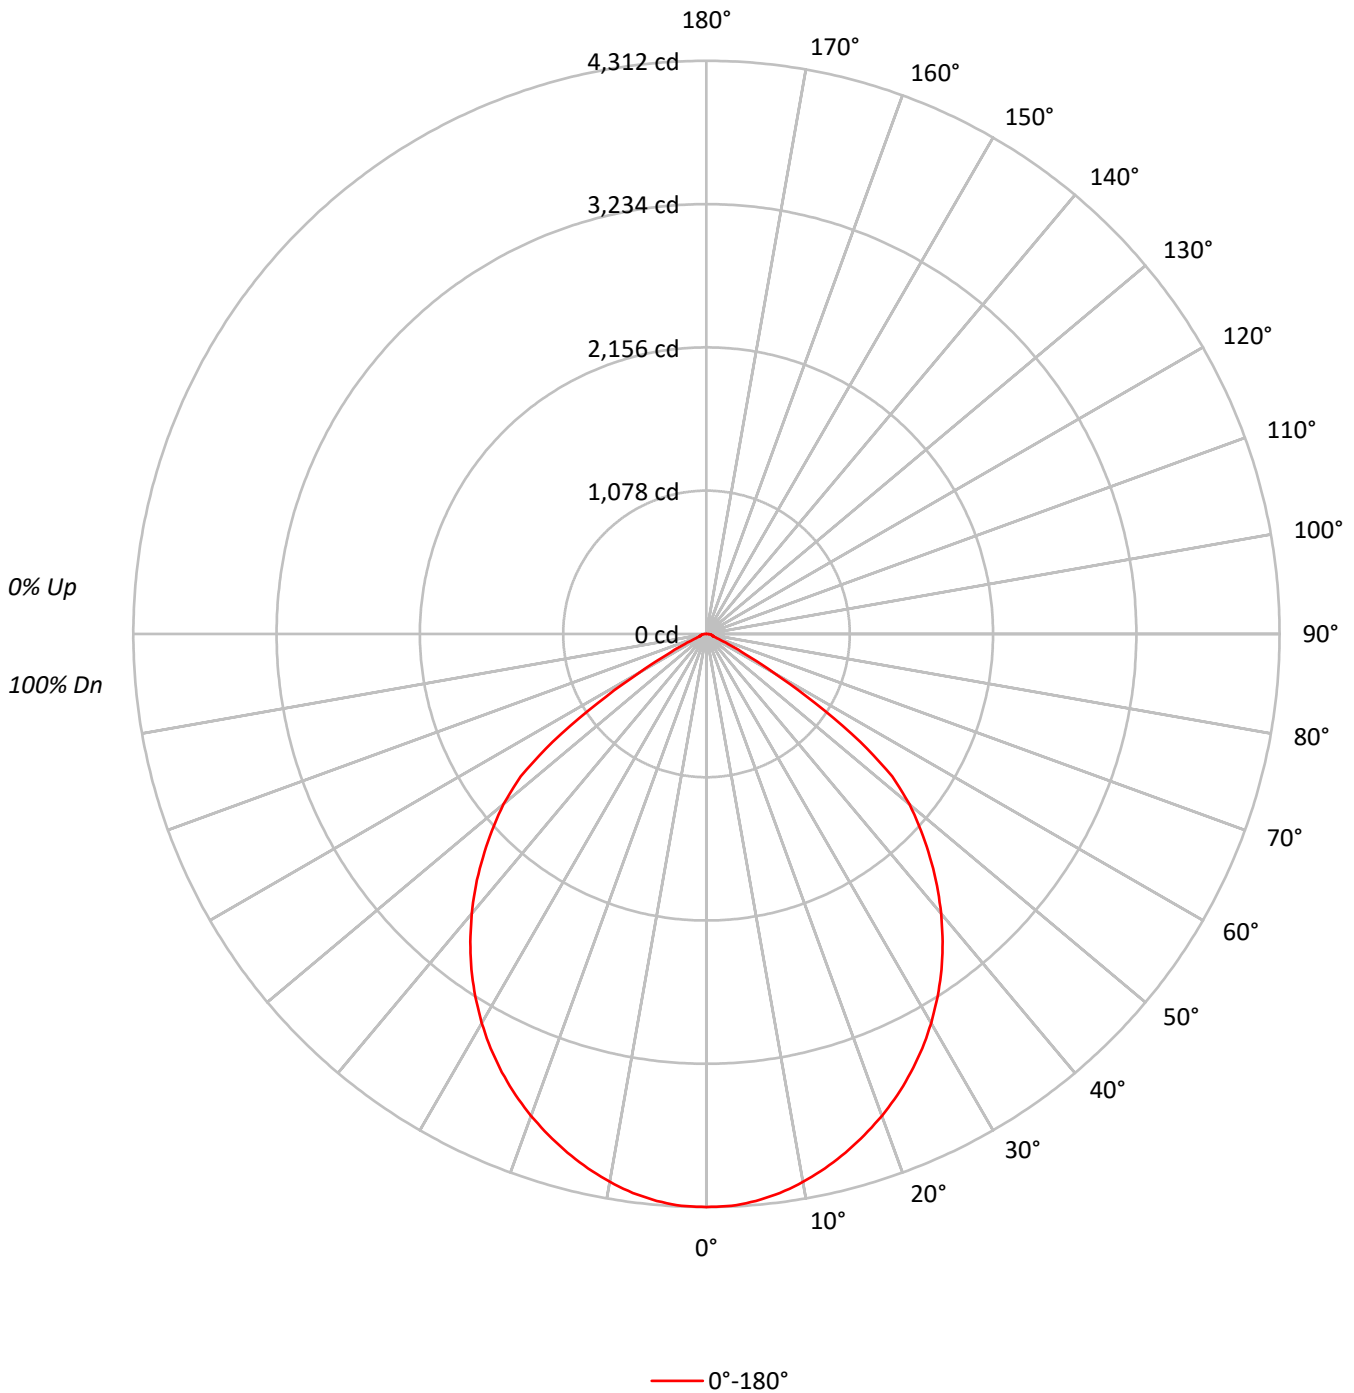



TEST NUMBER: P867046

CATALOG NUMBER: PRLX-2002-L-935-100L-L-X-X-GREY-X

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	112	108	105	102	109	106	103	100	102	99	97	98	96	94	94	93	91	90
2	104	97	92	87	101	95	91	86	92	88	84	89	86	83	86	83	81	79
3	96	88	81	76	94	86	80	75	83	78	74	81	76	73	78	75	71	69
4	89	79	72	66	87	78	71	66	75	70	65	73	68	64	71	67	63	61
5	83	72	64	58	81	71	63	58	69	62	57	67	61	57	65	60	56	54
6	77	65	57	52	75	64	57	52	63	56	51	61	55	51	60	54	50	48
7	72	60	52	46	70	59	51	46	57	51	46	56	50	46	55	49	45	43
8	67	55	47	42	65	54	47	42	53	46	41	52	46	41	50	45	41	39
9	63	50	43	38	61	50	43	38	49	42	38	48	42	37	47	41	37	36
10	59	47	39	35	58	46	39	34	45	39	34	44	38	34	43	38	34	32

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	21274
5°	21209
10°	20974
15°	20638
20°	20262
25°	19817
30°	19258
35°	18576
40°	17687
45°	16597
50°	15295
55°	12159
60°	5723
65°	2066
70°	796
75°	883
80°	1011
85°	1206

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 16597 cd/sqm

TEST NUMBER: P867046

CATALOG NUMBER: PRLX-2002-L-935-100L-L-X-X-GREY-X

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	405.7	4.8
10°-20°	1138.7	13.4
20°-30°	1674.8	19.8
30°-40°	1924.2	22.7
40°-50°	1832.7	21.6
50°-60°	1205.2	14.2
60°-70°	222.6	2.6
70°-80°	48.6	0.6
80°-90°	21.8	0.3
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	3219.2	38.0
0°-40°	5143.4	60.7
0°-60°	8181.4	96.5
0°-90°	8474.5	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	8474.5	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	4312	
5°	4282	406
15°	4040	1139
25°	3640	1675
35°	3084	1924
45°	2379	1833
55°	1414	1205
65°	177	223
75°	46	49
85°	21	22
90°	0	

TEST NUMBER: P867046

CATALOG NUMBER: PRLX-2002-L-935-100L-L-X-X-GREY-X

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	4311.8
2.5°	4307.3
5°	4282.4
7.5°	4242.4
10°	4186.4
12.5°	4117.9
15°	4040.5
17.5°	3953.3
20°	3859.0
22.5°	3754.0
25°	3640.2
27.5°	3515.6
30°	3380.4
32.5°	3235.4
35°	3084.2
37.5°	2918.7
40°	2746.1
42.5°	2569.1
45°	2378.7
47.5°	2190.1
50°	1992.7
52.5°	1761.4
55°	1413.5
57.5°	968.8
60°	580.0
62.5°	326.5
65°	177.0
67.5°	89.0
70°	55.2
72.5°	50.7
75°	46.3
77.5°	41.8
80°	35.6
82.5°	29.4
85°	21.3
87.5°	11.6
90°	0.0



TEST NUMBER: P867046  
 CATALOG NUMBER: PRLX-2002-L-935-100L-L-X-X-GREY-X

**CIE UGR TABLE:**

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	18.62	20.02	18.98	20.33	20.65	18.62	20.02	18.98	20.33	20.65
	3H	18.53	19.77	18.91	20.10	20.46	18.53	19.77	18.91	20.10	20.46
	4H	18.48	19.63	18.89	19.98	20.36	18.48	19.63	18.89	19.98	20.36
	6H	18.44	19.49	18.85	19.86	20.25	18.44	19.49	18.85	19.86	20.25
	8H	18.41	19.41	18.84	19.80	20.20	18.41	19.41	18.84	19.80	20.20
	12H	18.39	19.34	18.82	19.72	20.15	18.39	19.34	18.82	19.72	20.15
4H	2H	18.49	19.64	18.89	19.99	20.37	18.49	19.64	18.89	19.99	20.37
	3H	18.42	19.35	18.83	19.75	20.15	18.42	19.35	18.83	19.75	20.15
	4H	18.37	19.19	18.80	19.61	20.05	18.37	19.19	18.80	19.61	20.05
	6H	18.34	19.05	18.80	19.49	19.96	18.34	19.05	18.80	19.49	19.96
	8H	18.31	18.97	18.78	19.42	19.89	18.31	18.97	18.78	19.42	19.89
	12H	18.29	18.88	18.78	19.36	19.84	18.29	18.88	18.78	19.36	19.84
8H	4H	18.26	18.92	18.73	19.37	19.84	18.26	18.92	18.73	19.37	19.84
	6H	18.22	18.77	18.72	19.26	19.74	18.22	18.77	18.72	19.26	19.74
	8H	18.20	18.69	18.72	19.21	19.70	18.20	18.69	18.72	19.21	19.70
	12H	18.19	18.64	18.71	19.13	19.70	18.19	18.64	18.71	19.13	19.70
12H	4H	18.22	18.80	18.70	19.29	19.76	18.22	18.80	18.70	19.29	19.76
	6H	18.16	18.66	18.68	19.17	19.67	18.16	18.66	18.68	19.17	19.67
	8H	18.16	18.61	18.68	19.10	19.67	18.16	18.61	18.68	19.10	19.67