

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P866201

Luminaire Tested: PRLX-2002-M-927-65L-L-U-S-X-X-BRSS-X

Issue Date: 8/20/2024

Test Information

Test Method: LM-79-2019
Report Number: P866201
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2304-993-51)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 8/20/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: Prenalux
Catalog Number: PRLX-2002-M-927-65L-L-U-S-X-X-BRSS-X
Description: PRENTALUX 3D PRINTED PENDANT LED LUMINAIRE, MEDIUM LIGHT ENGINE, FLAT LENS, TRUNCATED DOME WITH BRASS INTERIOR SHADE.
LIGHT LEVEL 7
Light Source: 3000K CCT, 90 CRI LEDS
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 5059.9 lumens
Efficiency: N/A
Efficacy: 86.3 lumens/watt
Spacing Criteria (0/90/45): 1.16 / 1.16 / 1.27
Luminous Opening: Circular (Dia: 1.31' x H: 0')
CIE Type: Direct

Input Watts (W): 58.6
Input Voltage (V): 120
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: 0.5 HR
Operation Time: 3 HR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P866201

CATALOG NUMBER: PRLX-2002-M-927-65L-L-U-S-X-X-BRSS-X

Luminous Intensity Polar Plot

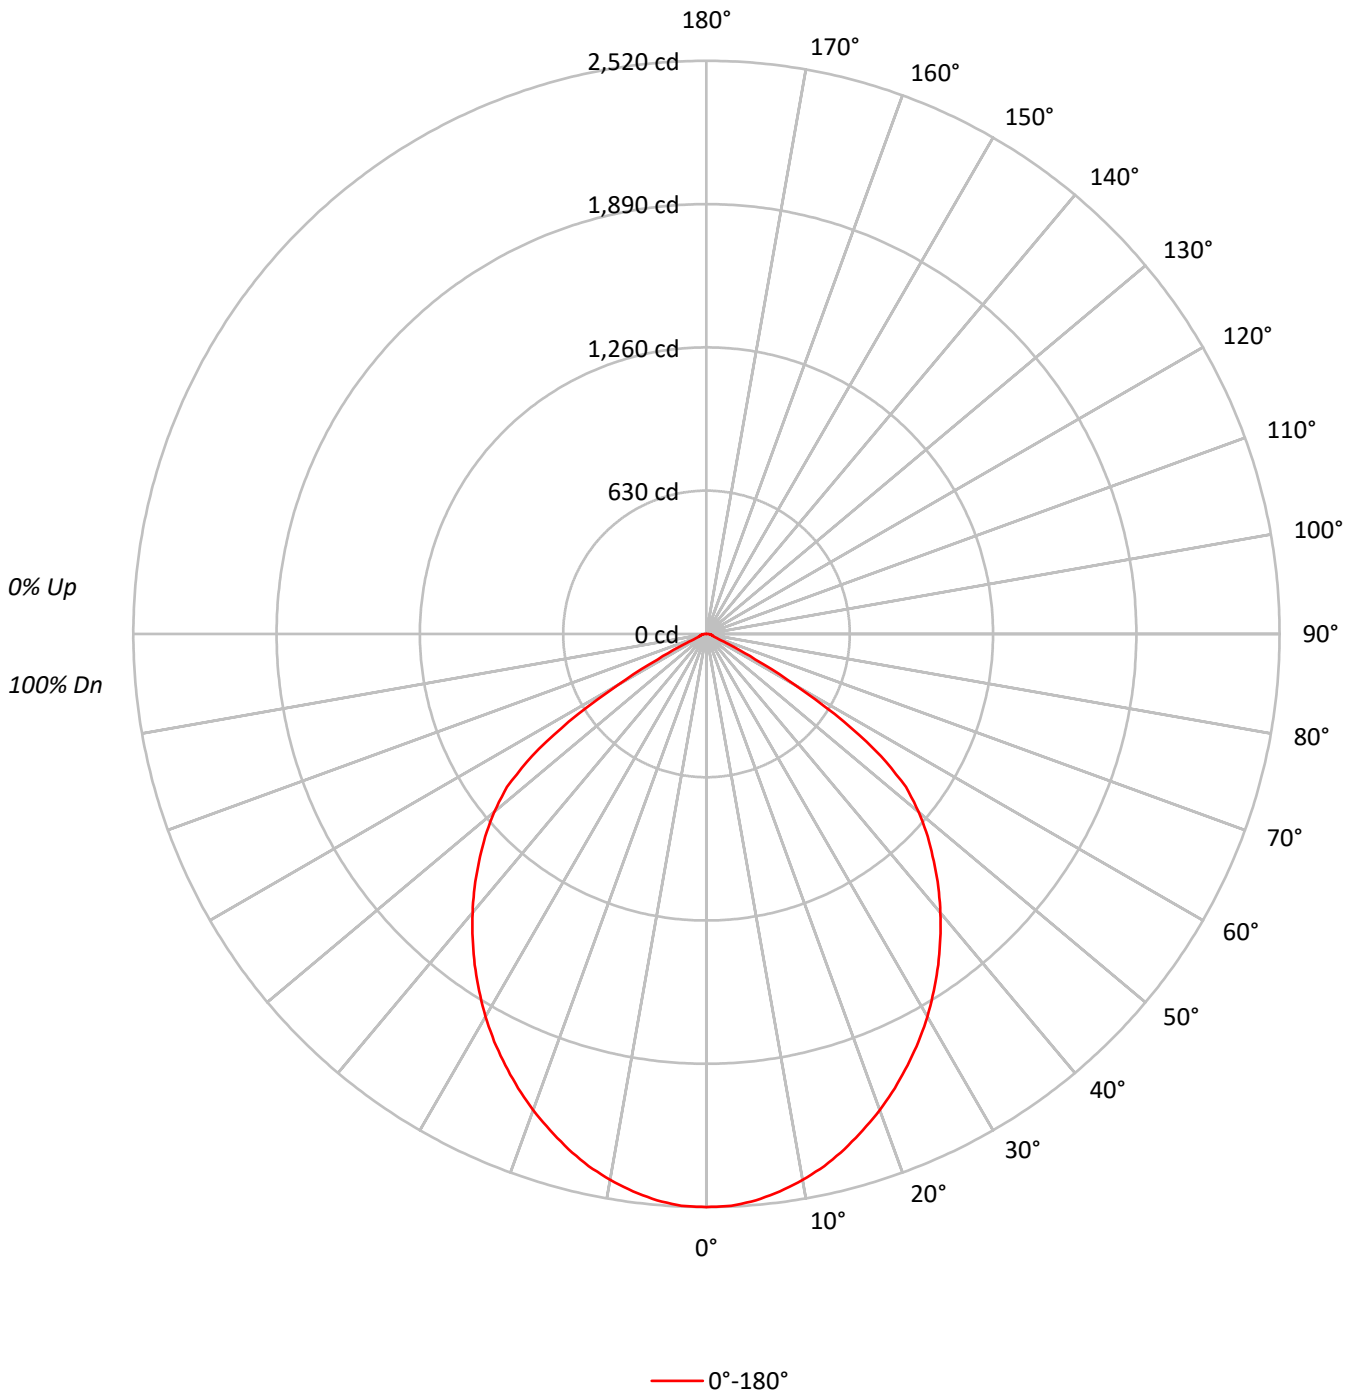



TEST NUMBER: P866201

CATALOG NUMBER: PRLX-2002-M-927-65L-L-U-S-X-X-BRSS-X

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	111	108	105	102	109	106	103	100	101	99	97	98	96	94	94	93	91	89
2	103	97	91	87	101	95	90	86	92	88	84	89	85	82	86	83	80	78
3	96	87	80	75	93	86	79	74	83	77	73	80	76	72	78	74	71	69
4	89	78	71	65	86	77	70	65	75	69	64	73	67	63	71	66	62	60
5	82	71	63	57	80	70	62	57	68	61	56	66	60	56	64	59	55	53
6	76	64	56	51	74	63	56	51	62	55	50	60	54	50	59	53	49	48
7	71	59	51	45	69	58	51	45	57	50	45	55	49	45	54	48	44	43
8	66	54	46	41	65	53	46	41	52	45	40	51	45	40	50	44	40	38
9	62	50	42	37	61	49	42	37	48	41	37	47	41	37	46	40	36	35
10	58	46	39	34	57	45	38	34	44	38	34	44	38	33	43	37	33	32

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	20049
5°	19967
10°	19692
15°	19316
20°	18864
25°	18372
30°	17848
35°	17251
40°	16615
45°	15902
50°	15085
55°	12994
60°	7163
65°	2018
70°	805
75°	861
80°	980
85°	1205

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 15902 cd/sqm

TEST NUMBER: P866201

CATALOG NUMBER: PRLX-2002-M-927-65L-L-U-S-X-X-BRSS-X

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	236.6	4.7
10°-20°	660.4	13.1
20°-30°	963.6	19.0
30°-40°	1110.3	21.9
40°-50°	1090.1	21.5
50°-60°	799.4	15.8
60°-70°	156.6	3.1
70°-80°	29.6	0.6
80°-90°	13.2	0.3
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1860.6	36.8
0°-40°	2970.9	58.7
0°-60°	4860.5	96.1
0°-90°	5059.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	5059.9	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	2520	
5°	2500	237
15°	2345	660
25°	2093	964
35°	1776	1110
45°	1413	1090
55°	937	799
65°	107	157
75°	28	30
85°	13	13
90°	0	

TEST NUMBER: P866201

CATALOG NUMBER: PRLX-2002-M-927-65L-L-U-S-X-X-BRSS-X

CANDELA DISTRIBUTION (FULL):

	0°
0°	2520.0
2.5°	2516.7
5°	2500.2
7.5°	2472.2
10°	2437.6
12.5°	2396.3
15°	2345.2
17.5°	2287.5
20°	2228.1
22.5°	2162.1
25°	2092.9
27.5°	2020.3
30°	1942.8
32.5°	1860.3
35°	1776.2
37.5°	1688.8
40°	1599.8
42.5°	1509.1
45°	1413.4
47.5°	1319.4
50°	1218.8
52.5°	1105.0
55°	936.8
57.5°	717.4
60°	450.2
62.5°	242.4
65°	107.2
67.5°	49.5
70°	34.6
72.5°	31.3
75°	28.0
77.5°	24.7
80°	21.4
82.5°	18.1
85°	13.2
87.5°	6.6
90°	0.0



TEST NUMBER: P866201
 CATALOG NUMBER: PRLX-2002-M-927-65L-L-U-S-X-X-BRSS-X

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	19.96	21.39	20.33	21.70	22.02	19.96	21.39	20.33	21.70	22.02
	3H	19.87	21.13	20.25	21.45	21.82	19.87	21.13	20.25	21.45	21.82
	4H	19.81	20.98	20.22	21.33	21.71	19.81	20.98	20.22	21.33	21.71
	6H	19.76	20.83	20.17	21.20	21.59	19.76	20.83	20.17	21.20	21.59
	8H	19.73	20.75	20.16	21.14	21.54	19.73	20.75	20.16	21.14	21.54
	12H	19.70	20.67	20.13	21.06	21.49	19.70	20.67	20.13	21.06	21.49
4H	2H	19.82	20.99	20.22	21.34	21.72	19.82	20.99	20.22	21.34	21.72
	3H	19.74	20.68	20.15	21.09	21.49	19.74	20.68	20.15	21.09	21.49
	4H	19.68	20.52	20.12	20.94	21.38	19.68	20.52	20.12	20.94	21.38
	6H	19.64	20.36	20.10	20.81	21.27	19.64	20.36	20.10	20.81	21.27
	8H	19.60	20.28	20.07	20.72	21.19	19.60	20.28	20.07	20.72	21.19
	12H	19.58	20.18	20.06	20.66	21.13	19.58	20.18	20.06	20.66	21.13
8H	4H	19.56	20.24	20.03	20.69	21.16	19.56	20.24	20.03	20.69	21.16
	6H	19.51	20.07	20.01	20.56	21.04	19.51	20.07	20.01	20.56	21.04
	8H	19.47	19.98	19.99	20.49	20.98	19.47	19.98	19.99	20.49	20.98
	12H	19.46	19.91	19.97	20.40	20.97	19.46	19.91	19.97	20.40	20.97
12H	4H	19.52	20.12	20.01	20.61	21.08	19.52	20.12	20.01	20.61	21.08
	6H	19.45	19.96	19.97	20.47	20.96	19.45	19.96	19.97	20.47	20.96
	8H	19.44	19.89	19.95	20.38	20.95	19.44	19.89	19.95	20.38	20.95