

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P866222

Luminaire Tested: PRLX-2002-M-930-15L-G-U-S-X-X-GREY-X

Issue Date: 8/20/2024

Test Information

Test Method: LM-79-2019
Report Number: P866222
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2304-993-40)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 8/20/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: Prenalux
Catalog Number: PRLX-2002-M-930-15L-G-U-S-X-X-GREY-X
Description: PRENTALUX 3D PRINTED PENDANT LED LUMINAIRE, MEDIUM LIGHT ENGINE, GLOBE LENS, TRUNCATED DOME WITH GRAY INTERIOR SHADE.
LIGHT LEVEL 2
Light Source: 3000K CCT, 90 CRI LEDS
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 562.1 lumens
Efficiency: N/A
Efficacy: 40.2 lumens/watt
Spacing Criteria (0/90/45): 1.36 / 1.36 / 1.53
Luminous Opening: Circular (Dia: 1.31' x H: 0')
CIE Type: Direct

Input Watts (W): 14
Input Voltage (V): 120
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: 0.5 HR
Operation Time: 3 HR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P866222

CATALOG NUMBER: PRLX-2002-M-930-15L-G-U-S-X-X-GREY-X

Luminous Intensity Polar Plot

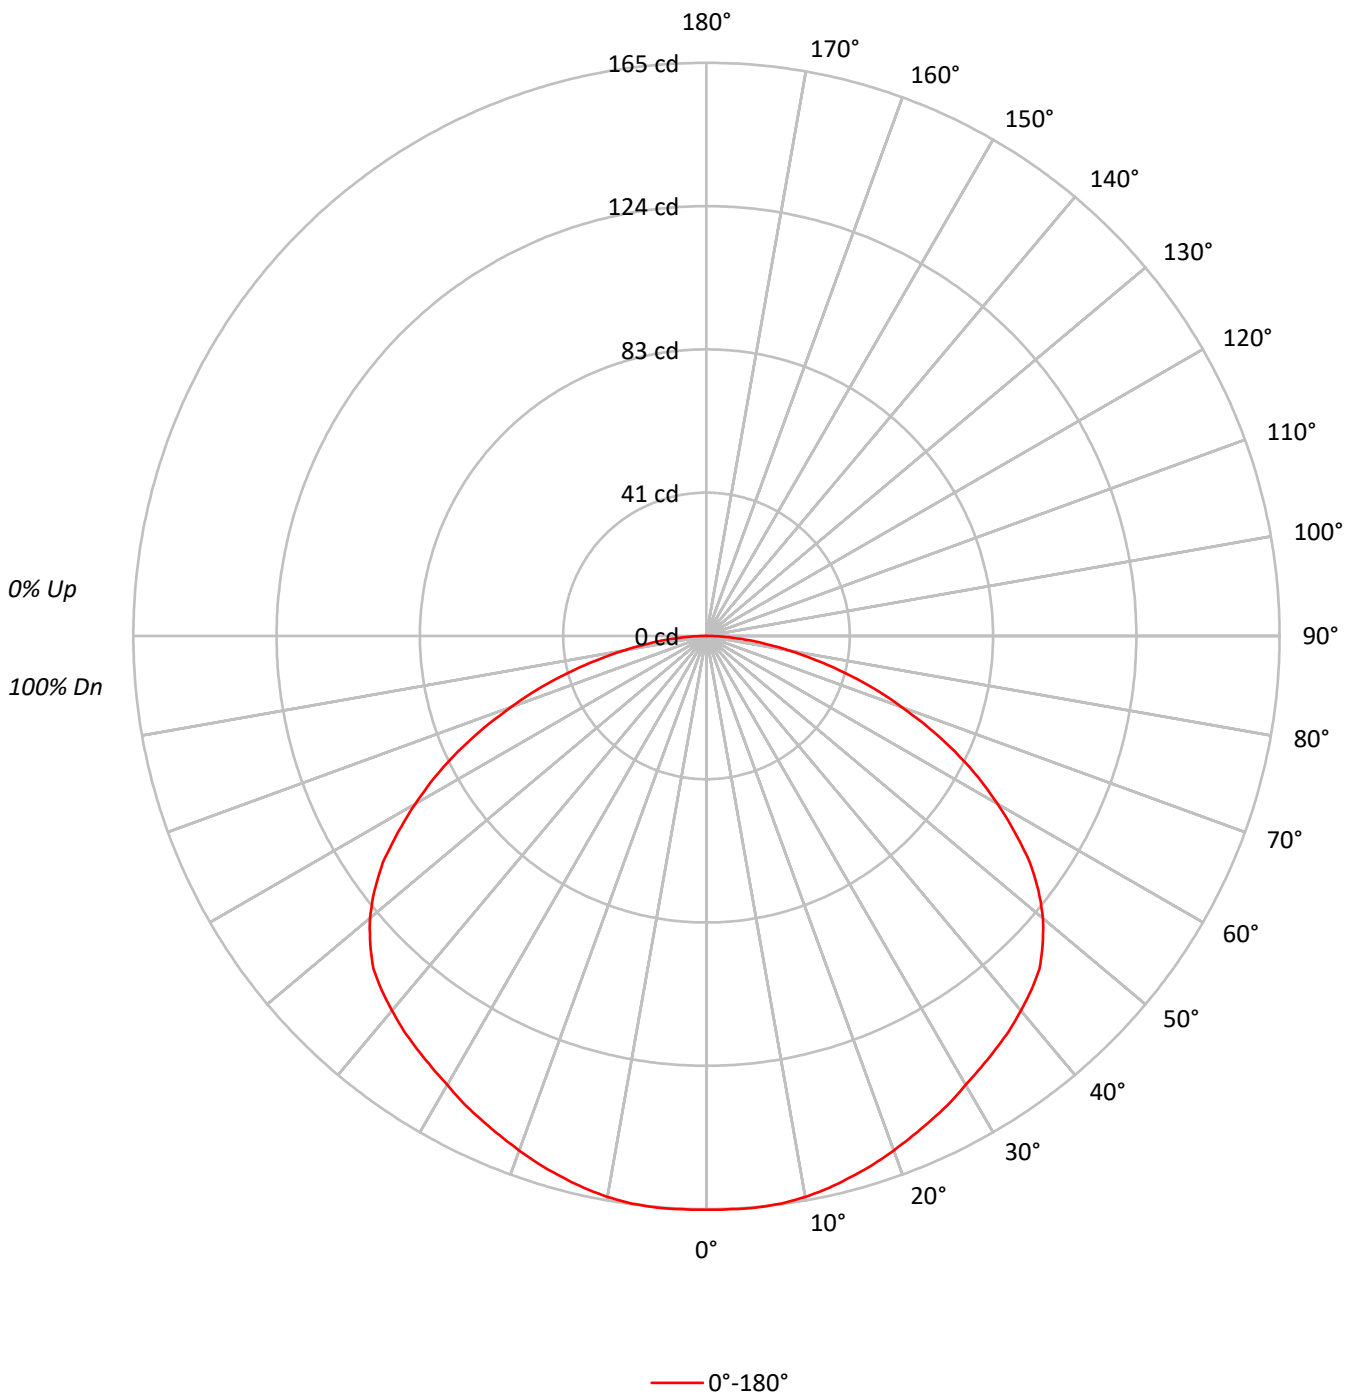



TEST NUMBER: P866222

CATALOG NUMBER: PRLX-2002-M-930-15L-G-U-S-X-X-GREY-X

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	108	103	99	95	105	101	97	93	97	93	90	93	90	87	89	87	85	83
2	98	89	82	76	95	87	81	75	84	78	73	80	76	72	77	73	70	68
3	89	78	69	62	86	76	68	62	73	66	61	70	64	59	68	63	58	56
4	81	68	59	52	78	67	58	52	64	57	51	62	55	50	60	54	49	47
5	74	61	51	44	72	59	51	44	57	49	44	55	48	43	53	47	43	40
6	68	54	45	38	66	53	44	38	51	44	38	50	43	37	48	42	37	35
7	63	49	40	33	61	48	39	33	47	39	33	45	38	33	44	37	33	31
8	58	44	36	30	57	44	35	30	42	35	29	41	34	29	40	34	29	27
9	55	41	32	26	53	40	32	26	39	31	26	38	31	26	37	31	26	24
10	51	37	29	24	50	37	29	24	36	29	24	35	28	24	34	28	23	22

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1314
5°	1319
10°	1325
15°	1328
20°	1334
25°	1348
30°	1371
35°	1410
40°	1462
45°	1526
50°	1566
55°	1577
60°	1542
65°	1487
70°	1391
75°	1276
80°	1113
85°	913

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 55°
 Luminance: 1577 cd/sqm

TEST NUMBER: P866222

CATALOG NUMBER: PRLX-2002-M-930-15L-G-U-S-X-X-GREY-X

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	15.7	2.8
10°-20°	45.6	8.1
20°-30°	71.0	12.6
30°-40°	91.1	16.2
40°-50°	104.2	18.5
50°-60°	100.9	18.0
60°-70°	77.9	13.9
70°-80°	43.9	7.8
80°-90°	11.8	2.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	132.3	23.5
0°-40°	223.3	39.7
0°-60°	428.5	76.2
0°-90°	562.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	562.1	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	165	
5°	165	16
15°	161	46
25°	154	71
35°	145	91
45°	136	104
55°	114	101
65°	79	78
75°	42	44
85°	10	12
90°	0	

TEST NUMBER: P866222

CATALOG NUMBER: PRLX-2002-M-930-15L-G-U-S-X-X-GREY-X

CANDELA DISTRIBUTION (FULL):

	0°
0°	165.2
2.5°	165.2
5°	165.2
7.5°	164.8
10°	164.0
12.5°	162.8
15°	161.2
17.5°	159.6
20°	157.6
22.5°	155.6
25°	153.6
27.5°	151.6
30°	149.2
32.5°	147.2
35°	145.2
37.5°	143.2
40°	140.8
42.5°	138.4
45°	135.6
47.5°	131.3
50°	126.5
52.5°	120.5
55°	113.7
57.5°	105.3
60°	96.9
62.5°	88.2
65°	79.0
67.5°	69.4
70°	59.8
72.5°	50.7
75°	41.5
77.5°	32.3
80°	24.3
82.5°	16.8
85°	10.0
87.5°	4.4
90°	0.0



TEST NUMBER: P866222
 CATALOG NUMBER: PRLX-2002-M-930-15L-G-U-S-X-X-GREY-X

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	14.07	15.77	14.43	16.08	16.40	14.07	15.77	14.43	16.08	16.40
	3H	15.88	17.43	16.26	17.75	18.11	15.88	17.43	16.26	17.75	18.11
	4H	16.55	18.01	16.94	18.35	18.73	16.55	18.01	16.94	18.35	18.73
	6H	17.01	18.37	17.42	18.73	19.12	17.01	18.37	17.42	18.73	19.12
	8H	17.16	18.45	17.58	18.84	19.24	17.16	18.45	17.58	18.84	19.24
	12H	17.25	18.49	17.68	18.88	19.30	17.25	18.49	17.68	18.88	19.30
4H	2H	14.73	16.18	15.12	16.53	16.90	14.73	16.18	15.12	16.53	16.90
	3H	16.75	17.98	17.16	18.38	18.78	16.75	17.98	17.16	18.38	18.78
	4H	17.54	18.65	17.97	19.07	19.50	17.54	18.65	17.97	19.07	19.50
	6H	18.13	19.10	18.58	19.54	20.00	18.13	19.10	18.58	19.54	20.00
	8H	18.32	19.23	18.78	19.67	20.14	18.32	19.23	18.78	19.67	20.14
	12H	18.46	19.28	18.94	19.75	20.22	18.46	19.28	18.94	19.75	20.22
8H	4H	17.85	18.77	18.31	19.21	19.67	17.85	18.77	18.31	19.21	19.67
	6H	18.56	19.32	19.05	19.80	20.28	18.56	19.32	19.05	19.80	20.28
	8H	18.82	19.50	19.32	20.00	20.49	18.82	19.50	19.32	20.00	20.49
	12H	19.02	19.63	19.53	20.11	20.67	19.02	19.63	19.53	20.11	20.67
12H	4H	17.89	18.71	18.37	19.18	19.65	17.89	18.71	18.37	19.18	19.65
	6H	18.61	19.29	19.12	19.80	20.28	18.61	19.29	19.12	19.80	20.28
	8H	18.93	19.53	19.43	20.02	20.58	18.93	19.53	19.43	20.02	20.58