

Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P866264

Luminaire Tested: PRLX-2002-M-930-65L-L-U-S-X-X-BLAK-X

Issue Date: 8/20/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P866264  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2304-993-53)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 8/20/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: Prenalux  
Catalog Number: PRLX-2002-M-930-65L-L-U-S-X-X-BLAK-X  
Description: PRENTALUX 3D PRINTED PENDANT LED LUMINAIRE, MEDIUM LIGHT ENGINE, FLAT LENS, TRUNCATED DOME WITH BLACK INTERIOR SHADE.  
LIGHT LEVEL 7  
Light Source: 3000K CCT, 90 CRI LEDS  
Ballast/Driver: -


**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 4987.6 lumens  
Efficiency: N/A  
Efficacy: 85.1 lumens/watt  
Spacing Criteria (0/90/45): 1.16 / 1.16 / 1.27  
Luminous Opening: Circular (Dia: 1.31' x H: 0')  
CIE Type: Direct  
  
Input Watts (W): 58.6  
Input Voltage (V): 120  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: 0.5 HR  
Operation Time: 3 HR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P866264

CATALOG NUMBER: PRLX-2002-M-930-65L-L-U-S-X-X-BLAK-X

### Luminous Intensity Polar Plot

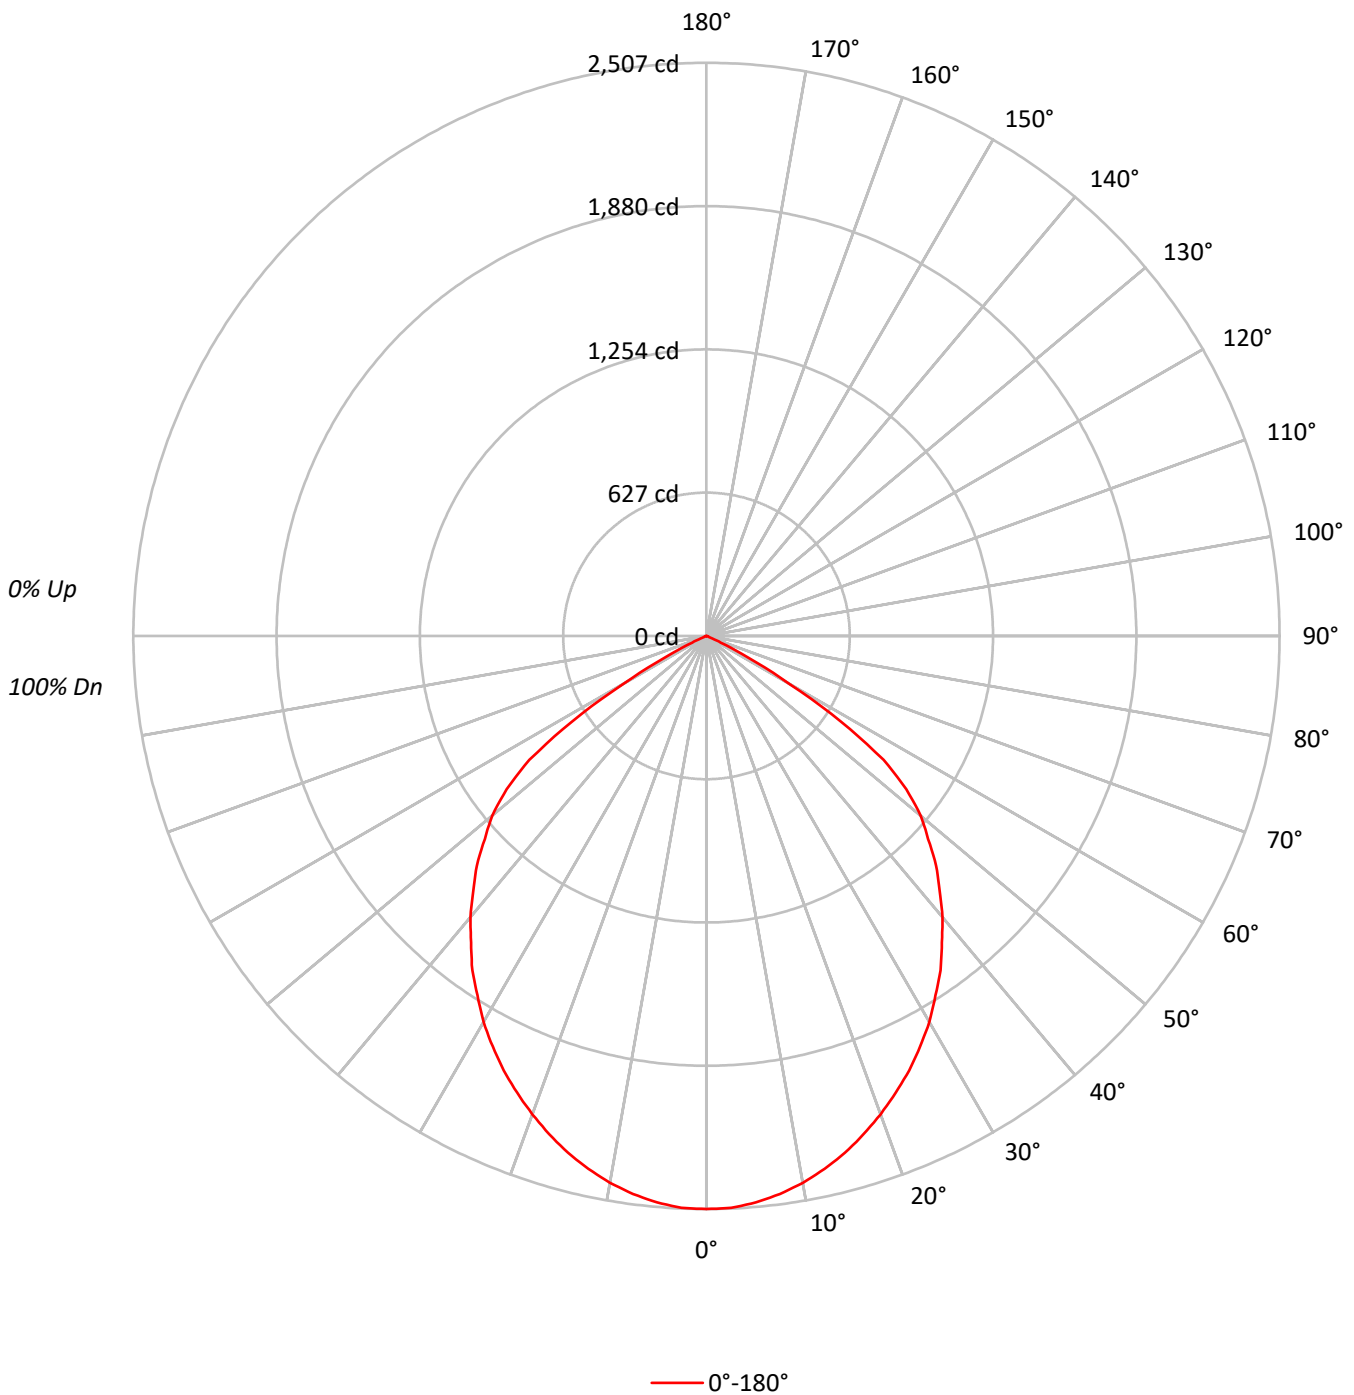



TEST NUMBER: P866264

CATALOG NUMBER: PRLX-2002-M-930-65L-L-U-S-X-X-BLAK-X

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	112	108	105	102	109	106	103	100	102	99	97	98	96	94	95	93	92	90
2	104	97	92	88	101	96	91	87	92	88	85	89	86	83	86	83	81	79
3	96	88	81	76	94	86	80	75	83	78	74	81	76	73	78	75	71	69
4	89	79	72	66	87	78	71	66	75	69	65	73	68	64	71	67	63	61
5	83	71	64	58	81	70	63	58	68	62	57	67	61	57	65	60	56	54
6	77	65	57	51	75	64	57	51	62	56	51	61	55	50	59	54	50	48
7	71	59	51	46	70	58	51	46	57	50	45	56	50	45	54	49	45	43
8	67	54	47	41	65	54	46	41	52	46	41	51	45	41	50	45	41	39
9	62	50	43	37	61	49	42	37	48	42	37	47	41	37	46	41	37	35
10	59	46	39	34	57	46	39	34	45	38	34	44	38	34	43	38	34	32

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	19943
5°	19867
10°	19622
15°	19280
20°	18852
25°	18408
30°	17915
35°	17344
40°	16679
45°	15989
50°	15149
55°	13116
60°	6711
65°	1303
70°	121
75°	160
80°	160
85°	155

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 15989 cd/sqm

TEST NUMBER: P866264

CATALOG NUMBER: PRLX-2002-M-930-65L-L-U-S-X-X-BLAK-X

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	235.6	4.7
10°-20°	659.1	13.2
20°-30°	965.1	19.3
30°-40°	1113.7	22.3
40°-50°	1092.0	21.9
50°-60°	793.4	15.9
60°-70°	121.7	2.4
70°-80°	4.8	0.1
80°-90°	2.4	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1859.7	37.3
0°-40°	2973.4	59.6
0°-60°	4858.8	97.4
0°-90°	4987.6	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4987.6	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	2507	
5°	2488	236
15°	2341	659
25°	2097	965
35°	1786	1114
45°	1421	1092
55°	946	793
65°	69	122
75°	5	5
85°	2	2
90°	0	

TEST NUMBER: P866264

CATALOG NUMBER: PRLX-2002-M-930-65L-L-U-S-X-X-BLAK-X

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	2506.7
2.5°	2503.3
5°	2487.7
7.5°	2461.8
10°	2428.9
12.5°	2387.4
15°	2340.8
17.5°	2285.5
20°	2226.7
22.5°	2162.7
25°	2097.0
27.5°	2024.4
30°	1950.1
32.5°	1863.6
35°	1785.8
37.5°	1690.7
40°	1606.0
42.5°	1509.2
45°	1421.1
47.5°	1315.6
50°	1224.0
52.5°	1101.2
55°	945.6
57.5°	698.4
60°	421.8
62.5°	200.5
65°	69.2
67.5°	17.3
70°	5.2
72.5°	5.2
75°	5.2
77.5°	3.5
80°	3.5
82.5°	3.5
85°	1.7
87.5°	1.7
90°	0.0



TEST NUMBER: P866264  
 CATALOG NUMBER: PRLX-2002-M-930-65L-L-U-S-X-X-BLAK-X

**CIE UGR TABLE:**

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	19.83	21.25	20.20	21.56	21.87	19.83	21.25	20.20	21.56	21.87
	3H	19.72	20.96	20.09	21.29	21.65	19.72	20.96	20.09	21.29	21.65
	4H	19.65	20.80	20.05	21.15	21.53	19.65	20.80	20.05	21.15	21.53
	6H	19.58	20.63	19.99	21.00	21.40	19.58	20.63	19.99	21.00	21.40
	8H	19.54	20.54	19.97	20.93	21.33	19.54	20.54	19.97	20.93	21.33
	12H	19.50	20.45	19.93	20.84	21.27	19.50	20.45	19.93	20.84	21.27
4H	2H	19.67	20.82	20.07	21.17	21.55	19.67	20.82	20.07	21.17	21.55
	3H	19.56	20.48	19.97	20.88	21.29	19.56	20.48	19.97	20.88	21.29
	4H	19.47	20.30	19.91	20.71	21.16	19.47	20.30	19.91	20.71	21.16
	6H	19.40	20.11	19.86	20.55	21.02	19.40	20.11	19.86	20.55	21.02
	8H	19.34	20.01	19.81	20.45	20.92	19.34	20.01	19.81	20.45	20.92
	12H	19.30	19.89	19.78	20.37	20.84	19.30	19.89	19.78	20.37	20.84
8H	4H	19.34	20.00	19.81	20.45	20.92	19.34	20.00	19.81	20.45	20.92
	6H	19.24	19.79	19.74	20.28	20.76	19.24	19.79	19.74	20.28	20.76
	8H	19.17	19.67	19.69	20.18	20.67	19.17	19.67	19.69	20.18	20.67
	12H	19.12	19.57	19.64	20.06	20.63	19.12	19.57	19.64	20.06	20.63
12H	4H	19.30	19.88	19.78	20.37	20.84	19.30	19.88	19.78	20.37	20.84
	6H	19.17	19.67	19.69	20.18	20.67	19.17	19.67	19.69	20.18	20.67
	8H	19.12	19.57	19.64	20.06	20.63	19.12	19.57	19.64	20.06	20.63