

Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P866299

Luminaire Tested: PRLX-2002-M-935-25L-L-U-S-X-X-WHHR-X

Issue Date: 8/20/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P866299  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2304-993-50)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 8/20/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: Prenalux  
Catalog Number: PRLX-2002-M-935-25L-L-U-S-X-X-WHHR-X  
Description: PRENATALUX 3D PRINTED PENDANT LED LUMINAIRE, MEDIUM LIGHT ENGINE, FLAT LENS, TRUNCATED DOME WITH WHITE INTERIOR SHADE.  
LIGHT LEVEL 3  
Light Source: 3500K CCT, 90 CRI LEDS  
Ballast/Driver: -


**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 2530.3 lumens  
Efficiency: N/A  
Efficacy: 116.6 lumens/watt  
Spacing Criteria (0/90/45): 1.19 / 1.19 / 1.3  
Luminous Opening: Circular (Dia: 1.31' x H: 0')  
CIE Type: Direct  
  
Input Watts (W): 21.7  
Input Voltage (V): 120  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: 0.333 HR  
Operation Time: 3 HR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P866299

CATALOG NUMBER: PRLX-2002-M-935-25L-L-U-S-X-X-WHHR-X

### Luminous Intensity Polar Plot

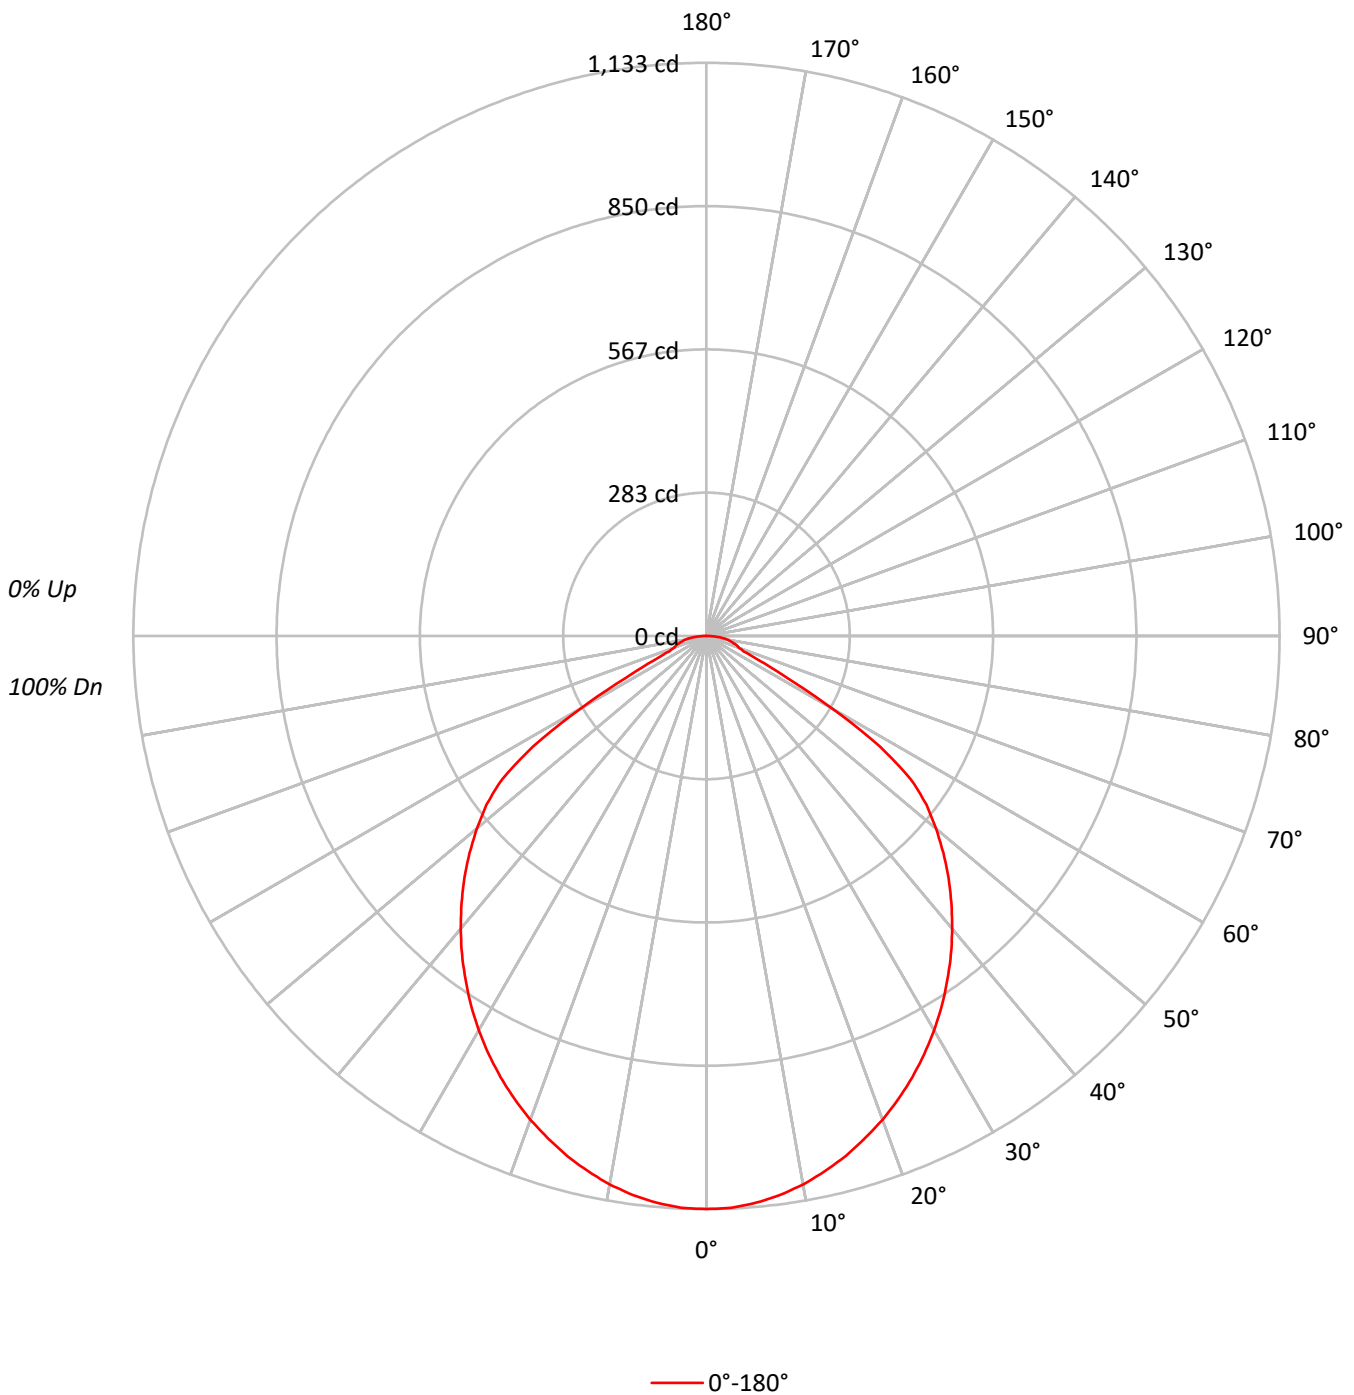



TEST NUMBER: P866299

CATALOG NUMBER: PRLX-2002-M-935-25L-L-U-S-X-X-WHHR-X

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	111	107	103	100	108	104	101	98	100	98	95	96	94	92	93	91	89	87
2	102	95	89	84	100	93	88	83	90	85	81	86	83	79	84	80	78	76
3	94	85	77	72	92	83	76	71	80	75	70	78	73	69	75	71	68	66
4	87	76	68	62	84	75	67	62	72	66	61	70	64	60	68	63	59	57
5	80	68	60	54	78	67	60	54	65	58	53	63	57	53	62	56	52	50
6	74	62	54	48	72	61	53	48	59	52	47	58	51	47	56	51	46	44
7	69	56	48	42	67	56	48	42	54	47	42	53	46	42	51	46	41	40
8	64	52	44	38	63	51	43	38	50	43	38	48	42	38	47	42	37	36
9	60	47	40	34	59	47	39	34	46	39	34	45	38	34	44	38	34	32
10	56	44	36	31	55	43	36	31	42	36	31	41	35	31	41	35	31	29

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	9013
5°	8983
10°	8894
15°	8767
20°	8615
25°	8450
30°	8270
35°	8064
40°	7848
45°	7610
50°	7330
55°	6831
60°	4587
65°	2171
70°	1593
75°	1709
80°	1897
85°	2109

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 7610 cd/sqm

TEST NUMBER: P866299

CATALOG NUMBER: PRLX-2002-M-935-25L-L-U-S-X-X-WHHR-X

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	106.6	4.2
10°-20°	299.9	11.9
20°-30°	443.3	17.5
30°-40°	519.4	20.5
40°-50°	521.4	20.6
50°-60°	420.8	16.6
60°-70°	136.0	5.4
70°-80°	58.7	2.3
80°-90°	24.3	1.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	849.8	33.6
0°-40°	1369.1	54.1
0°-60°	2311.3	91.3
0°-90°	2530.3	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2530.3	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	1133	
5°	1125	107
15°	1064	300
25°	963	443
35°	830	519
45°	676	521
55°	492	421
65°	115	136
75°	56	59
85°	23	24
90°	0	

TEST NUMBER: P866299

CATALOG NUMBER: PRLX-2002-M-935-25L-L-U-S-X-X-WHHR-X

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	1132.9
2.5°	1131.6
5°	1124.8
7.5°	1114.6
10°	1101.0
12.5°	1083.4
15°	1064.4
17.5°	1041.3
20°	1017.6
22.5°	991.1
25°	962.6
27.5°	932.1
30°	900.2
32.5°	866.3
35°	830.3
37.5°	793.7
40°	755.7
42.5°	716.4
45°	676.4
47.5°	635.0
50°	592.2
52.5°	548.1
55°	492.5
57.5°	406.4
60°	288.3
62.5°	180.5
65°	115.3
67.5°	79.4
70°	68.5
72.5°	63.1
75°	55.6
77.5°	48.8
80°	41.4
82.5°	33.2
85°	23.1
87.5°	12.2
90°	0.0



TEST NUMBER: P866299  
 CATALOG NUMBER: PRLX-2002-M-935-25L-L-U-S-X-X-WHHR-X

**CIE UGR TABLE:**

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	18.38	19.87	18.74	20.19	20.50	18.38	19.87	18.74	20.19	20.50
	3H	18.48	19.81	18.86	20.14	20.51	18.48	19.81	18.86	20.14	20.51
	4H	18.57	19.81	18.97	20.16	20.54	18.57	19.81	18.97	20.16	20.54
	6H	18.68	19.83	19.10	20.20	20.59	18.68	19.83	19.10	20.20	20.59
	8H	18.74	19.83	19.17	20.22	20.62	18.74	19.83	19.17	20.22	20.62
	12H	18.79	19.83	19.22	20.21	20.64	18.79	19.83	19.22	20.21	20.64
4H	2H	18.34	19.58	18.74	19.93	20.31	18.34	19.58	18.74	19.93	20.31
	3H	18.54	19.56	18.95	19.96	20.36	18.54	19.56	18.95	19.96	20.36
	4H	18.70	19.61	19.13	20.03	20.47	18.70	19.61	19.13	20.03	20.47
	6H	18.92	19.71	19.38	20.15	20.61	18.92	19.71	19.38	20.15	20.61
	8H	19.02	19.76	19.49	20.21	20.67	19.02	19.76	19.49	20.21	20.67
	12H	19.12	19.78	19.61	20.26	20.74	19.12	19.78	19.61	20.26	20.74
8H	4H	18.72	19.45	19.18	19.90	20.37	18.72	19.45	19.18	19.90	20.37
	6H	19.01	19.63	19.51	20.12	20.60	19.01	19.63	19.51	20.12	20.60
	8H	19.18	19.74	19.70	20.25	20.74	19.18	19.74	19.70	20.25	20.74
	12H	19.36	19.85	19.87	20.35	20.91	19.36	19.85	19.87	20.35	20.91
12H	4H	18.71	19.36	19.19	19.84	20.32	18.71	19.36	19.19	19.84	20.32
	6H	19.02	19.57	19.53	20.08	20.57	19.02	19.57	19.53	20.08	20.57
	8H	19.24	19.73	19.75	20.22	20.79	19.24	19.73	19.75	20.22	20.79