

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P865654

Luminaire Tested: PRLX-2002-S-935-05L-G-U-S-X-X-GREY-X

Issue Date: 8/20/2024

Test Information

Test Method: LM-79-2019
Report Number: P865654
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2304-993-9)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 8/20/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: Prenalux
Catalog Number: PRLX-2002-S-935-05L-G-U-S-X-X-GREY-X
Description: PRENTALUX 3D PRINTED PENDANT LED LUMINAIRE, SMALL LIGHT ENGINE, GLOBE LENS, TRUNCATED DOME WITH GRAY INTERIOR SHADE.
LIGHT LEVEL 1
Light Source: 3500K CCT, 90 CRI LEDS
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 171.3 lumens
Efficiency: N/A
Efficacy: 27.6 lumens/watt
Spacing Criteria (0/90/45): 1.37 / 1.37 / 1.53
Luminous Opening: Circular (Dia: 0.85' x H: 0')
CIE Type: Direct

Input Watts (W): 6.2
Input Voltage (V): 120
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: 0.333 HR
Operation Time: 3 HR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P865654

CATALOG NUMBER: PRLX-2002-S-935-05L-G-U-S-X-X-GREY-X

Luminous Intensity Polar Plot

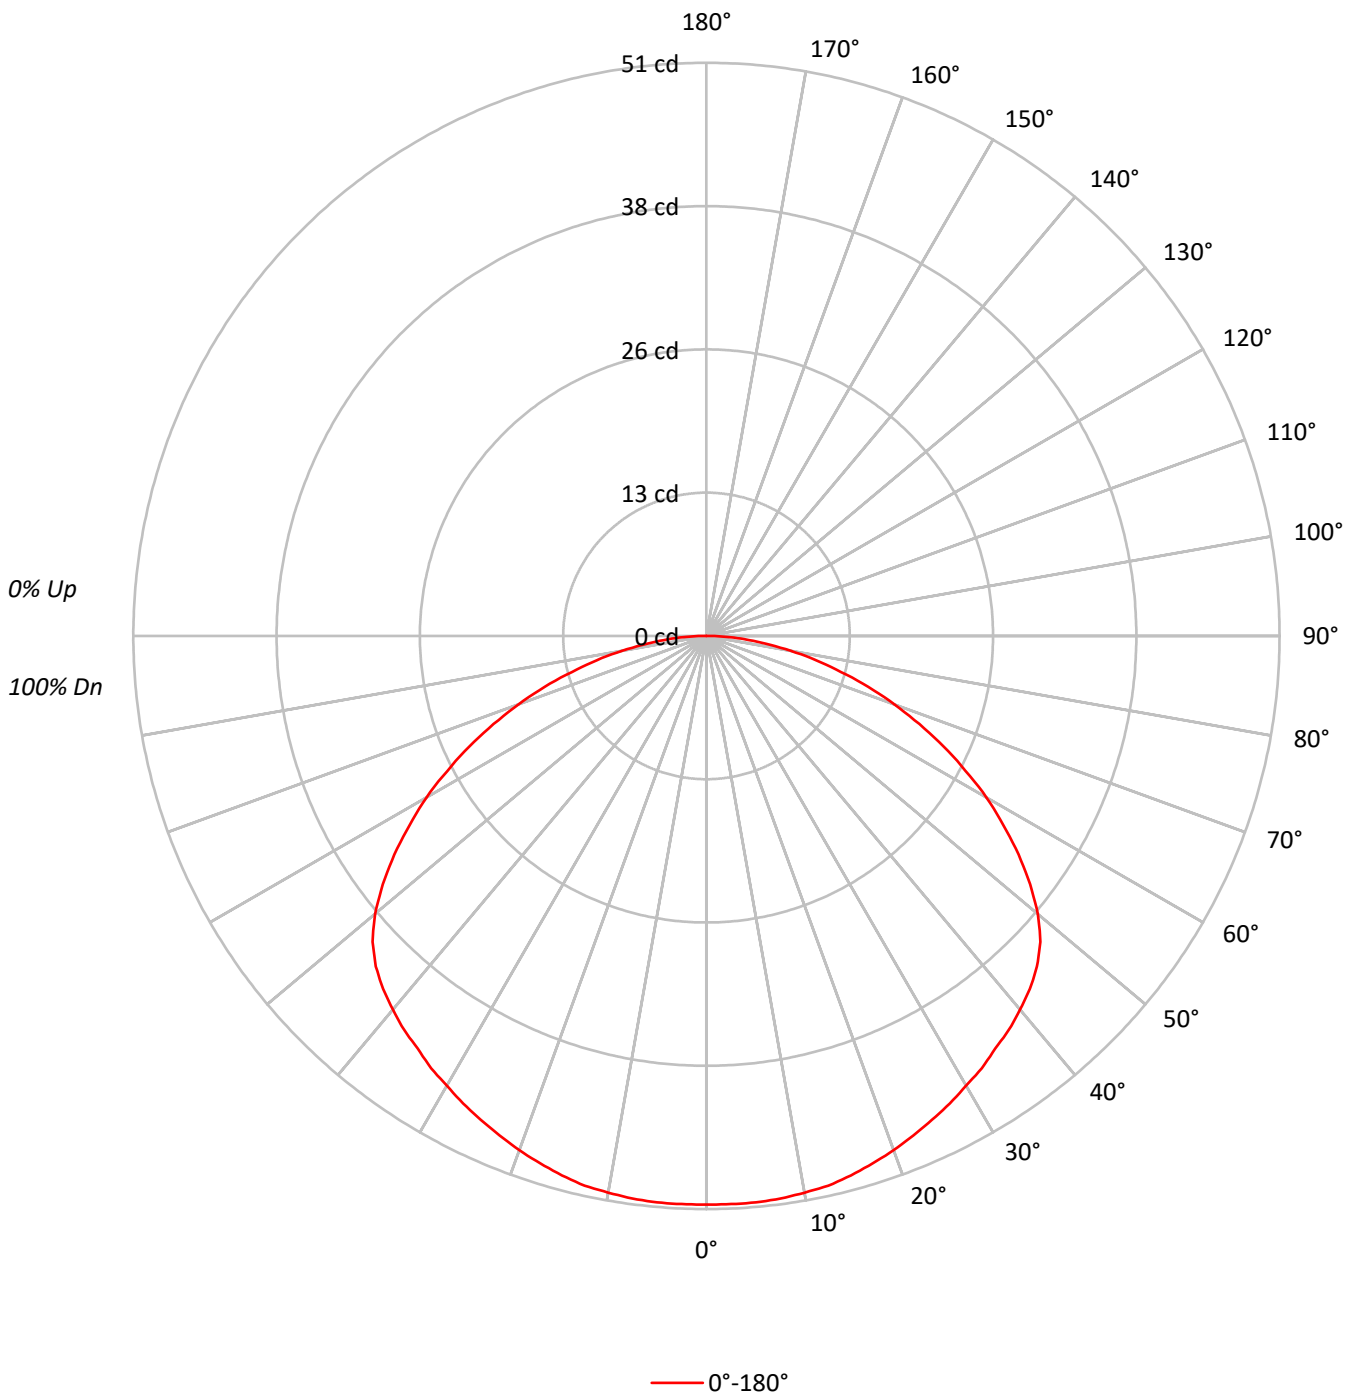



TEST NUMBER: P865654

CATALOG NUMBER: PRLX-2002-S-935-05L-G-U-S-X-X-GREY-X

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10	0		
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50	30	10	0
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102	102	102	100
1	108	103	99	95	105	101	97	93	97	93	90		93	90	87		89	87	85	83
2	98	89	82	76	95	87	81	75	84	78	73		80	76	72		77	73	70	68
3	89	78	69	62	86	76	68	62	73	66	61		70	65	60		68	63	59	56
4	81	68	59	52	79	67	59	52	65	57	51		62	56	50		60	54	50	47
5	74	61	51	45	72	60	51	44	57	50	44		55	49	43		54	48	43	41
6	68	54	45	39	66	54	45	38	52	44	38		50	43	38		48	42	37	35
7	63	49	40	34	61	48	40	34	47	39	33		45	38	33		44	38	33	31
8	59	45	36	30	57	44	36	30	43	35	30		41	34	29		40	34	29	27
9	55	41	32	27	53	40	32	27	39	32	26		38	31	26		37	31	26	24
10	51	38	29	24	50	37	29	24	36	29	24		35	28	24		34	28	24	22

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	950
5°	954
10°	959
15°	967
20°	974
25°	984
30°	1002
35°	1027
40°	1064
45°	1105
50°	1125
55°	1110
60°	1082
65°	1036
70°	978
75°	900
80°	822
85°	733

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 50°
 Luminance: 1125 cd/sqm

TEST NUMBER: P865654

CATALOG NUMBER: PRLX-2002-S-935-05L-G-U-S-X-X-GREY-X

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	4.8	2.8
10°-20°	14.0	8.2
20°-30°	21.9	12.8
30°-40°	28.1	16.4
40°-50°	32.0	18.7
50°-60°	30.2	17.6
60°-70°	23.0	13.4
70°-80°	13.2	7.7
80°-90°	3.9	2.3
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	40.8	23.8
0°-40°	69.0	40.2
0°-60°	131.2	76.6
0°-90°	171.3	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	171.3	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	51	
5°	51	5
15°	50	14
25°	48	22
35°	45	28
45°	42	32
55°	34	30
65°	23	23
75°	12	13
85°	3	4
90°	0	

TEST NUMBER: P865654

CATALOG NUMBER: PRLX-2002-S-935-05L-G-U-S-X-X-GREY-X

CANDELA DISTRIBUTION (FULL):

	0°
0°	50.6
2.5°	50.6
5°	50.6
7.5°	50.5
10°	50.3
12.5°	50.1
15°	49.7
17.5°	49.2
20°	48.7
22.5°	48.1
25°	47.5
27.5°	46.9
30°	46.2
32.5°	45.6
35°	44.8
37.5°	44.2
40°	43.4
42.5°	42.6
45°	41.6
47.5°	40.3
50°	38.5
52.5°	36.3
55°	33.9
57.5°	31.3
60°	28.8
62.5°	26.0
65°	23.3
67.5°	20.5
70°	17.8
72.5°	15.1
75°	12.4
77.5°	10.0
80°	7.6
82.5°	5.3
85°	3.4
87.5°	1.8
90°	0.0



TEST NUMBER: P865654
 CATALOG NUMBER: PRLX-2002-S-935-05L-G-U-S-X-X-GREY-X

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.76	14.45	13.12	14.77	15.08	12.76	14.45	13.12	14.77	15.08
	3H	14.56	16.10	14.94	16.43	16.79	14.56	16.10	14.94	16.43	16.79
	4H	15.24	16.69	15.63	17.03	17.41	15.24	16.69	15.63	17.03	17.41
	6H	15.74	17.09	16.15	17.45	17.84	15.74	17.09	16.15	17.45	17.84
	8H	15.91	17.20	16.33	17.59	17.98	15.91	17.20	16.33	17.59	17.98
	12H	16.03	17.26	16.45	17.64	18.07	16.03	17.26	16.45	17.64	18.07
4H	2H	13.40	14.86	13.80	15.20	15.58	13.40	14.86	13.80	15.20	15.58
	3H	15.43	16.65	15.84	17.05	17.45	15.43	16.65	15.84	17.05	17.45
	4H	16.23	17.34	16.66	17.75	18.18	16.23	17.34	16.66	17.75	18.18
	6H	16.87	17.84	17.32	18.28	18.73	16.87	17.84	17.32	18.28	18.73
	8H	17.08	17.99	17.54	18.43	18.90	17.08	17.99	17.54	18.43	18.90
	12H	17.25	18.07	17.73	18.54	19.01	17.25	18.07	17.73	18.54	19.01
8H	4H	16.55	17.46	17.01	17.90	18.37	16.55	17.46	17.01	17.90	18.37
	6H	17.32	18.08	17.81	18.56	19.04	17.32	18.08	17.81	18.56	19.04
	8H	17.61	18.29	18.11	18.79	19.28	17.61	18.29	18.11	18.79	19.28
	12H	17.85	18.45	18.35	18.94	19.50	17.85	18.45	18.35	18.94	19.50
12H	4H	16.59	17.41	17.07	17.89	18.36	16.59	17.41	17.07	17.89	18.36
	6H	17.38	18.06	17.89	18.57	19.05	17.38	18.06	17.89	18.57	19.05
	8H	17.73	18.33	18.23	18.82	19.38	17.73	18.33	18.23	18.82	19.38