

Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P865673

Luminaire Tested: PRLX-2002-S-935-15L-L-U-S-X-X-BRSS-X

Issue Date: 8/20/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P865673  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2304-993-20)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 8/20/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: Prenalux  
Catalog Number: PRLX-2002-S-935-15L-L-U-S-X-X-BRSS-X  
Description: PRENTALUX 3D PRINTED PENDANT LED LUMINAIRE, SMALL LIGHT ENGINE, FLAT LENS, TRUNCATED DOME WITH BRASS INTERIOR SHADE.  
LIGHT LEVEL 3  
Light Source: 3500K CCT, 90 CRI LEDS  
Ballast/Driver: -


**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 1230.3 lumens  
Efficiency: N/A  
Efficacy: 78.9 lumens/watt  
Spacing Criteria (0/90/45): 1.16 / 1.16 / 1.27  
Luminous Opening: Circular (Dia: 0.85' x H: 0')  
CIE Type: Direct  
  
Input Watts (W): 15.6  
Input Voltage (V): 120  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: 0.333 HR  
Operation Time: 3 HR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P865673

CATALOG NUMBER: PRLX-2002-S-935-15L-L-U-S-X-X-BRSS-X

### Luminous Intensity Polar Plot

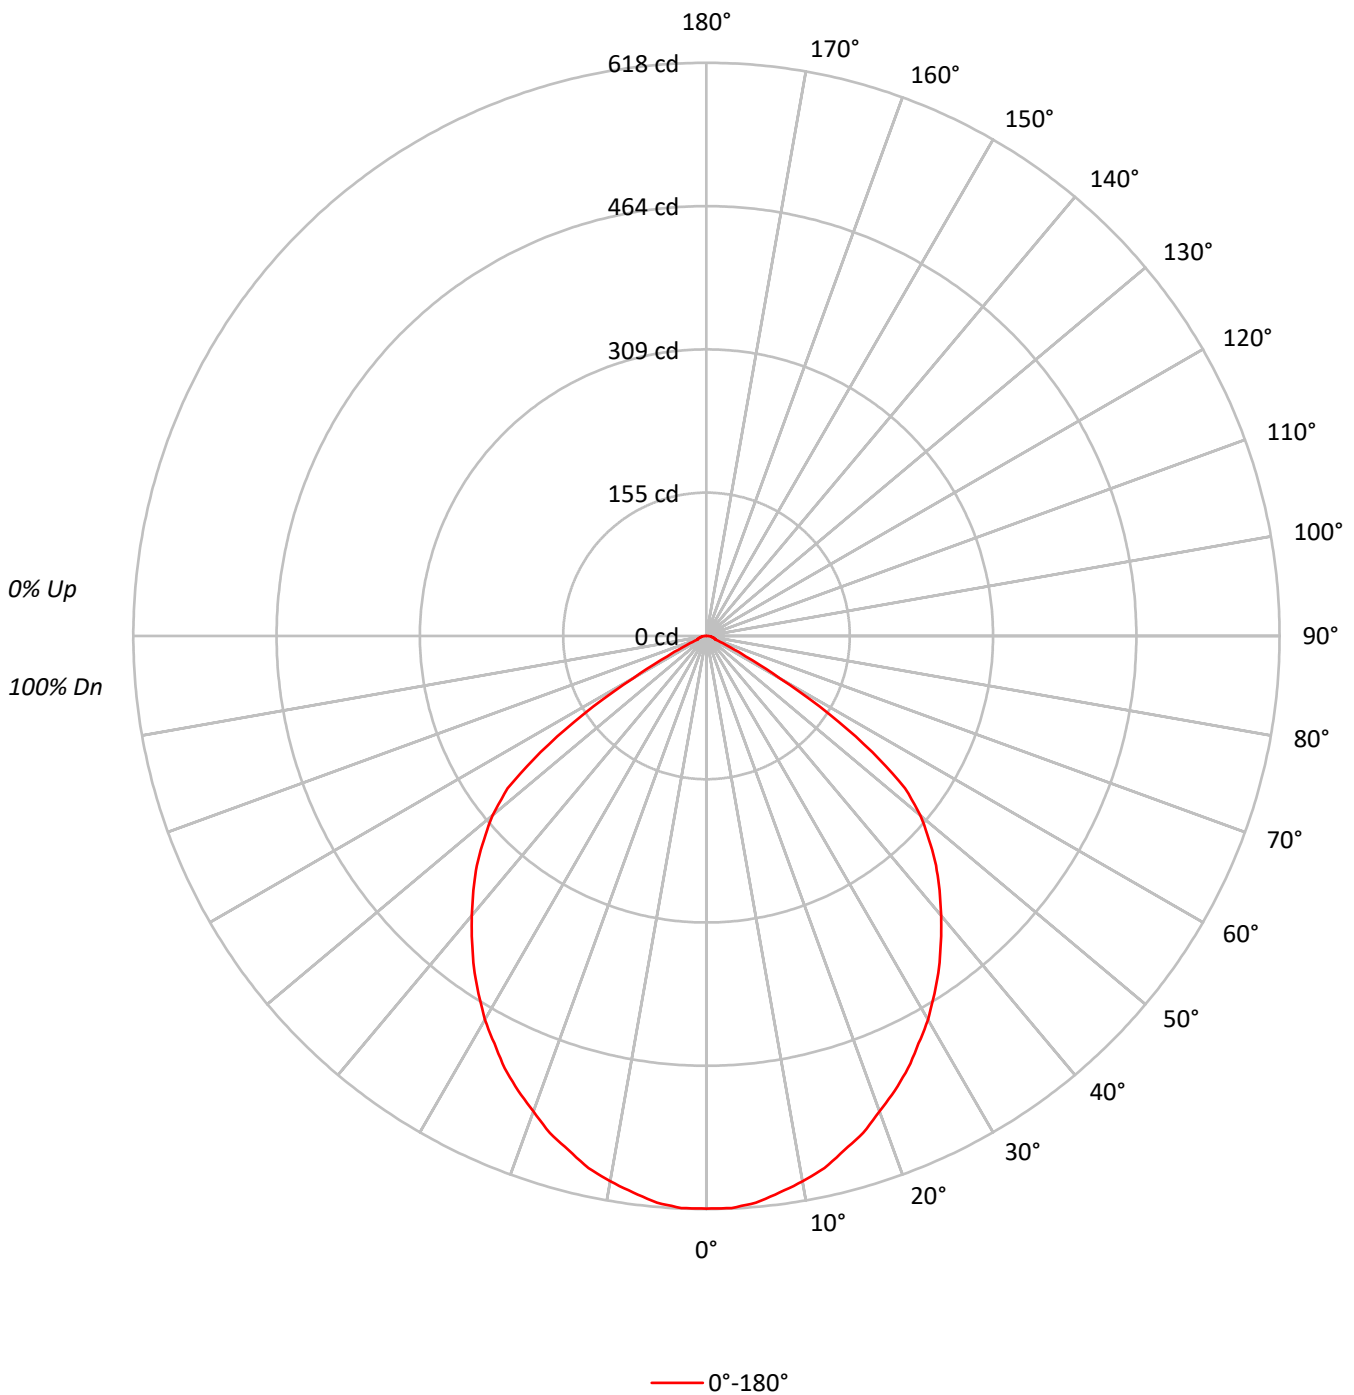



TEST NUMBER: P865673

CATALOG NUMBER: PRLX-2002-S-935-15L-L-U-S-X-X-BRSS-X

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	111	108	105	102	109	106	103	100	102	99	97	98	96	94	94	93	91	89
2	104	97	92	87	101	95	90	86	92	88	84	89	85	82	86	83	80	79
3	96	87	81	75	94	86	80	75	83	78	73	80	76	72	78	74	71	69
4	89	79	71	66	87	77	70	65	75	69	64	73	68	63	71	66	63	61
5	82	71	63	58	80	70	63	57	68	62	57	66	61	56	65	60	56	54
6	76	65	57	51	75	64	56	51	62	55	50	60	55	50	59	54	50	48
7	71	59	51	46	70	58	51	46	57	50	45	55	49	45	54	49	45	43
8	66	54	46	41	65	53	46	41	52	46	41	51	45	41	50	44	40	39
9	62	50	42	37	61	49	42	37	48	42	37	47	41	37	46	41	37	35
10	58	46	39	34	57	46	39	34	45	38	34	44	38	34	43	37	34	32

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	11599
5°	11566
10°	11389
15°	11164
20°	10906
25°	10662
30°	10361
35°	10021
40°	9652
45°	9300
50°	8805
55°	7156
60°	3415
65°	1085
70°	522
75°	588
80°	584
85°	884

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 9300 cd/sqm

TEST NUMBER: P865673

CATALOG NUMBER: PRLX-2002-S-935-15L-L-U-S-X-X-BRSS-X

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	58.0	4.7
10°-20°	161.9	13.2
20°-30°	236.5	19.2
30°-40°	273.1	22.2
40°-50°	269.1	21.9
50°-60°	187.0	15.2
60°-70°	32.5	2.6
70°-80°	8.4	0.7
80°-90°	3.7	0.3
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	456.4	37.1
0°-40°	729.5	59.3
0°-60°	1185.6	96.4
0°-90°	1230.3	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1230.3	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	618	
5°	613	58
15°	574	162
25°	514	237
35°	437	273
45°	350	269
55°	218	187
65°	24	33
75°	8	8
85°	4	4
90°	0	

TEST NUMBER: P865673

CATALOG NUMBER: PRLX-2002-S-935-15L-L-U-S-X-X-BRSS-X

**CANDELA DISTRIBUTION (FULL):**

0°	
0°	617.5
2.5°	617.5
5°	613.4
7.5°	605.3
10°	597.1
12.5°	587.6
15°	574.1
17.5°	561.9
20°	545.6
22.5°	530.6
25°	514.4
27.5°	495.4
30°	477.7
32.5°	457.4
35°	437.0
37.5°	415.3
40°	393.6
42.5°	371.9
45°	350.1
47.5°	325.7
50°	301.3
52.5°	270.1
55°	218.5
57.5°	157.4
60°	90.9
62.5°	47.5
65°	24.4
67.5°	10.9
70°	9.5
72.5°	9.5
75°	8.1
77.5°	6.8
80°	5.4
82.5°	5.4
85°	4.1
87.5°	1.4
90°	0.0



TEST NUMBER: P865673

CATALOG NUMBER: PRLX-2002-S-935-15L-L-U-S-X-X-BRSS-X

**CIE UGR TABLE:**

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	17.30	18.72	17.67	19.04	19.35	17.30	18.72	17.67	19.04	19.35
	3H	17.21	18.46	17.59	18.79	19.16	17.21	18.46	17.59	18.79	19.16
	4H	17.17	18.33	17.57	18.68	19.06	17.17	18.33	17.57	18.68	19.06
	6H	17.12	18.19	17.54	18.56	18.95	17.12	18.19	17.54	18.56	18.95
	8H	17.10	18.11	17.53	18.50	18.90	17.10	18.11	17.53	18.50	18.90
	12H	17.08	18.05	17.51	18.43	18.86	17.08	18.05	17.51	18.43	18.86
4H	2H	17.16	18.33	17.57	18.68	19.06	17.16	18.33	17.57	18.68	19.06
	3H	17.09	18.03	17.50	18.43	18.83	17.09	18.03	17.50	18.43	18.83
	4H	17.05	17.88	17.48	18.30	18.74	17.05	17.88	17.48	18.30	18.74
	6H	17.02	17.73	17.48	18.18	18.65	17.02	17.73	17.48	18.18	18.65
	8H	16.99	17.66	17.46	18.11	18.58	16.99	17.66	17.46	18.11	18.58
	12H	16.98	17.58	17.47	18.06	18.54	16.98	17.58	17.47	18.06	18.54
8H	4H	16.94	17.61	17.41	18.06	18.53	16.94	17.61	17.41	18.06	18.53
	6H	16.90	17.45	17.40	17.95	18.43	16.90	17.45	17.40	17.95	18.43
	8H	16.88	17.39	17.40	17.90	18.39	16.88	17.39	17.40	17.90	18.39
	12H	16.90	17.35	17.41	17.84	18.41	16.90	17.35	17.41	17.84	18.41
12H	4H	16.90	17.50	17.38	17.98	18.45	16.90	17.50	17.38	17.98	18.45
	6H	16.84	17.35	17.36	17.86	18.35	16.84	17.35	17.36	17.86	18.35
	8H	16.86	17.31	17.37	17.80	18.37	16.86	17.31	17.37	17.80	18.37