

Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P867256

Luminaire Tested: PRLX-2004-L-930-133L-G-X-X-BLAK-X

Issue Date: 8/20/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P867256  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2304-993-75)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 8/20/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: Prenalux  
Catalog Number: PRLX-2004-L-930-133L-G-X-X-BLAK-X  
Description: PRENTALUX 3D PRINTED PENDANT LED LUMINAIRE, LARGE LIGHT ENGINE, GLOBE LENS,  
BELL WITH BLACK INTERIOR SHADE.  
LIGHT LEVEL 8  
Light Source: 3000K CCT, 90 CRI LEDS  
Ballast/Driver: -


**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 1721.6 lumens  
Efficiency: N/A  
Efficacy: 15.4 lumens/watt  
Spacing Criteria (0/90/45): 1.24 / 1.24 / 1.19  
Luminous Opening: Circular (Dia: 1.67' x H: 0')  
CIE Type: Direct  
  
Input Watts (W): 111.8  
Input Voltage (V): 120  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: 0.333 HR  
Operation Time: 3 HR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P867256

CATALOG NUMBER: PRLX-2004-L-930-133L-G-X-X-BLAK-X

### Luminous Intensity Polar Plot

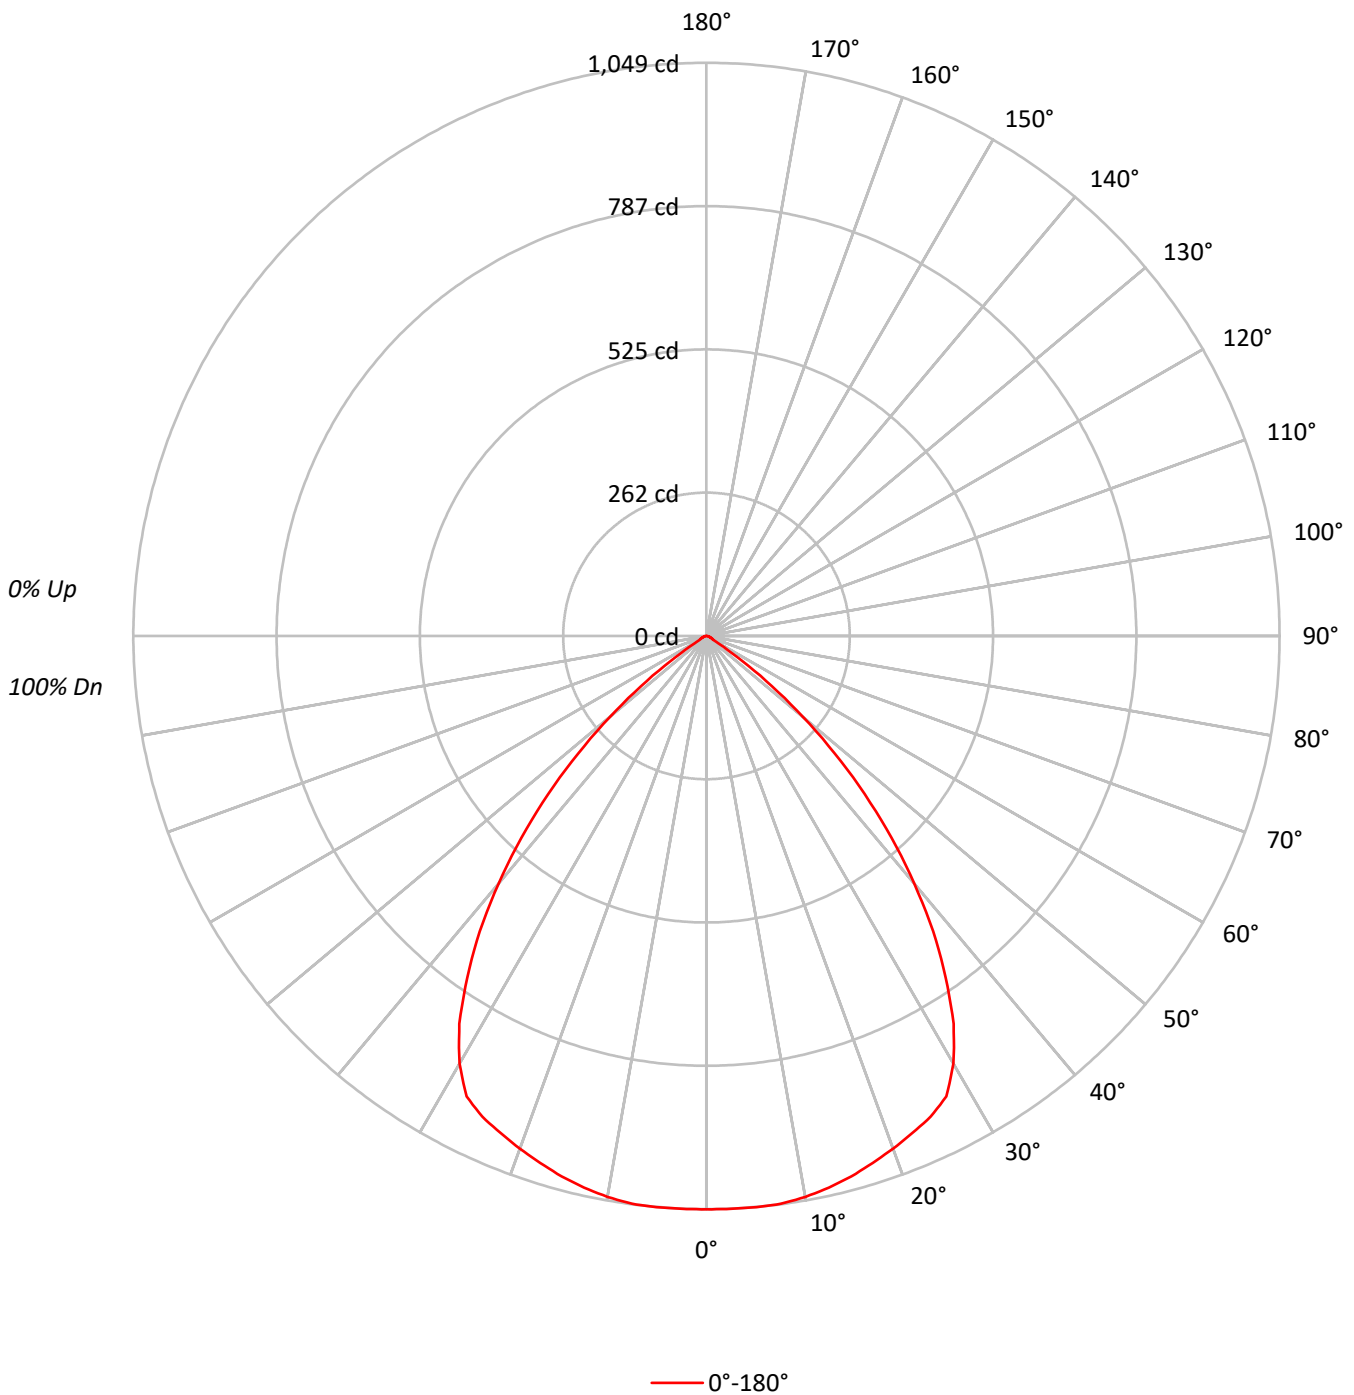



TEST NUMBER: P867256

CATALOG NUMBER: PRLX-2004-L-930-133L-G-X-X-BLAK-X

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20			
RC	80				70				50				30				10	0		
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50	30	10	0
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102	102	102	100
1	112	109	106	104	110	107	105	102	103	101	99		99	98	96		96	94	93	91
2	106	100	95	91	103	98	94	90	95	91	88		92	89	86		89	87	84	83
3	99	91	86	81	97	90	85	80	87	83	79		85	81	78		82	79	76	75
4	93	84	77	72	91	83	76	72	80	75	71		78	74	70		76	72	69	67
5	87	77	70	65	85	76	69	65	74	68	64		72	67	63		71	66	63	61
6	81	71	64	59	80	70	63	58	68	62	58		67	62	58		65	61	57	55
7	76	65	58	53	75	65	58	53	63	57	53		62	56	52		61	56	52	51
8	72	60	53	49	70	60	53	48	59	53	48		58	52	48		56	51	48	46
9	67	56	49	45	66	56	49	44	55	48	44		54	48	44		53	48	44	42
10	64	52	45	41	62	52	45	41	51	45	41		50	45	41		49	44	41	39

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	5178
5°	5197
10°	5223
15°	5230
20°	5244
25°	5286
30°	5151
35°	4598
40°	3810
45°	2857
50°	1770
55°	685
60°	148
65°	121
70°	100
75°	88
80°	99
85°	68

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 2857 cd/sqm

TEST NUMBER: P867256

CATALOG NUMBER: PRLX-2004-L-930-133L-G-X-X-BLAK-X

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	100.0	5.8
10°-20°	289.2	16.8
20°-30°	445.2	25.9
30°-40°	472.7	27.5
40°-50°	313.8	18.2
50°-60°	83.3	4.8
60°-70°	10.7	0.6
70°-80°	5.0	0.3
80°-90°	1.8	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	834.4	48.5
0°-40°	1307.2	75.9
0°-60°	1704.2	99.0
0°-90°	1721.6	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1721.6	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	1049	
5°	1049	100
15°	1024	289
25°	971	445
35°	763	473
45°	409	314
55°	80	83
65°	10	11
75°	5	5
85°	1	2
90°	0	

TEST NUMBER: P867256

CATALOG NUMBER: PRLX-2004-L-930-133L-G-X-X-BLAK-X

**CANDELA DISTRIBUTION (FULL):**

0°	
0°	1049.4
2.5°	1049.4
5°	1049.4
7.5°	1048.3
10°	1042.5
12.5°	1034.4
15°	1024.0
17.5°	1011.4
20°	998.7
22.5°	984.8
25°	971.0
27.5°	950.2
30°	904.1
32.5°	841.8
35°	763.4
37.5°	681.5
40°	591.6
42.5°	501.6
45°	409.4
47.5°	318.3
50°	230.6
52.5°	151.1
55°	79.6
57.5°	26.5
60°	15.0
62.5°	12.7
65°	10.4
67.5°	9.2
70°	6.9
72.5°	5.8
75°	4.6
77.5°	3.5
80°	3.5
82.5°	2.3
85°	1.2
87.5°	1.2
90°	0.0



TEST NUMBER: P867256

CATALOG NUMBER: PRLX-2004-L-930-133L-G-X-X-BLAK-X

**CIE UGR TABLE:**

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	0.00	0.58	0.00	0.90	1.21	0.00	0.58	0.00	0.90	1.21
	3H	0.00	0.90	0.23	1.23	1.60	0.00	0.90	0.23	1.23	1.60
	4H	0.01	0.98	0.41	1.33	1.72	0.01	0.98	0.41	1.33	1.72
	6H	0.14	1.03	0.56	1.40	1.80	0.14	1.03	0.56	1.40	1.80
	8H	0.20	1.04	0.63	1.43	1.83	0.20	1.04	0.63	1.43	1.83
	12H	0.21	1.01	0.64	1.39	1.82	0.21	1.01	0.64	1.39	1.82
4H	2H	0.00	0.39	0.00	0.74	1.12	0.00	0.39	0.00	0.74	1.12
	3H	0.03	0.81	0.44	1.22	1.62	0.03	0.81	0.44	1.22	1.62
	4H	0.26	0.95	0.70	1.38	1.82	0.26	0.95	0.70	1.38	1.82
	6H	0.51	1.10	0.97	1.55	2.02	0.51	1.10	0.97	1.55	2.02
	8H	0.60	1.16	1.08	1.61	2.08	0.60	1.16	1.08	1.61	2.08
	12H	0.64	1.13	1.13	1.62	2.09	0.64	1.13	1.13	1.62	2.09
8H	4H	0.27	0.83	0.74	1.28	1.75	0.27	0.83	0.74	1.28	1.75
	6H	0.62	1.08	1.13	1.58	2.06	0.62	1.08	1.13	1.58	2.06
	8H	0.78	1.19	1.30	1.71	2.20	0.78	1.19	1.30	1.71	2.20
	12H	0.87	1.23	1.39	1.73	2.30	0.87	1.23	1.39	1.73	2.30
12H	4H	0.25	0.74	0.74	1.23	1.70	0.25	0.74	0.74	1.23	1.70
	6H	0.62	1.03	1.15	1.55	2.04	0.62	1.03	1.15	1.55	2.04
	8H	0.82	1.18	1.34	1.68	2.25	0.82	1.18	1.34	1.68	2.25