

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P867281

Luminaire Tested: PRLX-2004-L-930-48L-G-X-X-BRSS-X

Issue Date: 8/20/2024

Test Information

Test Method: LM-79-2019
Report Number: P867281
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2304-993-73)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 8/20/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: Prenalux
Catalog Number: PRLX-2004-L-930-48L-G-X-X-BRSS-X
Description: PRENTALUX 3D PRINTED PENDANT LED LUMINAIRE, LARGE LIGHT ENGINE, GLOBE LENS, BELL WITH BRASS INTERIOR SHADE.
LIGHT LEVEL 3
Light Source: 3000K CCT, 90 CRI LEDS
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 950.9 lumens
Efficiency: N/A
Efficacy: 25.4 lumens/watt
Spacing Criteria (0/90/45): 1.17 / 1.17 / 1.17
Luminous Opening: Circular (Dia: 1.67' x H: 0')
CIE Type: Direct

Input Watts (W): 37.5
Input Voltage (V): 120
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: 0.5 HR
Operation Time: 3 HR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P867281

CATALOG NUMBER: PRLX-2004-L-930-48L-G-X-X-BRSS-X

Luminous Intensity Polar Plot

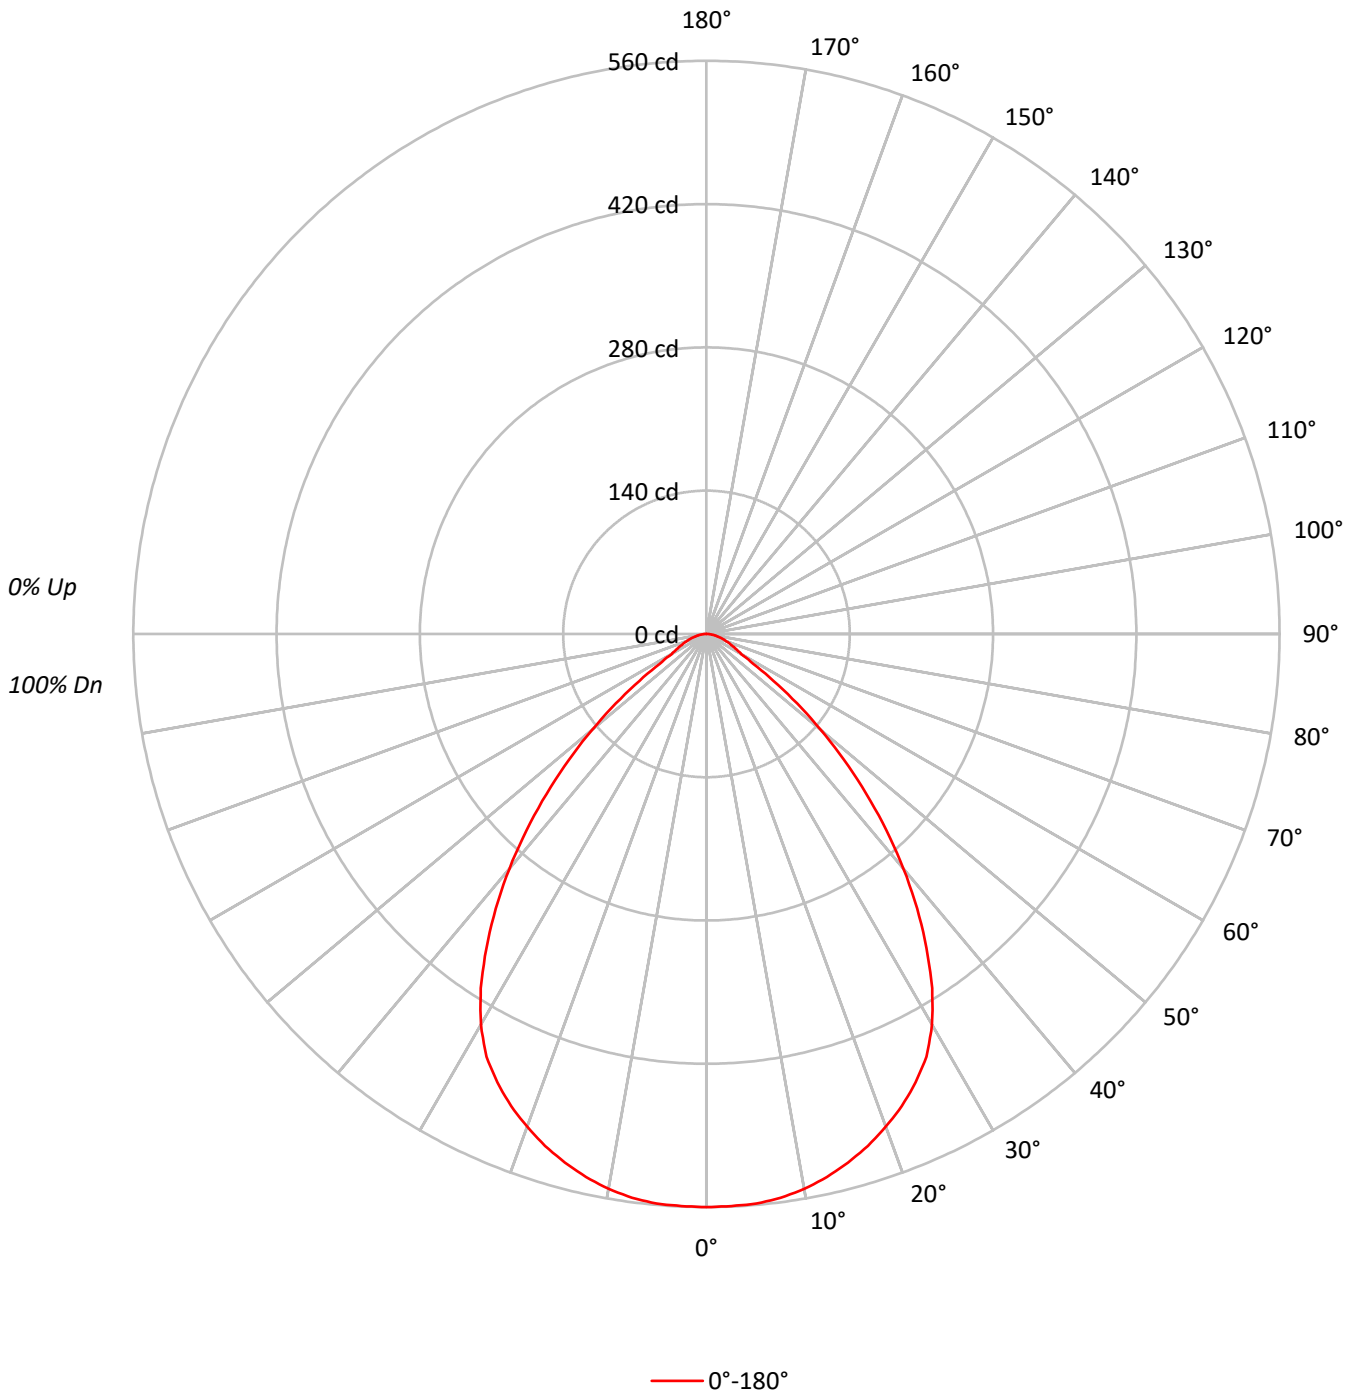



TEST NUMBER: P867281

CATALOG NUMBER: PRLX-2004-L-930-48L-G-X-X-BRSS-X

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	112	108	105	102	109	106	103	101	102	100	97	98	96	95	95	93	92	90
2	104	98	93	89	102	96	92	88	93	89	86	90	87	84	87	84	82	80
3	97	89	83	78	95	88	82	77	85	80	76	82	78	74	80	76	73	71
4	91	81	74	69	89	80	73	68	78	72	67	75	70	67	73	69	66	64
5	85	74	67	61	83	73	66	61	71	65	60	69	64	60	68	63	59	57
6	79	68	61	55	77	67	60	55	65	59	55	64	58	54	62	58	54	52
7	74	63	55	50	72	62	55	50	60	54	49	59	53	49	58	53	49	47
8	69	58	50	45	68	57	50	45	56	50	45	55	49	45	54	49	45	43
9	65	54	46	42	64	53	46	42	52	46	41	51	45	41	50	45	41	39
10	62	50	43	38	60	49	43	38	48	42	38	48	42	38	47	42	38	36

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	2763
5°	2767
10°	2759
15°	2731
20°	2689
25°	2632
30°	2511
35°	2258
40°	1930
45°	1542
50°	1119
55°	687
60°	388
65°	330
70°	293
75°	265
80°	242
85°	215

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 1542 cd/sqm

TEST NUMBER: P867281

CATALOG NUMBER: PRLX-2004-L-930-48L-G-X-X-BRSS-X

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	53.1	5.6
10°-20°	150.7	15.8
20°-30°	221.8	23.3
30°-40°	232.8	24.5
40°-50°	169.9	17.9
50°-60°	74.9	7.9
60°-70°	28.6	3.0
70°-80°	14.8	1.6
80°-90°	4.4	0.5
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	425.5	44.7
0°-40°	658.4	69.2
0°-60°	903.2	95.0
0°-90°	950.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	950.9	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	560	
5°	559	53
15°	535	151
25°	484	222
35°	375	233
45°	221	170
55°	80	75
65°	28	29
75°	14	15
85°	4	4
90°	0	

TEST NUMBER: P867281

CATALOG NUMBER: PRLX-2004-L-930-48L-G-X-X-BRSS-X

CANDELA DISTRIBUTION (FULL):

	0°
0°	560.0
2.5°	559.5
5°	558.7
7.5°	555.7
10°	550.7
12.5°	543.5
15°	534.6
17.5°	524.5
20°	512.2
22.5°	499.1
25°	483.5
27.5°	465.7
30°	440.8
32.5°	410.4
35°	374.9
37.5°	338.1
40°	299.6
42.5°	260.3
45°	221.0
47.5°	182.1
50°	145.8
52.5°	111.6
55°	79.9
57.5°	54.1
60°	39.3
62.5°	33.4
65°	28.3
67.5°	24.1
70°	20.3
72.5°	16.9
75°	13.9
77.5°	11.0
80°	8.5
82.5°	6.3
85°	3.8
87.5°	1.7
90°	0.0



TEST NUMBER: P867281
 CATALOG NUMBER: PRLX-2004-L-930-48L-G-X-X-BRSS-X

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	6.36	7.67	6.73	7.98	8.29	6.36	7.67	6.73	7.98	8.29
	3H	7.25	8.40	7.63	8.73	9.09	7.25	8.40	7.63	8.73	9.09
	4H	7.60	8.67	8.00	9.02	9.40	7.60	8.67	8.00	9.02	9.40
	6H	7.86	8.84	8.28	9.21	9.61	7.86	8.84	8.28	9.21	9.61
	8H	7.95	8.88	8.38	9.27	9.68	7.95	8.88	8.38	9.27	9.68
	12H	8.01	8.90	8.44	9.28	9.71	8.01	8.90	8.44	9.28	9.71
4H	2H	6.59	7.66	6.99	8.01	8.39	6.59	7.66	6.99	8.01	8.39
	3H	7.69	8.56	8.10	8.97	9.37	7.69	8.56	8.10	8.97	9.37
	4H	8.16	8.93	8.59	9.35	9.80	8.16	8.93	8.59	9.35	9.80
	6H	8.54	9.21	9.01	9.66	10.13	8.54	9.21	9.01	9.66	10.13
	8H	8.68	9.31	9.15	9.75	10.22	8.68	9.31	9.15	9.75	10.22
	12H	8.78	9.33	9.26	9.81	10.29	8.78	9.33	9.26	9.81	10.29
8H	4H	8.29	8.92	8.76	9.36	9.84	8.29	8.92	8.76	9.36	9.84
	6H	8.78	9.29	9.28	9.79	10.27	8.78	9.29	9.28	9.79	10.27
	8H	8.99	9.45	9.51	9.96	10.46	8.99	9.45	9.51	9.96	10.46
	12H	9.15	9.56	9.67	10.06	10.63	9.15	9.56	9.67	10.06	10.63
12H	4H	8.29	8.84	8.77	9.32	9.80	8.29	8.84	8.77	9.32	9.80
	6H	8.80	9.26	9.32	9.77	10.27	8.80	9.26	9.32	9.77	10.27
	8H	9.05	9.46	9.57	9.96	10.53	9.05	9.46	9.57	9.96	10.53