

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P867290

Luminaire Tested: PRLX-2004-L-930-67L-G-X-X-GREY-X

Issue Date: 8/20/2024

Test Information

Test Method: LM-79-2019
Report Number: P867290
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2304-993-74)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 8/20/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: Prenalux
Catalog Number: PRLX-2004-L-930-67L-G-X-X-GREY-X
Description: PRENATALUX 3D PRINTED PENDANT LED LUMINAIRE, LARGE LIGHT ENGINE, GLOBE LENS,
BELL WITH GRAY INTERIOR SHADE.
LIGHT LEVEL 4
Light Source: 3000K CCT, 90 CRI LEDS
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 1254.5 lumens
Efficiency: N/A
Efficacy: 24.9 lumens/watt
Spacing Criteria (0/90/45): 1.16 / 1.16 / 1.15
Luminous Opening: Circular (Dia: 1.67' x H: 0')
CIE Type: Direct

Input Watts (W): 50.4
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: 0.333 HR
Operation Time: 3 HR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P867290

CATALOG NUMBER: PRLX-2004-L-930-67L-G-X-X-GREY-X

Luminous Intensity Polar Plot

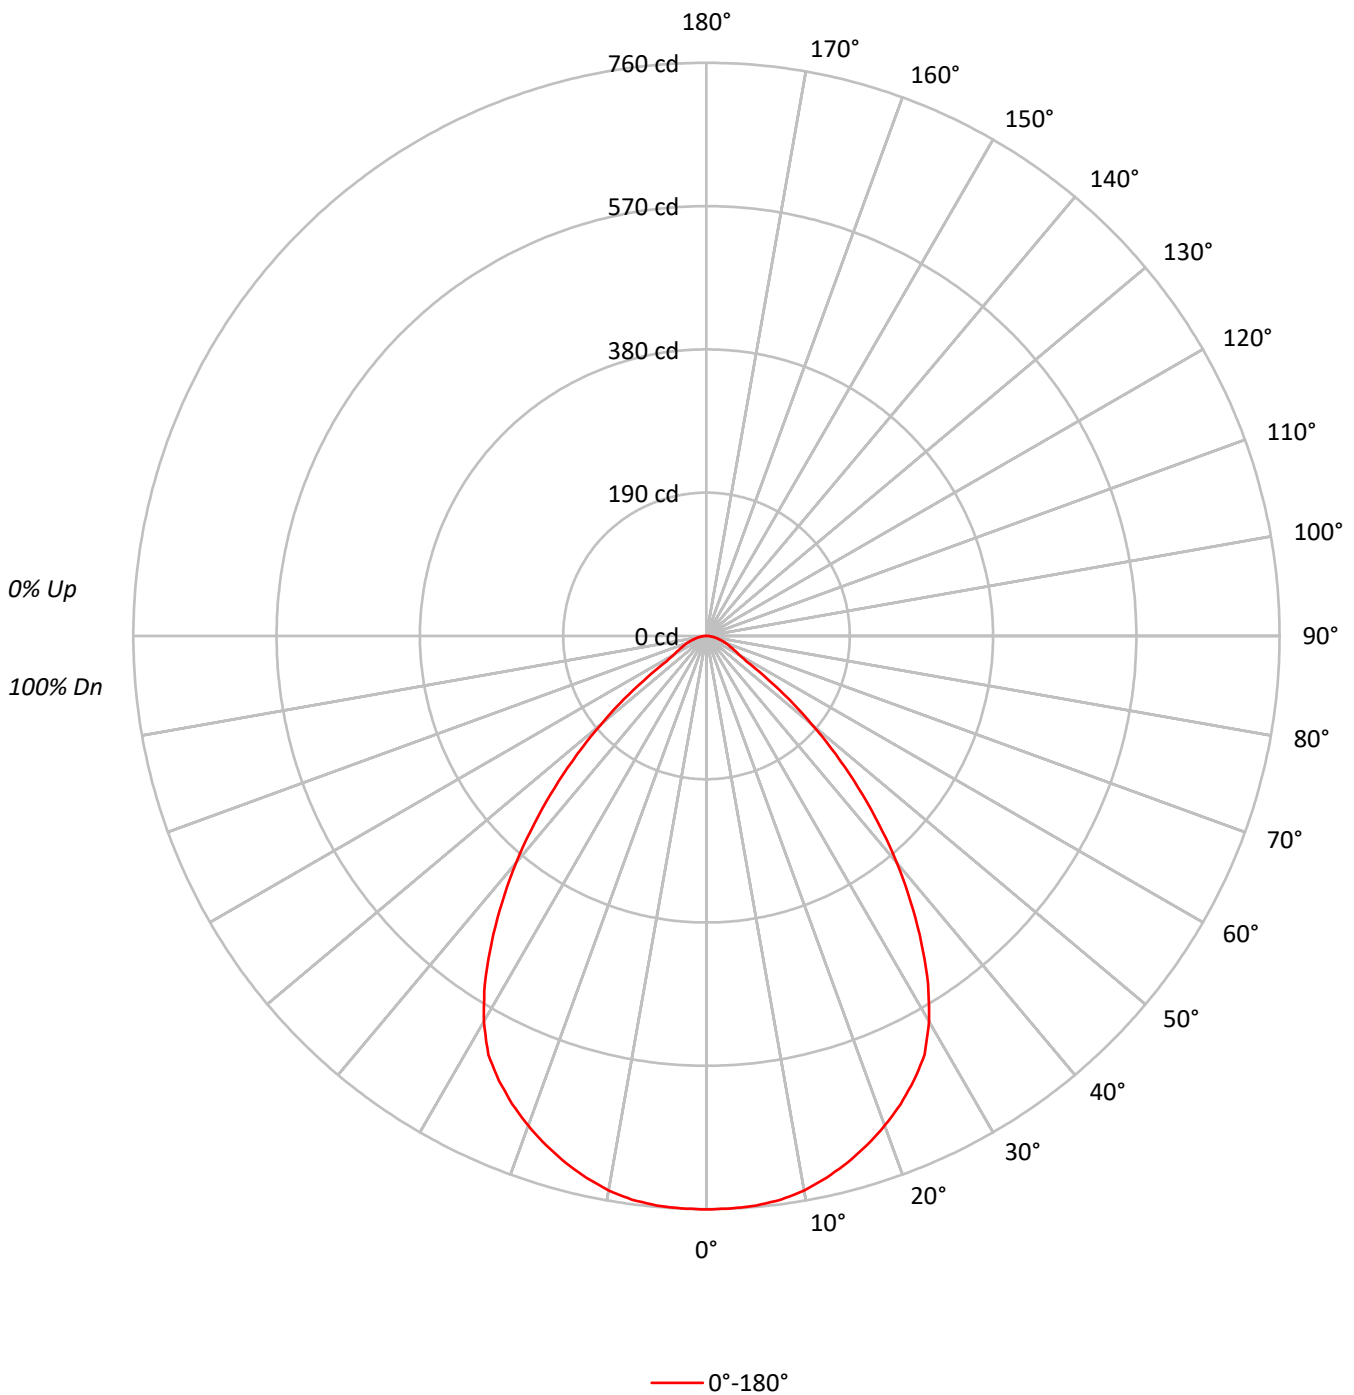



TEST NUMBER: P867290

CATALOG NUMBER: PRLX-2004-L-930-67L-G-X-X-GREY-X

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	112	108	105	102	109	106	103	101	102	100	98	98	96	95	95	93	92	90
2	104	98	93	89	102	96	92	88	93	89	86	90	87	84	87	85	82	80
3	97	89	83	78	95	88	82	77	85	80	76	82	78	75	80	77	74	72
4	91	81	74	69	89	80	74	69	78	72	68	76	71	67	74	70	66	64
5	85	75	67	62	83	73	67	62	72	66	61	70	64	60	68	63	60	58
6	79	68	61	56	78	68	61	56	66	60	55	64	59	55	63	58	54	53
7	74	63	56	51	73	62	55	50	61	55	50	60	54	50	58	53	49	48
8	70	58	51	46	68	58	51	46	56	50	46	55	50	45	54	49	45	44
9	66	54	47	42	64	54	47	42	53	46	42	52	46	42	51	45	42	40
10	62	50	43	39	61	50	43	39	49	43	39	48	42	39	47	42	38	37

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	3752
5°	3755
10°	3741
15°	3692
20°	3628
25°	3542
30°	3363
35°	2994
40°	2527
45°	1988
50°	1402
55°	817
60°	493
65°	425
70°	378
75°	336
80°	307
85°	289

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 1988 cd/sqm

TEST NUMBER: P867290

CATALOG NUMBER: PRLX-2004-L-930-67L-G-X-X-GREY-X

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	72.0	5.7
10°-20°	203.7	16.2
20°-30°	298.3	23.8
30°-40°	308.6	24.6
40°-50°	219.2	17.5
50°-60°	91.2	7.3
60°-70°	36.8	2.9
70°-80°	19.0	1.5
80°-90°	5.7	0.5
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	574.1	45.8
0°-40°	882.7	70.4
0°-60°	1193.1	95.1
0°-90°	1254.5	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1254.5	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	760	
5°	758	72
15°	723	204
25°	651	298
35°	497	309
45°	285	219
55°	95	91
65°	36	37
75°	18	19
85°	5	6
90°	0	

TEST NUMBER: P867290

CATALOG NUMBER: PRLX-2004-L-930-67L-G-X-X-GREY-X

CANDELA DISTRIBUTION (FULL):

0°	
0°	760.4
2.5°	759.8
5°	758.1
7.5°	754.1
10°	746.7
12.5°	735.9
15°	722.9
17.5°	708.1
20°	691.0
22.5°	672.2
25°	650.6
27.5°	626.2
30°	590.3
32.5°	547.1
35°	497.1
37.5°	445.3
40°	392.4
42.5°	338.4
45°	284.9
47.5°	232.6
50°	182.6
52.5°	137.6
55°	95.0
57.5°	63.1
60°	50.0
62.5°	43.2
65°	36.4
67.5°	31.3
70°	26.2
72.5°	21.6
75°	17.6
77.5°	14.2
80°	10.8
82.5°	8.0
85°	5.1
87.5°	2.3
90°	0.0

TEST NUMBER: P867290

CATALOG NUMBER: PRLX-2004-L-930-67L-G-X-X-GREY-X

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	6.52	7.81	6.89	8.12	8.44	6.52	7.81	6.89	8.12	8.44
	3H	7.60	8.73	7.98	9.06	9.43	7.60	8.73	7.98	9.06	9.43
	4H	7.99	9.05	8.39	9.40	9.78	7.99	9.05	8.39	9.40	9.78
	6H	8.29	9.26	8.71	9.63	10.03	8.29	9.26	8.71	9.63	10.03
	8H	8.40	9.32	8.83	9.71	10.11	8.40	9.32	8.83	9.71	10.11
	12H	8.47	9.34	8.90	9.73	10.16	8.47	9.34	8.90	9.73	10.16
4H	2H	6.83	7.89	7.24	8.24	8.62	6.83	7.89	7.24	8.24	8.62
	3H	8.12	8.98	8.53	9.39	9.79	8.12	8.98	8.53	9.39	9.79
	4H	8.63	9.40	9.07	9.82	10.26	8.63	9.40	9.07	9.82	10.26
	6H	9.06	9.72	9.52	10.16	10.63	9.06	9.72	9.52	10.16	10.63
	8H	9.20	9.82	9.67	10.27	10.74	9.20	9.82	9.67	10.27	10.74
	12H	9.31	9.86	9.80	10.34	10.82	9.31	9.86	9.80	10.34	10.82
8H	4H	8.79	9.40	9.26	9.85	10.32	8.79	9.40	9.26	9.85	10.32
	6H	9.32	9.82	9.82	10.32	10.80	9.32	9.82	9.82	10.32	10.80
	8H	9.54	9.99	10.06	10.51	11.00	9.54	9.99	10.06	10.51	11.00
	12H	9.72	10.13	10.24	10.62	11.19	9.72	10.13	10.24	10.62	11.19
12H	4H	8.78	9.33	9.27	9.81	10.28	8.78	9.33	9.27	9.81	10.28
	6H	9.34	9.79	9.86	10.31	10.80	9.34	9.79	9.86	10.31	10.80
	8H	9.61	10.01	10.12	10.51	11.08	9.61	10.01	10.12	10.51	11.08