

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P867298

Luminaire Tested: PRLX-2004-L-930-83L-G-X-X-GREY-X

Issue Date: 8/20/2024

Test Information

Test Method: LM-79-2019
Report Number: P867298
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2304-993-74)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 8/20/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: Prenalux
Catalog Number: PRLX-2004-L-930-83L-G-X-X-GREY-X
Description: PRENTALUX 3D PRINTED PENDANT LED LUMINAIRE, LARGE LIGHT ENGINE, GLOBE LENS,
BELL WITH GRAY INTERIOR SHADE.
LIGHT LEVEL 5
Light Source: 3000K CCT, 90 CRI LEDS
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 1576.9 lumens
Efficiency: N/A
Efficacy: 24.4 lumens/watt
Spacing Criteria (0/90/45): 1.16 / 1.16 / 1.15
Luminous Opening: Circular (Dia: 1.67' x H: 0')
CIE Type: Direct

Input Watts (W): 64.5
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: 0.333 HR
Operation Time: 3 HR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P867298

CATALOG NUMBER: PRLX-2004-L-930-83L-G-X-X-GREY-X

Luminous Intensity Polar Plot

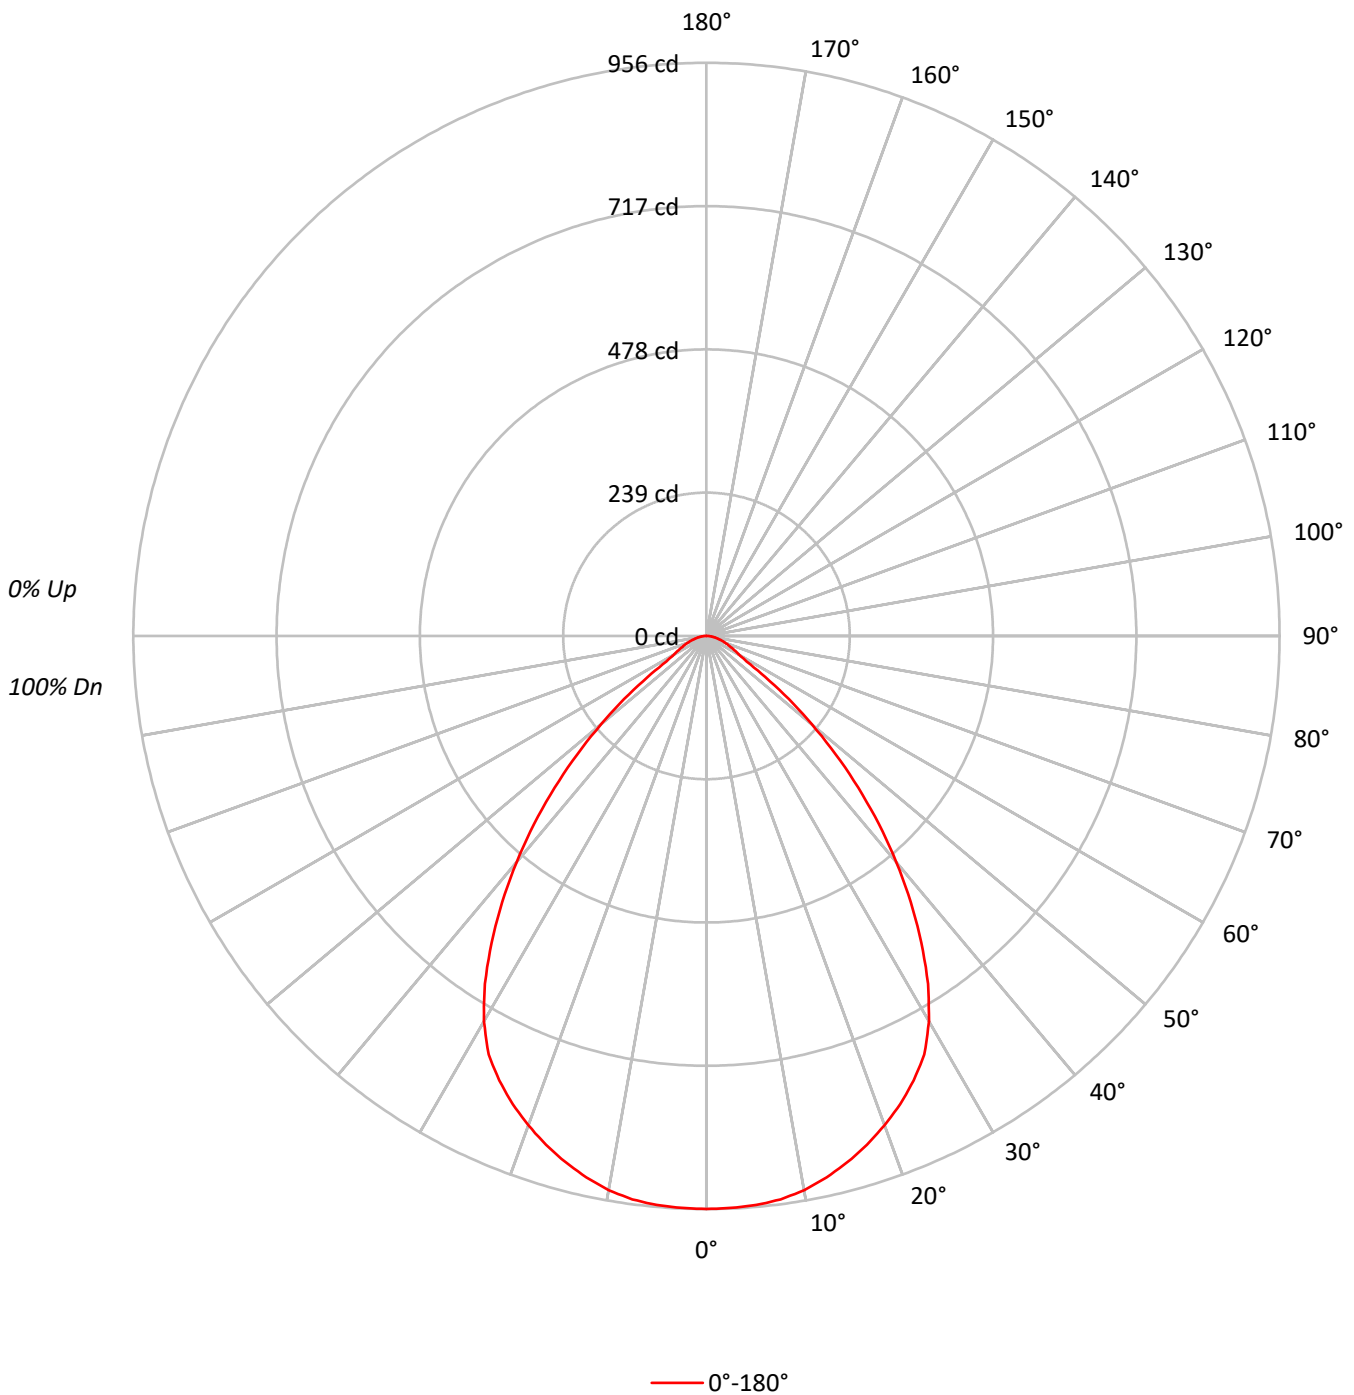



TEST NUMBER: P867298

CATALOG NUMBER: PRLX-2004-L-930-83L-G-X-X-GREY-X

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10	0		
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50	30	10	0
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102	102	102	100
1	112	108	105	102	109	106	103	101	102	100	98		98	96	95		95	93	92	90
2	104	98	93	89	102	96	92	88	93	89	86		90	87	84		87	85	82	80
3	97	89	83	78	95	88	82	77	85	80	76		82	78	75		80	77	74	72
4	91	81	74	69	89	80	74	69	78	72	68		76	71	67		74	70	66	64
5	85	75	67	62	83	73	67	62	72	66	61		70	64	60		68	63	60	58
6	79	68	61	56	78	68	61	56	66	60	55		64	59	55		63	58	54	53
7	74	63	56	51	73	62	55	50	61	55	50		60	54	50		58	53	49	48
8	70	58	51	46	68	58	51	46	56	50	46		55	50	45		54	49	45	44
9	66	54	47	42	64	54	47	42	53	46	42		52	46	42		51	45	42	40
10	62	50	43	39	61	50	43	39	49	43	39		48	42	39		47	42	38	37

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	4716
5°	4719
10°	4702
15°	4641
20°	4560
25°	4452
30°	4227
35°	3763
40°	3177
45°	2499
50°	1762
55°	1027
60°	621
65°	535
70°	475
75°	423
80°	386
85°	362

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 2499 cd/sqm

TEST NUMBER: P867298

CATALOG NUMBER: PRLX-2004-L-930-83L-G-X-X-GREY-X

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	90.5	5.7
10°-20°	256.0	16.2
20°-30°	375.0	23.8
30°-40°	387.9	24.6
40°-50°	275.5	17.5
50°-60°	114.7	7.3
60°-70°	46.3	2.9
70°-80°	23.9	1.5
80°-90°	7.1	0.5
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	721.6	45.8
0°-40°	1109.5	70.4
0°-60°	1499.6	95.1
0°-90°	1576.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1576.9	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	956	
5°	953	91
15°	909	256
25°	818	375
35°	625	388
45°	358	275
55°	119	115
65°	46	46
75°	22	24
85°	6	7
90°	0	

TEST NUMBER: P867298

CATALOG NUMBER: PRLX-2004-L-930-83L-G-X-X-GREY-X

CANDELA DISTRIBUTION (FULL):

	0°
0°	955.8
2.5°	955.0
5°	952.9
7.5°	947.9
10°	938.6
12.5°	925.0
15°	908.6
17.5°	890.0
20°	868.5
22.5°	845.0
25°	817.8
27.5°	787.0
30°	742.0
32.5°	687.7
35°	624.8
37.5°	559.7
40°	493.2
42.5°	425.3
45°	358.1
47.5°	292.4
50°	229.5
52.5°	173.0
55°	119.4
57.5°	79.3
60°	62.9
62.5°	54.3
65°	45.8
67.5°	39.3
70°	32.9
72.5°	27.2
75°	22.2
77.5°	17.9
80°	13.6
82.5°	10.0
85°	6.4
87.5°	2.9
90°	0.0

TEST NUMBER: P867298
 CATALOG NUMBER: PRLX-2004-L-930-83L-G-X-X-GREY-X

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	7.32	8.61	7.68	8.92	9.23	7.32	8.61	7.68	8.92	9.23
	3H	8.39	9.53	8.77	9.86	10.22	8.39	9.53	8.77	9.86	10.22
	4H	8.79	9.84	9.19	10.19	10.58	8.79	9.84	9.19	10.19	10.58
	6H	9.09	10.06	9.51	10.43	10.83	9.09	10.06	9.51	10.43	10.83
	8H	9.19	10.11	9.62	10.50	10.91	9.19	10.11	9.62	10.50	10.91
	12H	9.26	10.14	9.69	10.52	10.95	9.26	10.14	9.69	10.52	10.95
4H	2H	7.63	8.68	8.03	9.04	9.42	7.63	8.68	8.03	9.04	9.42
	3H	8.91	9.77	9.33	10.18	10.58	8.91	9.77	9.33	10.18	10.58
	4H	9.43	10.19	9.86	10.61	11.06	9.43	10.19	9.86	10.61	11.06
	6H	9.85	10.52	10.32	10.96	11.43	9.85	10.52	10.32	10.96	11.43
	8H	10.00	10.62	10.47	11.06	11.54	10.00	10.62	10.47	11.06	11.54
	12H	10.11	10.65	10.60	11.14	11.61	10.11	10.65	10.60	11.14	11.61
8H	4H	9.58	10.20	10.05	10.65	11.12	9.58	10.20	10.05	10.65	11.12
	6H	10.12	10.62	10.62	11.12	11.60	10.12	10.62	10.62	11.12	11.60
	8H	10.33	10.79	10.86	11.30	11.80	10.33	10.79	10.86	11.30	11.80
	12H	10.52	10.92	11.04	11.42	11.99	10.52	10.92	11.04	11.42	11.99
12H	4H	9.58	10.12	10.07	10.61	11.08	9.58	10.12	10.07	10.61	11.08
	6H	10.14	10.59	10.66	11.11	11.60	10.14	10.59	10.66	11.11	11.60
	8H	10.41	10.81	10.92	11.30	11.88	10.41	10.81	10.92	11.30	11.88