

Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P867304

Luminaire Tested: PRLX-2004-L-935-100L-G-X-X-BLAK-X

Issue Date: 8/20/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P867304  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2304-993-75)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 8/20/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: Prenalux  
Catalog Number: PRLX-2004-L-935-100L-G-X-X-BLAK-X  
Description: PRENTALUX 3D PRINTED PENDANT LED LUMINAIRE, LARGE LIGHT ENGINE, GLOBE LENS,  
BELL WITH BLACK INTERIOR SHADE.  
LIGHT LEVEL 6  
Light Source: 3500K CCT, 90 CRI LEDS  
Ballast/Driver: -


**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 1328.1 lumens  
Efficiency: N/A  
Efficacy: 16.7 lumens/watt  
Spacing Criteria (0/90/45): 1.24 / 1.24 / 1.19  
Luminous Opening: Circular (Dia: 1.67' x H: 0')  
CIE Type: Direct  
  
Input Watts (W): 79.4  
Input Voltage (V): 120  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: 0.333 HR  
Operation Time: 3 HR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P867304

CATALOG NUMBER: PRLX-2004-L-935-100L-G-X-X-BLAK-X

### Luminous Intensity Polar Plot

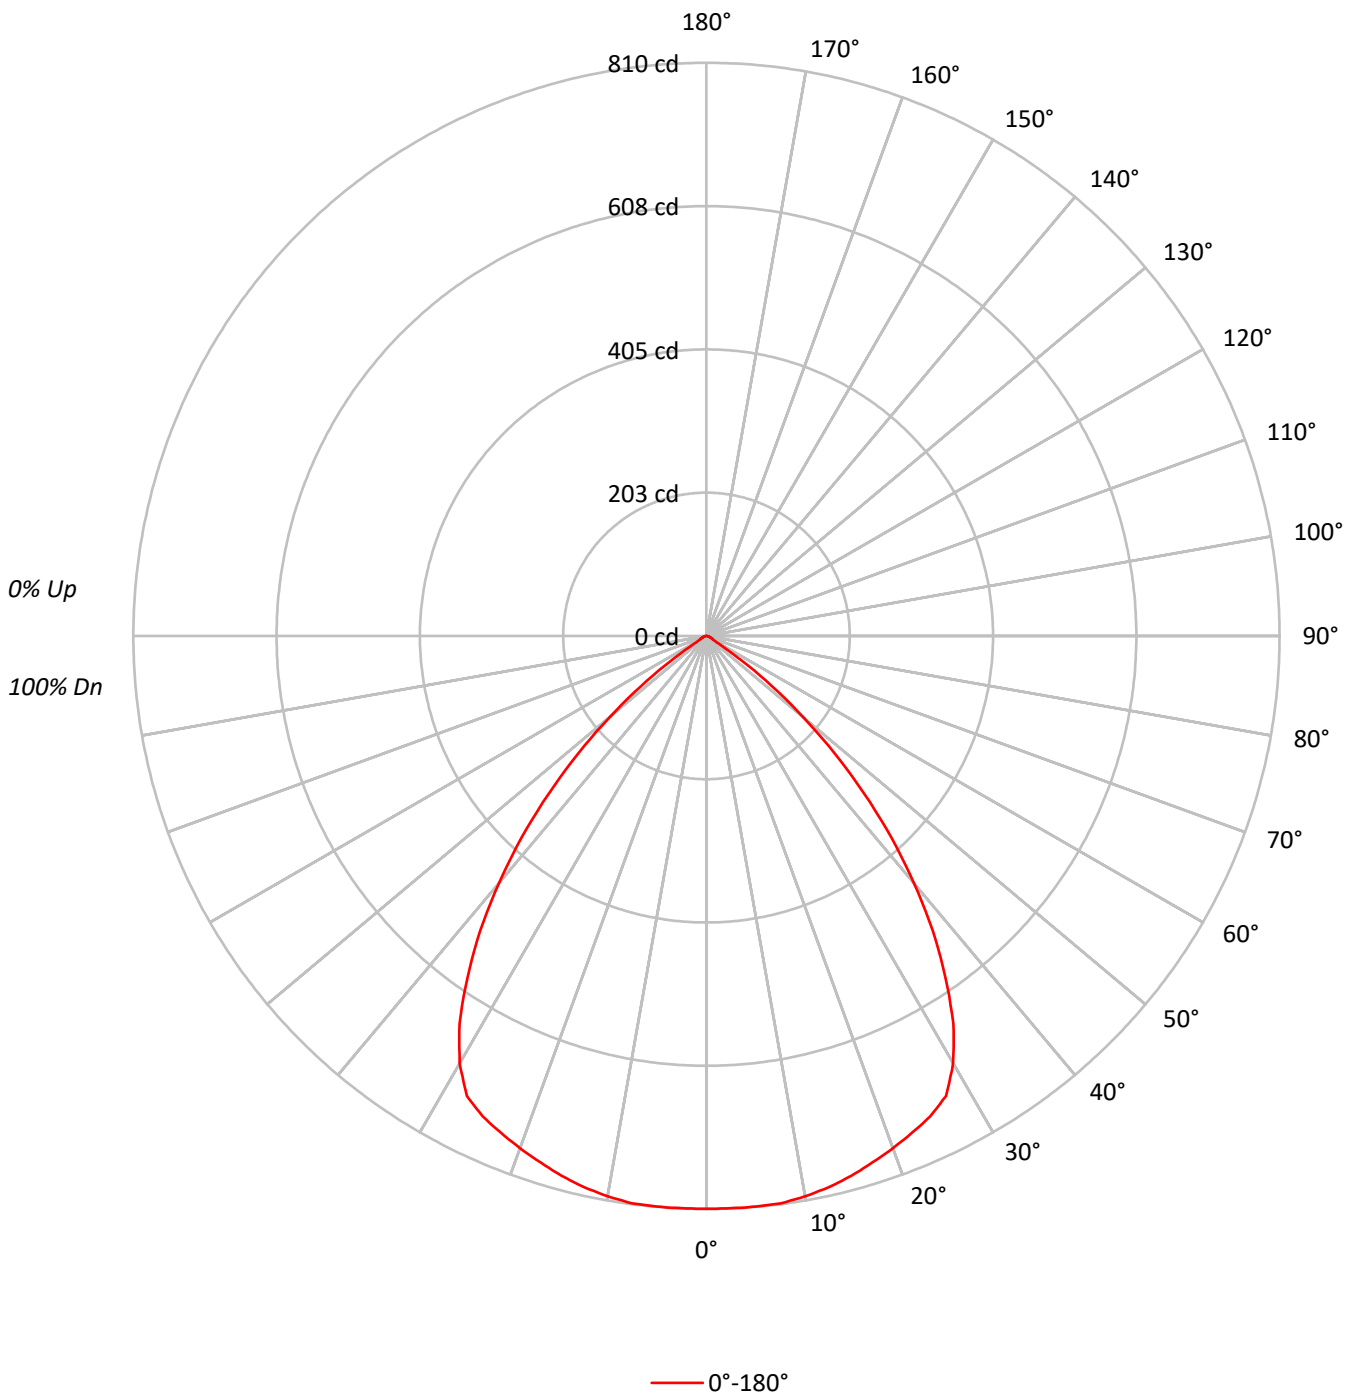



TEST NUMBER: P867304

CATALOG NUMBER: PRLX-2004-L-935-100L-G-X-X-BLAK-X

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	112	109	106	104	110	107	105	102	103	101	99	99	98	96	96	94	93	91
2	106	100	95	91	103	98	94	90	95	91	88	92	89	86	89	87	84	83
3	99	91	86	81	97	90	85	80	87	83	79	85	81	78	82	79	76	75
4	93	84	77	72	91	83	76	72	80	75	71	78	74	70	76	72	69	67
5	87	77	70	65	85	76	69	65	74	68	64	72	67	63	71	66	63	61
6	81	71	64	59	80	70	63	58	68	62	58	67	62	58	65	61	57	55
7	76	65	58	53	75	65	58	53	63	57	53	62	56	52	61	56	52	51
8	72	60	53	49	70	60	53	48	59	53	48	58	52	48	56	51	48	46
9	67	56	49	45	66	56	49	44	55	48	44	54	48	44	53	48	44	42
10	64	52	45	41	62	52	45	41	51	45	41	50	45	41	49	44	41	39

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	3994
5°	4009
10°	4029
15°	4035
20°	4045
25°	4077
30°	3973
35°	3547
40°	2940
45°	2203
50°	1365
55°	528
60°	114
65°	93
70°	76
75°	69
80°	77
85°	51

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 2203 cd/sqm

TEST NUMBER: P867304

CATALOG NUMBER: PRLX-2004-L-935-100L-G-X-X-BLAK-X

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	77.1	5.8
10°-20°	223.1	16.8
20°-30°	343.4	25.9
30°-40°	364.7	27.5
40°-50°	242.0	18.2
50°-60°	64.2	4.8
60°-70°	8.2	0.6
70°-80°	3.9	0.3
80°-90°	1.3	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	643.7	48.5
0°-40°	1008.3	75.9
0°-60°	1314.6	99.0
0°-90°	1328.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1328.1	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	810	
5°	810	77
15°	790	223
25°	749	343
35°	589	365
45°	316	242
55°	61	64
65°	8	8
75°	4	4
85°	1	1
90°	0	

TEST NUMBER: P867304

CATALOG NUMBER: PRLX-2004-L-935-100L-G-X-X-BLAK-X

**CANDELA DISTRIBUTION (FULL):**

0°	
0°	809.5
2.5°	809.5
5°	809.5
7.5°	808.6
10°	804.2
12.5°	798.0
15°	789.9
17.5°	780.2
20°	770.4
22.5°	759.7
25°	749.0
27.5°	733.0
30°	697.4
32.5°	649.4
35°	588.9
37.5°	525.7
40°	456.4
42.5°	387.0
45°	315.8
47.5°	245.5
50°	177.9
52.5°	116.5
55°	61.4
57.5°	20.5
60°	11.6
62.5°	9.8
65°	8.0
67.5°	7.1
70°	5.3
72.5°	4.4
75°	3.6
77.5°	2.7
80°	2.7
82.5°	1.8
85°	0.9
87.5°	0.9
90°	0.0



TEST NUMBER: P867304  
 CATALOG NUMBER: PRLX-2004-L-935-100L-G-X-X-BLAK-X

**CIE UGR TABLE:**

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	0.00	0.00	0.00	0.01	0.33	0.00	0.00	0.00	0.01	0.33
	3H	0.00	0.02	0.00	0.35	0.71	0.00	0.02	0.00	0.35	0.71
	4H	0.00	0.09	0.00	0.45	0.83	0.00	0.09	0.00	0.45	0.83
	6H	0.00	0.14	0.00	0.51	0.91	0.00	0.14	0.00	0.51	0.91
	8H	0.00	0.15	0.00	0.54	0.95	0.00	0.15	0.00	0.54	0.95
	12H	0.00	0.12	0.00	0.51	0.94	0.00	0.12	0.00	0.51	0.94
4H	2H	0.00	0.00	0.00	0.00	0.24	0.00	0.00	0.00	0.00	0.24
	3H	0.00	0.00	0.00	0.33	0.73	0.00	0.00	0.00	0.33	0.73
	4H	0.00	0.07	0.00	0.49	0.93	0.00	0.07	0.00	0.49	0.93
	6H	0.00	0.21	0.08	0.66	1.13	0.00	0.21	0.08	0.66	1.13
	8H	0.00	0.27	0.19	0.72	1.19	0.00	0.27	0.19	0.72	1.19
	12H	0.00	0.24	0.24	0.73	1.20	0.00	0.24	0.24	0.73	1.20
8H	4H	0.00	0.00	0.00	0.39	0.86	0.00	0.00	0.00	0.39	0.86
	6H	0.00	0.19	0.24	0.69	1.17	0.00	0.19	0.24	0.69	1.17
	8H	0.00	0.30	0.42	0.82	1.31	0.00	0.30	0.42	0.82	1.31
	12H	0.00	0.34	0.50	0.84	1.41	0.00	0.34	0.50	0.84	1.41
12H	4H	0.00	0.00	0.00	0.34	0.81	0.00	0.00	0.00	0.34	0.81
	6H	0.00	0.14	0.26	0.66	1.15	0.00	0.14	0.26	0.66	1.15
	8H	0.00	0.30	0.45	0.79	1.37	0.00	0.30	0.45	0.79	1.37