

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P867339

Luminaire Tested: PRLX-2004-L-935-32L-G-X-X-WHHR-X

Issue Date: 8/20/2024

Test Information

Test Method: LM-79-2019
Report Number: P867339
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2304-993-72)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 8/20/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: Prenalux
Catalog Number: PRLX-2004-L-935-32L-G-X-X-WHHR-X
Description: PRENATALUX 3D PRINTED PENDANT LED LUMINAIRE, LARGE LIGHT ENGINE, GLOBE LENS,
BELL WITH WHITE INTERIOR SHADE.
LIGHT LEVEL 2
Light Source: 3500K CCT, 90 CRI LEDS
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 1911.7 lumens
Efficiency: N/A
Efficacy: 73.2 lumens/watt
Spacing Criteria (0/90/45): 1.19 / 1.19 / 1.22
Luminous Opening: Circular (Dia: 1.67' x H: 0')
CIE Type: Direct

Input Watts (W): 26.1
Input Voltage (V): 120
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: 0.5 HR
Operation Time: 3 HR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P867339

CATALOG NUMBER: PRLX-2004-L-935-32L-G-X-X-WHHR-X

Luminous Intensity Polar Plot

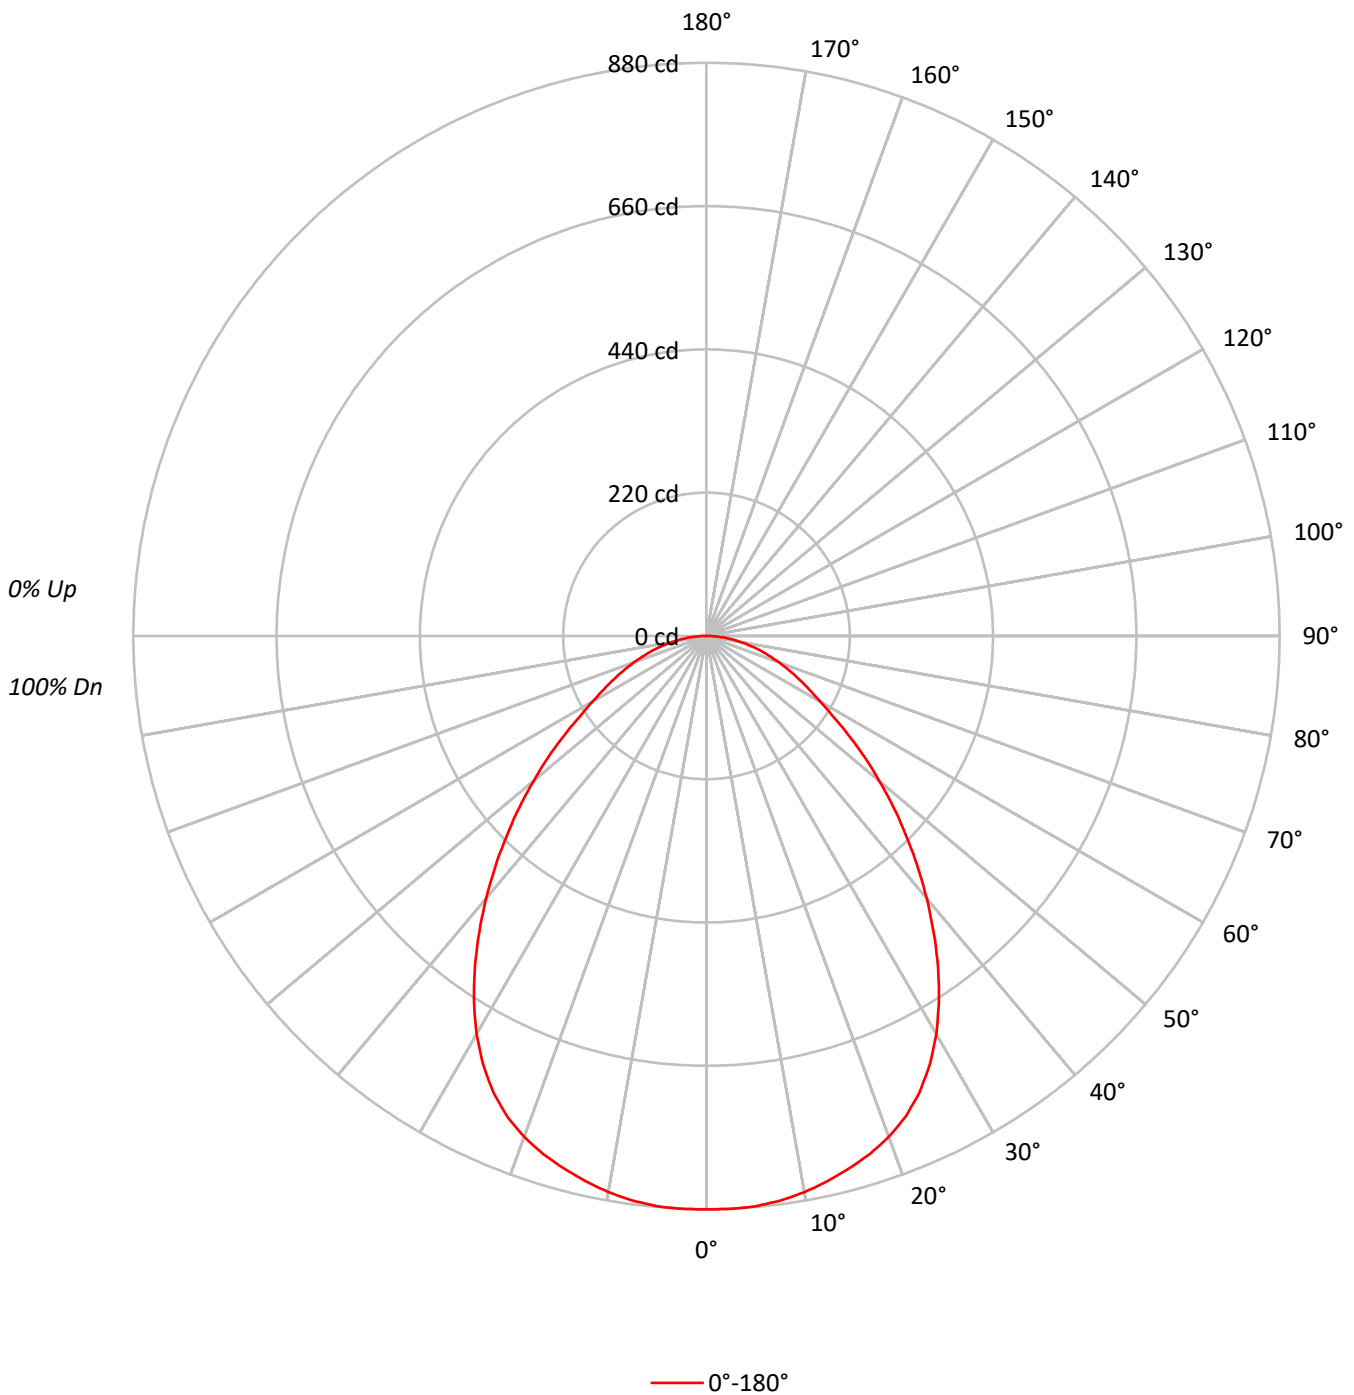



TEST NUMBER: P867339

CATALOG NUMBER: PRLX-2004-L-935-32L-G-X-X-WHHR-X

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	110	106	102	98	107	103	100	97	99	96	94	95	93	91	92	90	88	86
2	101	94	88	82	99	92	86	81	88	84	80	85	81	78	82	79	76	74
3	93	84	76	70	91	82	75	70	79	73	68	76	71	67	74	70	66	64
4	86	75	67	61	84	74	66	60	71	65	60	69	63	59	67	62	58	56
5	80	68	59	53	78	67	59	53	65	58	52	63	57	52	61	56	51	49
6	74	62	53	47	72	61	53	47	59	52	47	57	51	46	56	50	46	44
7	69	56	48	42	67	55	48	42	54	47	42	53	46	42	51	46	41	39
8	64	52	44	38	63	51	43	38	50	43	38	49	42	38	47	42	37	36
9	60	48	40	35	59	47	40	35	46	39	34	45	39	34	44	38	34	32
10	57	44	37	32	56	44	36	32	43	36	32	42	36	31	41	35	31	30

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	4344
5°	4352
10°	4344
15°	4324
20°	4297
25°	4210
30°	4020
35°	3732
40°	3388
45°	3024
50°	2658
55°	2295
60°	1990
65°	1828
70°	1707
75°	1601
80°	1509
85°	1421

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 3024 cd/sqm

TEST NUMBER: P867339

CATALOG NUMBER: PRLX-2004-L-935-32L-G-X-X-WHHR-X

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	83.5	4.4
10°-20°	238.9	12.5
20°-30°	354.5	18.5
30°-40°	386.1	20.2
40°-50°	334.8	17.5
50°-60°	240.6	12.6
60°-70°	156.0	8.2
70°-80°	89.3	4.7
80°-90°	28.0	1.5
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	676.9	35.4
0°-40°	1063.0	55.6
0°-60°	1638.3	85.7
0°-90°	1911.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1911.7	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	880	
5°	879	84
15°	846	239
25°	773	355
35°	620	386
45°	433	335
55°	267	241
65°	157	156
75°	84	89
85°	25	28
90°	0	

TEST NUMBER: P867339

CATALOG NUMBER: PRLX-2004-L-935-32L-G-X-X-WHHR-X

CANDELA DISTRIBUTION (FULL):

	0°
0°	880.5
2.5°	880.5
5°	878.8
7.5°	874.2
10°	867.1
12.5°	857.4
15°	846.5
17.5°	833.9
20°	818.5
22.5°	798.8
25°	773.4
27.5°	742.5
30°	705.7
32.5°	664.2
35°	619.7
37.5°	572.8
40°	526.0
42.5°	479.7
45°	433.4
47.5°	389.7
50°	346.3
52.5°	306.3
55°	266.8
57.5°	231.1
60°	201.7
62.5°	177.7
65°	156.6
67.5°	136.6
70°	118.3
72.5°	100.6
75°	84.0
77.5°	68.3
80°	53.1
82.5°	38.9
85°	25.1
87.5°	12.3
90°	0.0

TEST NUMBER: P867339
 CATALOG NUMBER: PRLX-2004-L-935-32L-G-X-X-WHHR-X

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	13.85	15.35	14.22	15.67	15.98	13.85	15.35	14.22	15.67	15.98
	3H	15.37	16.71	15.75	17.04	17.40	15.37	16.71	15.75	17.04	17.40
	4H	15.97	17.23	16.37	17.58	17.96	15.97	17.23	16.37	17.58	17.96
	6H	16.45	17.61	16.86	17.98	18.37	16.45	17.61	16.86	17.98	18.37
	8H	16.62	17.72	17.04	18.11	18.52	16.62	17.72	17.04	18.11	18.52
	12H	16.74	17.80	17.17	18.18	18.61	16.74	17.80	17.17	18.18	18.61
4H	2H	14.36	15.62	14.76	15.97	16.35	14.36	15.62	14.76	15.97	16.35
	3H	16.11	17.16	16.52	17.56	17.96	16.11	17.16	16.52	17.56	17.96
	4H	16.85	17.79	17.28	18.20	18.64	16.85	17.79	17.28	18.20	18.64
	6H	17.46	18.28	17.92	18.73	19.19	17.46	18.28	17.92	18.73	19.19
	8H	17.68	18.45	18.15	18.90	19.36	17.68	18.45	18.15	18.90	19.36
	12H	17.86	18.55	18.34	19.02	19.50	17.86	18.55	18.34	19.02	19.50
8H	4H	17.12	17.89	17.59	18.33	18.80	17.12	17.89	17.59	18.33	18.80
	6H	17.87	18.51	18.37	19.00	19.47	17.87	18.51	18.37	19.00	19.47
	8H	18.18	18.75	18.69	19.26	19.75	18.18	18.75	18.69	19.26	19.75
	12H	18.44	18.94	18.95	19.44	20.00	18.44	18.94	18.95	19.44	20.00
12H	4H	17.15	17.84	17.63	18.31	18.79	17.15	17.84	17.63	18.31	18.79
	6H	17.93	18.50	18.44	19.01	19.50	17.93	18.50	18.44	19.01	19.50
	8H	18.29	18.80	18.80	19.29	19.86	18.29	18.80	18.80	19.29	19.86