

Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P866419

Luminaire Tested: PRLX-2004-M-927-15L-L-U-S-X-X-WHHR-X

Issue Date: 8/20/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P866419  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2304-993-54)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 8/20/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: Prenalux  
Catalog Number: PRLX-2004-M-927-15L-L-U-S-X-X-WHHR-X  
Description: PRENTALUX 3D PRINTED PENDANT LED LUMINAIRE, MEDIUM LIGHT ENGINE, FLAT LENS,  
BELL WITH WHITE INTERIOR SHADE.  
LIGHT LEVEL 2  
Light Source: 2700K CCT, 90 CRI LEDS  
Ballast/Driver: -


**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 1353.1 lumens  
Efficiency: N/A  
Efficacy: 96.6 lumens/watt  
Spacing Criteria (0/90/45): 1.11 / 1.11 / 1.05  
Luminous Opening: Circular (Dia: 1.31' x H: 0')  
CIE Type: Direct  
  
Input Watts (W): 14  
Input Voltage (V): 120  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: 0.5 HR  
Operation Time: 3 HR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P866419

CATALOG NUMBER: PRLX-2004-M-927-15L-L-U-S-X-X-WHHR-X

### Luminous Intensity Polar Plot

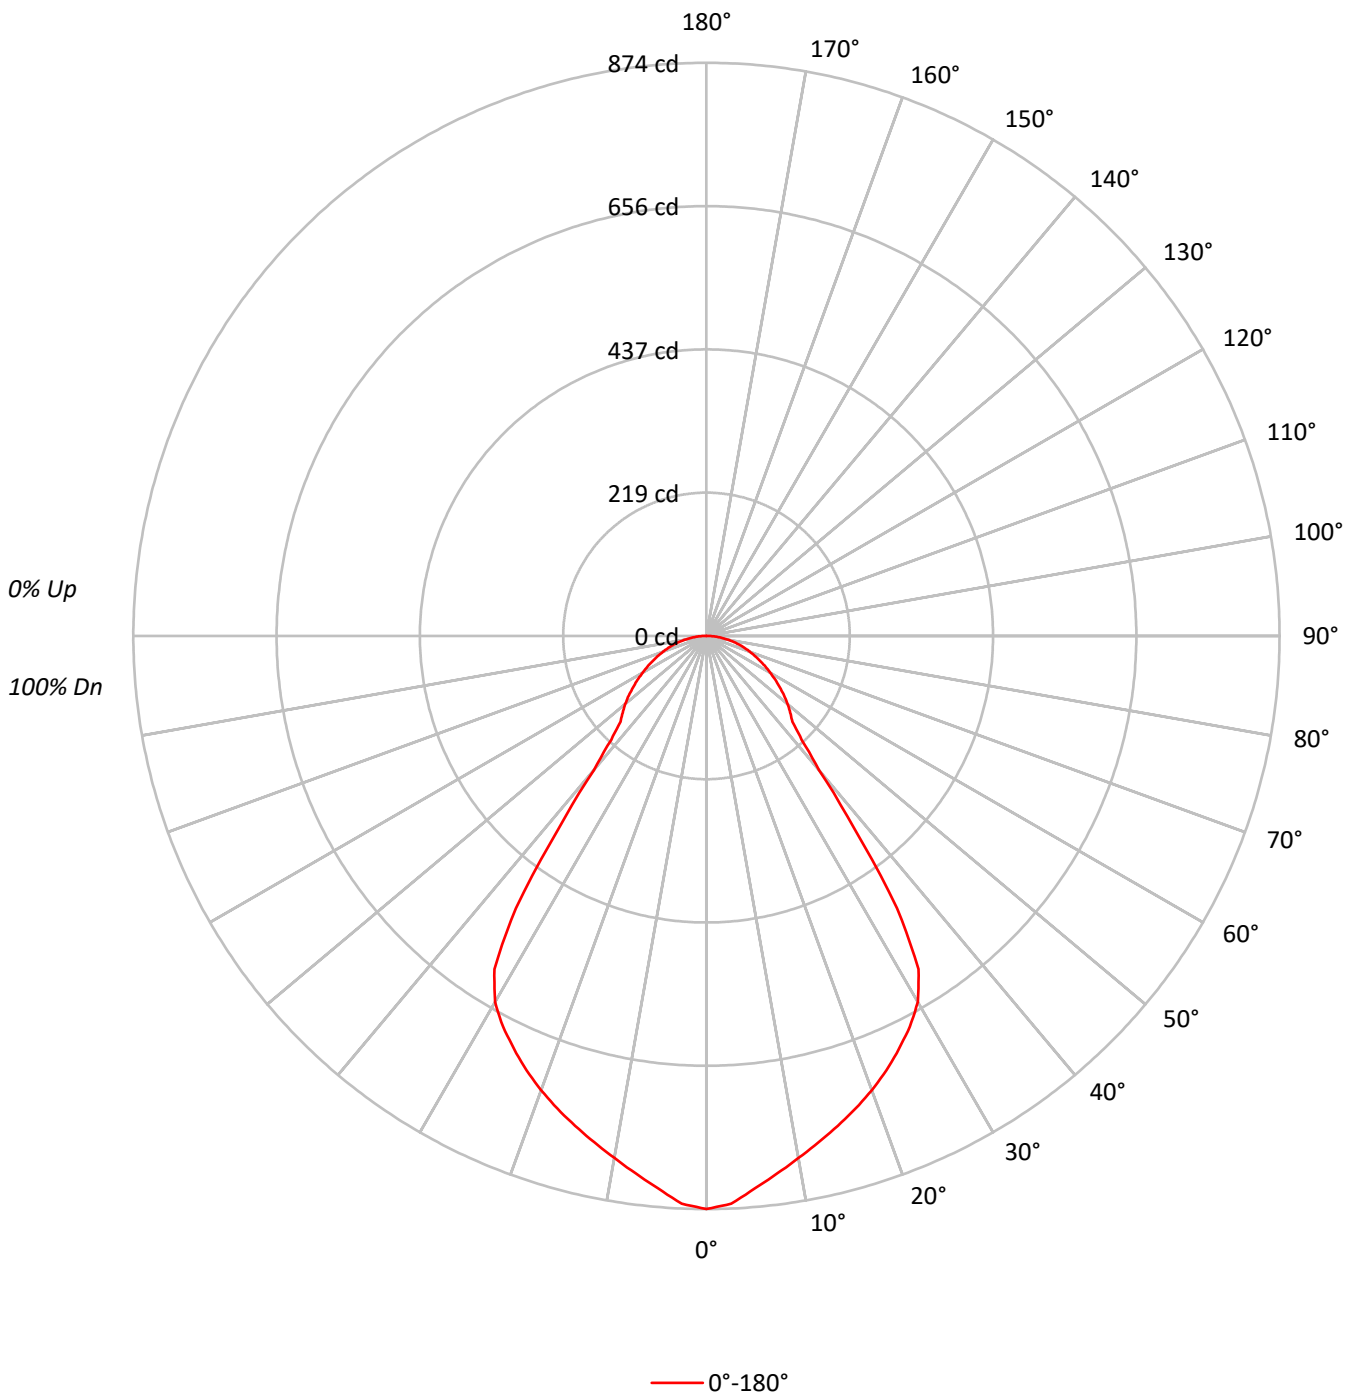



TEST NUMBER: P866419

CATALOG NUMBER: PRLX-2004-M-927-15L-L-U-S-X-X-WHHR-X

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	111	107	103	100	108	105	101	98	100	98	95	97	94	92	93	91	90	88
2	103	96	90	85	100	94	89	84	91	86	83	87	84	81	85	82	79	77
3	95	87	80	74	93	85	79	74	82	77	72	80	75	71	77	73	70	68
4	89	79	71	66	87	77	71	65	75	69	64	73	68	64	71	66	63	61
5	83	72	64	59	81	71	64	58	69	63	58	67	62	57	65	61	57	55
6	78	66	58	53	76	65	58	53	64	57	52	62	56	52	61	55	51	50
7	73	61	53	48	71	60	53	48	59	52	48	57	52	47	56	51	47	45
8	68	57	49	44	67	56	49	44	55	48	44	54	48	43	52	47	43	42
9	64	53	45	40	63	52	45	40	51	45	40	50	44	40	49	44	40	38
10	61	49	42	37	60	49	42	37	48	41	37	47	41	37	46	41	37	35

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	6952
5°	6754
10°	6531
15°	6370
20°	6241
25°	6097
30°	5923
35°	4924
40°	2771
45°	2085
50°	2003
55°	1895
60°	1787
65°	1698
70°	1638
75°	1592
80°	1553
85°	1524

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 2085 cd/sqm

TEST NUMBER: P866419

CATALOG NUMBER: PRLX-2004-M-927-15L-L-U-S-X-X-WHHR-X

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	79.6	5.9
10°-20°	218.2	16.1
20°-30°	319.8	23.6
30°-40°	298.8	22.1
40°-50°	151.5	11.2
50°-60°	122.3	9.0
60°-70°	89.9	6.6
70°-80°	54.7	4.0
80°-90°	18.3	1.4
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	617.6	45.6
0°-40°	916.3	67.7
0°-60°	1190.2	88.0
0°-90°	1353.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1353.1	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	874	
5°	846	80
15°	773	218
25°	695	320
35°	507	299
45°	185	152
55°	137	122
65°	90	90
75°	52	55
85°	17	18
90°	0	

TEST NUMBER: P866419

CATALOG NUMBER: PRLX-2004-M-927-15L-L-U-S-X-X-WHHR-X

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	873.8
2.5°	866.6
5°	845.7
7.5°	826.6
10°	808.4
12.5°	790.9
15°	773.4
17.5°	755.9
20°	737.2
22.5°	717.0
25°	694.6
27.5°	671.7
30°	644.7
32.5°	602.1
35°	507.0
37.5°	369.6
40°	266.8
42.5°	215.0
45°	185.3
47.5°	173.2
50°	161.8
52.5°	149.2
55°	136.6
57.5°	124.5
60°	112.3
62.5°	101.6
65°	90.2
67.5°	80.3
70°	70.4
72.5°	60.9
75°	51.8
77.5°	42.6
80°	33.9
82.5°	25.1
85°	16.7
87.5°	8.4
90°	0.0



TEST NUMBER: P866419  
 CATALOG NUMBER: PRLX-2004-M-927-15L-L-U-S-X-X-WHHR-X

**CIE UGR TABLE:**

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	12.62	13.97	12.99	14.29	14.60	12.62	13.97	12.99	14.29	14.60
	3H	14.36	15.57	14.74	15.90	16.27	14.36	15.57	14.74	15.90	16.27
	4H	15.07	16.20	15.47	16.55	16.94	15.07	16.20	15.47	16.55	16.94
	6H	15.64	16.69	16.06	17.06	17.45	15.64	16.69	16.06	17.06	17.45
	8H	15.86	16.85	16.28	17.24	17.64	15.86	16.85	16.28	17.24	17.64
	12H	16.01	16.96	16.44	17.34	17.77	16.01	16.96	16.44	17.34	17.77
4H	2H	13.18	14.31	13.58	14.66	15.04	13.18	14.31	13.58	14.66	15.04
	3H	15.15	16.09	15.56	16.49	16.90	15.15	16.09	15.56	16.49	16.90
	4H	16.00	16.85	16.43	17.26	17.71	16.00	16.85	16.43	17.26	17.71
	6H	16.72	17.45	17.18	17.90	18.36	16.72	17.45	17.18	17.90	18.36
	8H	16.99	17.67	17.45	18.12	18.59	16.99	17.67	17.45	18.12	18.59
	12H	17.20	17.81	17.68	18.29	18.76	17.20	17.81	17.68	18.29	18.76
8H	4H	16.31	16.99	16.77	17.44	17.91	16.31	16.99	16.77	17.44	17.91
	6H	17.18	17.74	17.68	18.24	18.72	17.18	17.74	17.68	18.24	18.72
	8H	17.54	18.04	18.06	18.56	19.05	17.54	18.04	18.06	18.56	19.05
	12H	17.86	18.30	18.37	18.79	19.36	17.86	18.30	18.37	18.79	19.36
12H	4H	16.34	16.95	16.82	17.43	17.90	16.34	16.95	16.82	17.43	17.90
	6H	17.25	17.75	17.77	18.27	18.76	17.25	17.75	17.77	18.27	18.76
	8H	17.68	18.12	18.19	18.61	19.18	17.68	18.12	18.19	18.61	19.18