

Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P866464

Luminaire Tested: PRLX-2004-M-927-75L-L-U-S-X-X-BLAK-X

Issue Date: 8/20/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P866464  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2304-993-57)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 8/20/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: Prenalux  
Catalog Number: PRLX-2004-M-927-75L-L-U-S-X-X-BLAK-X  
Description: PRENATALUX 3D PRINTED PENDANT LED LUMINAIRE, MEDIUM LIGHT ENGINE, FLAT LENS,  
BELL WITH BLACK INTERIOR SHADE.  
LIGHT LEVEL 8  
Light Source: 3000K CCT, 90 CRI LEDS  
Ballast/Driver: -


**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 3028.1 lumens  
Efficiency: N/A  
Efficacy: 43.4 lumens/watt  
Spacing Criteria (0/90/45): 1.06 / 1.06 / 1  
Luminous Opening: Circular (Dia: 1.31' x H: 0')  
CIE Type: Direct  
  
Input Watts (W): 69.7  
Input Voltage (V): 120  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: 0.333 HR  
Operation Time: 3 HR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P866464

CATALOG NUMBER: PRLX-2004-M-927-75L-L-U-S-X-X-BLAK-X

### Luminous Intensity Polar Plot

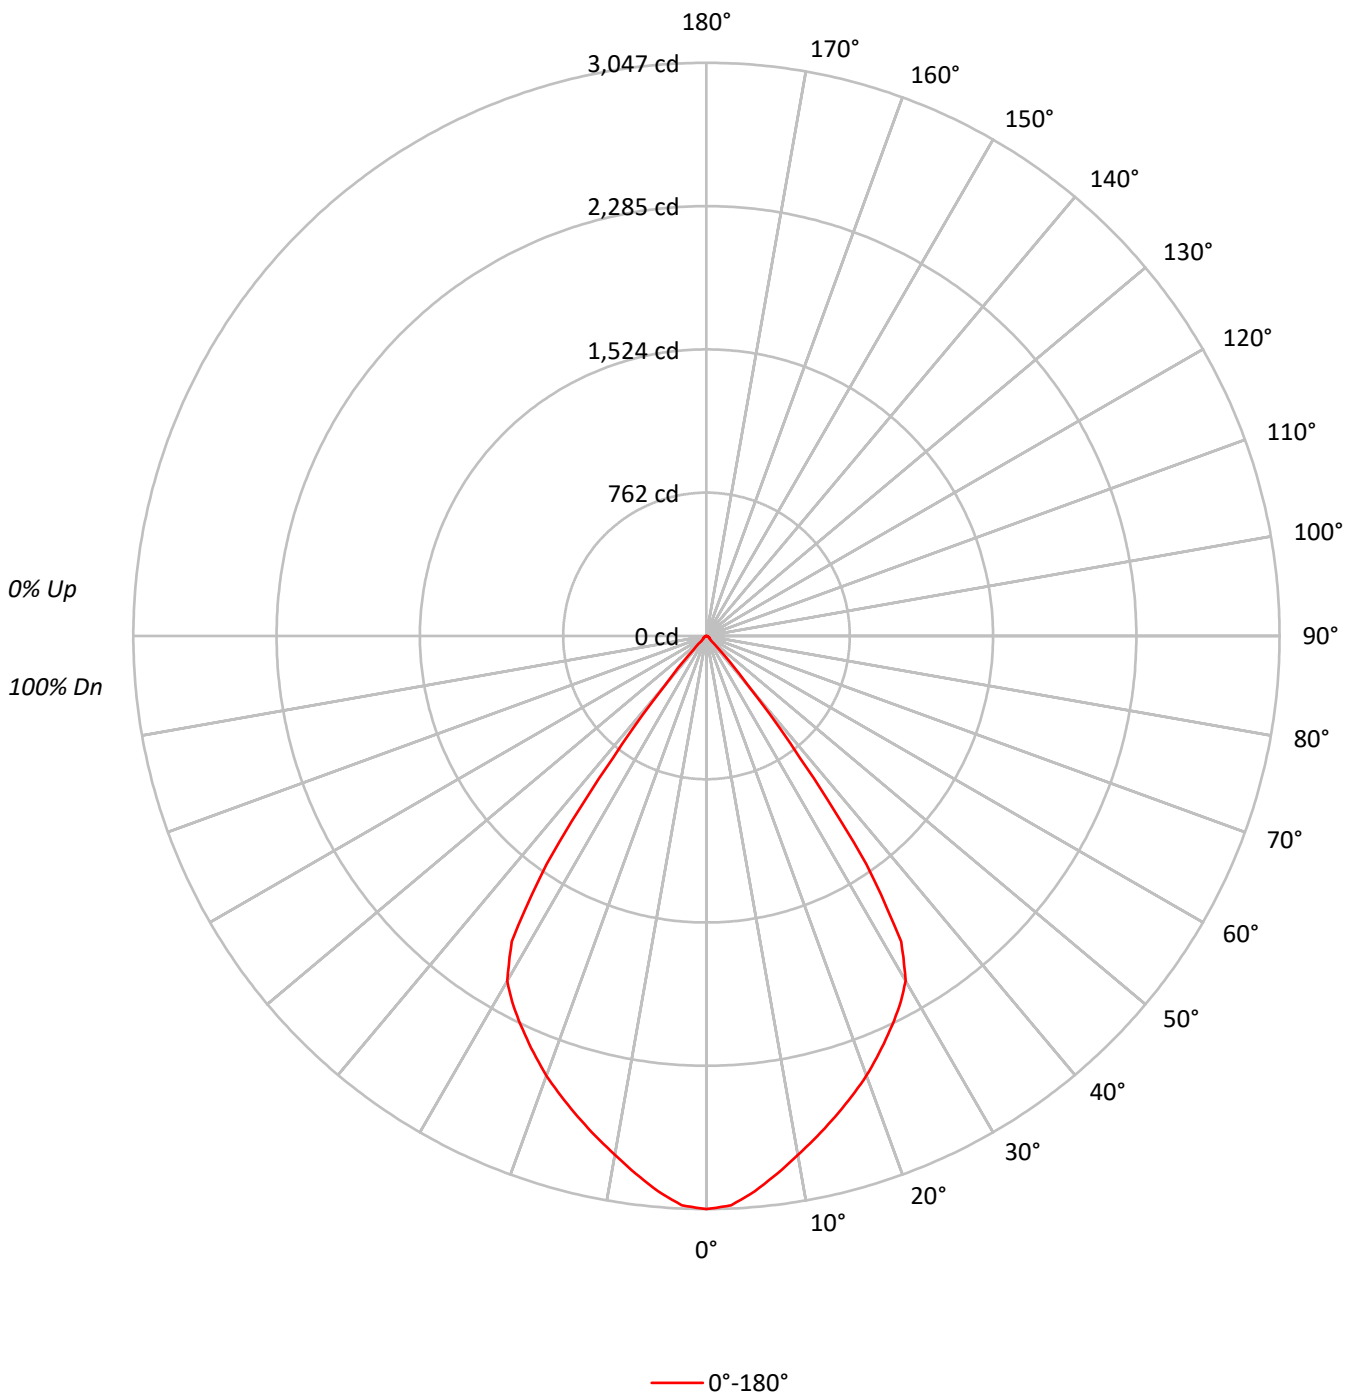



TEST NUMBER: P866464

CATALOG NUMBER: PRLX-2004-M-927-75L-L-U-S-X-X-BLAK-X

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	113	111	108	106	111	108	106	104	104	103	101	101	99	98	97	96	95	93
2	108	103	99	95	106	101	97	94	98	95	92	95	92	90	92	90	88	87
3	102	96	91	87	100	94	90	86	92	88	85	89	86	83	87	84	82	81
4	97	89	84	80	95	88	83	79	86	82	78	84	80	77	82	79	76	75
5	92	84	78	73	90	83	77	73	81	76	72	79	75	72	78	74	71	70
6	87	78	72	68	86	77	72	68	76	71	67	75	70	67	73	69	66	65
7	83	73	67	63	81	73	67	63	71	66	62	70	66	62	69	65	62	60
8	79	69	63	59	77	68	63	59	67	62	58	66	62	58	65	61	58	56
9	75	65	59	55	74	64	59	55	63	58	55	63	58	54	62	57	54	53
10	71	61	55	51	70	61	55	51	60	55	51	59	54	51	58	54	51	50

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	24239
5°	23662
10°	22629
15°	21786
20°	21057
25°	20279
30°	19457
35°	14379
40°	3636
45°	429
50°	282
55°	264
60°	242
65°	215
70°	177
75°	175
80°	174
85°	173

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 429 cd/sqm

TEST NUMBER: P866464

CATALOG NUMBER: PRLX-2004-M-927-75L-L-U-S-X-X-BLAK-X

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	277.6	9.2
10°-20°	745.2	24.6
20°-30°	1063.5	35.1
30°-40°	833.5	27.5
40°-50°	72.5	2.4
50°-60°	17.0	0.6
60°-70°	11.3	0.4
70°-80°	6.0	0.2
80°-90°	1.5	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2086.4	68.9
0°-40°	2919.8	96.4
0°-60°	3009.3	99.4
0°-90°	3028.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3028.1	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	3047	
5°	2963	278
15°	2645	745
25°	2310	1063
35°	1480	833
45°	38	72
55°	19	17
65°	11	11
75°	6	6
85°	2	2
90°	0	

TEST NUMBER: P866464

CATALOG NUMBER: PRLX-2004-M-927-75L-L-U-S-X-X-BLAK-X

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	3046.7
2.5°	3029.5
5°	2962.9
7.5°	2883.0
10°	2801.2
12.5°	2723.2
15°	2645.1
17.5°	2567.1
20°	2487.2
22.5°	2399.6
25°	2310.2
27.5°	2220.8
30°	2118.0
32.5°	1925.8
35°	1480.5
37.5°	818.3
40°	350.1
42.5°	138.9
45°	38.1
47.5°	26.6
50°	22.8
52.5°	20.9
55°	19.0
57.5°	17.1
60°	15.2
62.5°	13.3
65°	11.4
67.5°	9.5
70°	7.6
72.5°	7.6
75°	5.7
77.5°	3.8
80°	3.8
82.5°	1.9
85°	1.9
87.5°	0.0
90°	0.0



TEST NUMBER: P866464  
 CATALOG NUMBER: PRLX-2004-M-927-75L-L-U-S-X-X-BLAK-X

**CIE UGR TABLE:**

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.06	0.00	0.00	0.00	0.00	0.06
	8H	0.00	0.00	0.00	0.00	0.13	0.00	0.00	0.00	0.00	0.13
	12H	0.00	0.00	0.00	0.00	0.18	0.00	0.00	0.00	0.00	0.18
4H	2H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4H	0.00	0.00	0.00	0.00	0.41	0.00	0.00	0.00	0.00	0.41
	6H	0.00	0.00	0.00	0.33	0.81	0.00	0.00	0.00	0.33	0.81
	8H	0.00	0.00	0.00	0.40	0.88	0.00	0.00	0.00	0.40	0.88
	12H	0.00	0.00	0.12	0.49	0.97	0.00	0.00	0.12	0.49	0.97
8H	4H	0.00	0.00	0.00	0.01	0.48	0.00	0.00	0.00	0.01	0.48
	6H	0.00	0.03	0.20	0.53	1.02	0.00	0.03	0.20	0.53	1.02
	8H	0.00	0.15	0.39	0.67	1.17	0.00	0.15	0.39	0.67	1.17
	12H	0.06	0.32	0.59	0.82	1.40	0.06	0.32	0.59	0.82	1.40
12H	4H	0.00	0.00	0.00	0.00	0.45	0.00	0.00	0.00	0.00	0.45
	6H	0.00	0.00	0.24	0.52	1.02	0.00	0.00	0.24	0.52	1.02
	8H	0.00	0.17	0.43	0.66	1.25	0.00	0.17	0.43	0.66	1.25