

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P866497

Luminaire Tested: PRLX-2004-M-930-35L-L-U-S-X-X-BRSS-X

Issue Date: 8/20/2024

Test Information

Test Method: LM-79-2019
Report Number: P866497
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2304-993-55)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 8/20/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: Prenalux
Catalog Number: PRLX-2004-M-930-35L-L-U-S-X-X-BRSS-X
Description: PRENATALUX 3D PRINTED PENDANT LED LUMINAIRE, MEDIUM LIGHT ENGINE, FLAT LENS,
BELL WITH BRASS INTERIOR SHADE.
LIGHT LEVEL 4
Light Source: 3000K CCT, 90 CRI LEDS
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 1796.5 lumens
Efficiency: N/A
Efficacy: 59.9 lumens/watt
Spacing Criteria (0/90/45): 1.03 / 1.03 / 1
Luminous Opening: Circular (Dia: 1.31' x H: 0')
CIE Type: Direct

Input Watts (W): 30
Input Voltage (V): 120
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: 0.5 HR
Operation Time: 3 HR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P866497

CATALOG NUMBER: PRLX-2004-M-930-35L-L-U-S-X-X-BRSS-X

Luminous Intensity Polar Plot

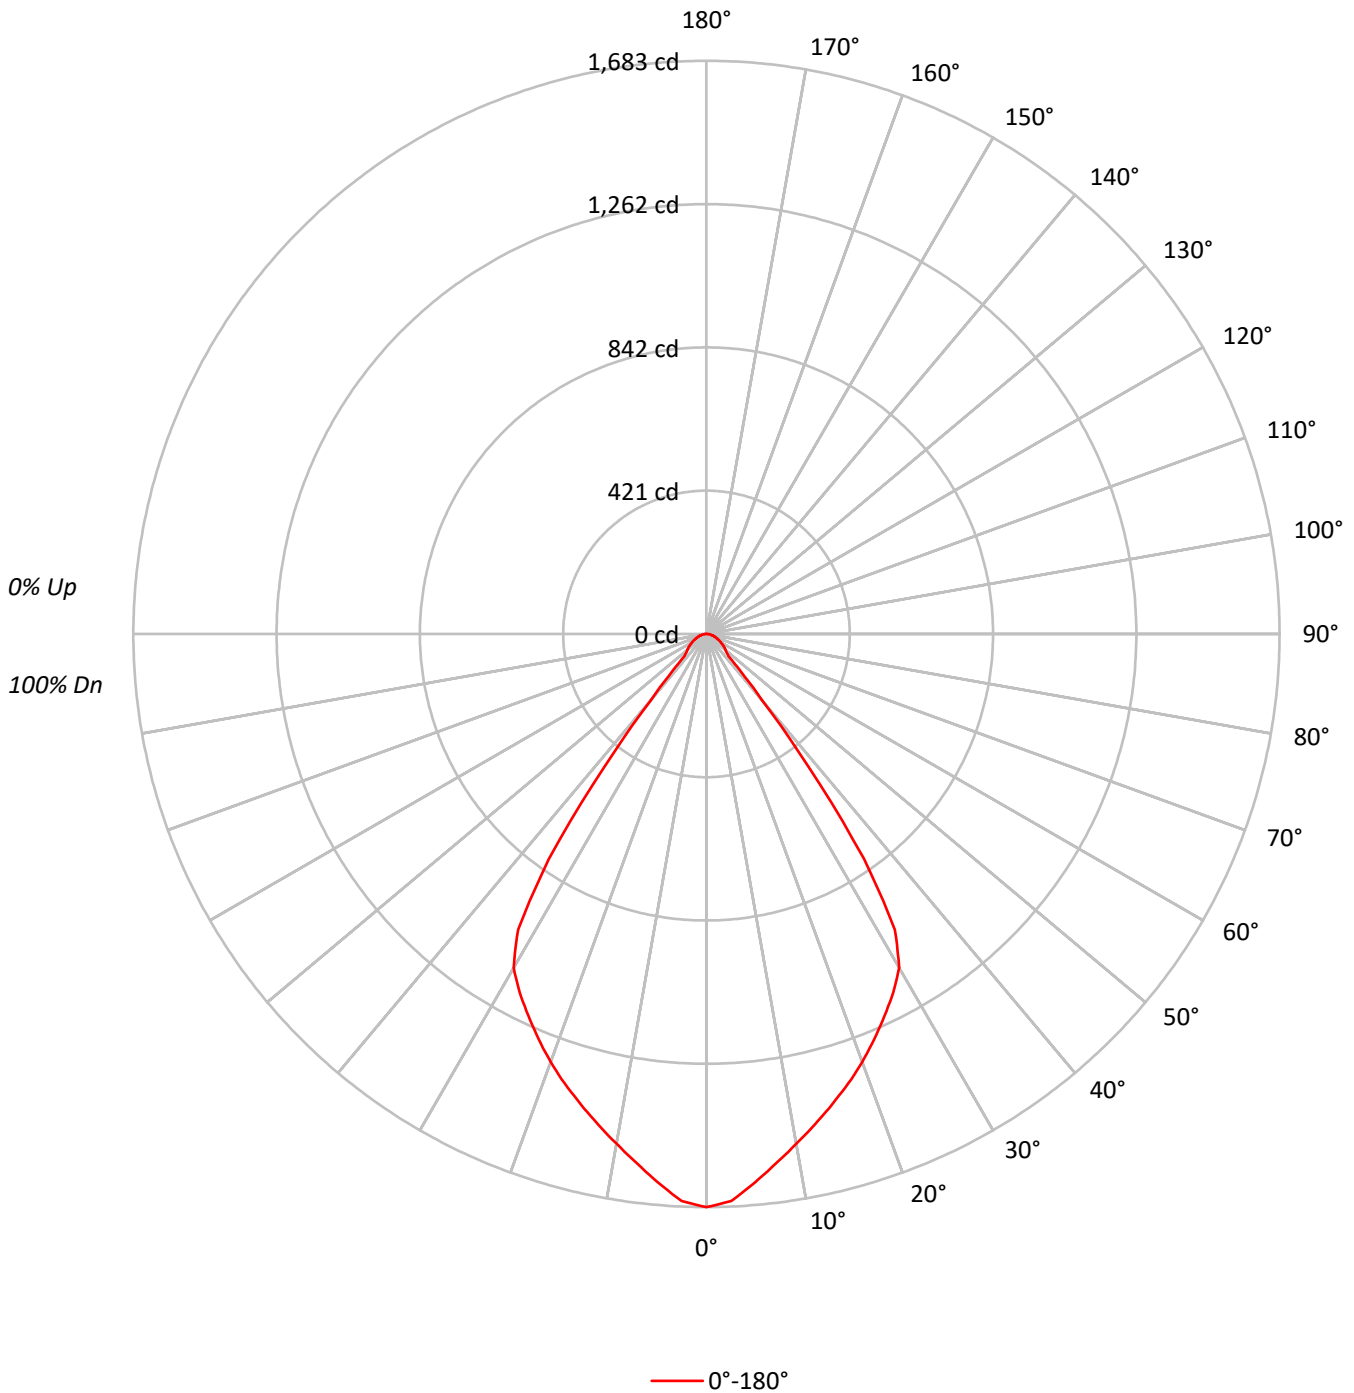



TEST NUMBER: P866497

CATALOG NUMBER: PRLX-2004-M-930-35L-L-U-S-X-X-BRSS-X

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	113	110	107	104	110	107	105	103	103	101	99	100	98	97	96	95	94	92
2	106	101	96	93	104	99	95	92	96	93	90	93	90	88	90	88	86	84
3	100	93	88	83	98	92	87	83	89	85	81	87	83	80	84	81	79	77
4	95	87	80	76	93	85	80	75	83	78	74	81	77	74	79	76	73	71
5	90	80	74	69	88	79	73	69	78	72	68	76	71	68	74	70	67	66
6	85	75	68	64	83	74	68	64	73	67	63	71	66	63	70	66	62	61
7	80	70	64	59	79	69	63	59	68	62	58	67	62	58	66	61	58	56
8	76	66	59	55	75	65	59	55	64	58	54	63	58	54	62	57	54	52
9	72	62	55	51	71	61	55	51	60	55	51	59	54	51	58	54	50	49
10	68	58	52	48	67	58	52	48	57	51	47	56	51	47	55	50	47	46

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	13390
5°	12921
10°	12280
15°	11769
20°	11325
25°	10860
30°	10398
35°	7829
40°	2639
45°	1026
50°	910
55°	839
60°	770
65°	700
70°	649
75°	630
80°	596
85°	593

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 1026 cd/sqm

TEST NUMBER: P866497

CATALOG NUMBER: PRLX-2004-M-930-35L-L-U-S-X-X-BRSS-X

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	151.4	8.4
10°-20°	402.5	22.4
20°-30°	569.7	31.7
30°-40°	462.3	25.7
40°-50°	90.7	5.1
50°-60°	54.2	3.0
60°-70°	37.3	2.1
70°-80°	21.6	1.2
80°-90°	6.8	0.4
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1123.6	62.5
0°-40°	1585.9	88.3
0°-60°	1730.8	96.3
0°-90°	1796.5	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1796.5	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1683	
5°	1618	151
15°	1429	402
25°	1237	570
35°	806	462
45°	91	91
55°	60	54
65°	37	37
75°	20	22
85°	6	7
90°	0	

TEST NUMBER: P866497

CATALOG NUMBER: PRLX-2004-M-930-35L-L-U-S-X-X-BRSS-X

CANDELA DISTRIBUTION (FULL):

	0°
0°	1683.0
2.5°	1667.2
5°	1617.9
7.5°	1567.6
10°	1520.1
12.5°	1474.5
15°	1428.9
17.5°	1384.2
20°	1337.7
22.5°	1287.4
25°	1237.1
27.5°	1187.8
30°	1131.9
32.5°	1029.6
35°	806.1
37.5°	489.6
40°	254.1
42.5°	143.4
45°	91.2
47.5°	79.1
50°	73.5
52.5°	67.0
55°	60.5
57.5°	54.0
60°	48.4
62.5°	42.8
65°	37.2
67.5°	32.6
70°	27.9
72.5°	24.2
75°	20.5
77.5°	16.8
80°	13.0
82.5°	9.3
85°	6.5
87.5°	2.8
90°	0.0



TEST NUMBER: P866497
 CATALOG NUMBER: PRLX-2004-M-930-35L-L-U-S-X-X-BRSS-X

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	6.20	7.26	6.57	7.57	7.88	6.20	7.26	6.57	7.57	7.88
	3H	7.70	8.63	8.08	8.96	9.33	7.70	8.63	8.08	8.96	9.33
	4H	8.31	9.17	8.71	9.52	9.91	8.31	9.17	8.71	9.52	9.91
	6H	8.79	9.58	9.21	9.95	10.35	8.79	9.58	9.21	9.95	10.35
	8H	8.95	9.69	9.38	10.08	10.49	8.95	9.69	9.38	10.08	10.49
	12H	9.06	9.77	9.50	10.16	10.59	9.06	9.77	9.50	10.16	10.59
4H	2H	6.64	7.50	7.04	7.86	8.24	6.64	7.50	7.04	7.86	8.24
	3H	8.35	9.06	8.77	9.47	9.88	8.35	9.06	8.77	9.47	9.88
	4H	9.10	9.73	9.54	10.16	10.60	9.10	9.73	9.54	10.16	10.60
	6H	9.72	10.26	10.19	10.71	11.18	9.72	10.26	10.19	10.71	11.18
	8H	9.92	10.43	10.40	10.88	11.35	9.92	10.43	10.40	10.88	11.35
	12H	10.09	10.53	10.58	11.02	11.49	10.09	10.53	10.58	11.02	11.49
8H	4H	9.33	9.84	9.81	10.29	10.76	9.33	9.84	9.81	10.29	10.76
	6H	10.09	10.49	10.60	11.00	11.48	10.09	10.49	10.60	11.00	11.48
	8H	10.38	10.74	10.91	11.26	11.76	10.38	10.74	10.91	11.26	11.76
	12H	10.65	10.96	11.17	11.46	12.04	10.65	10.96	11.17	11.46	12.04
12H	4H	9.34	9.78	9.83	10.26	10.74	9.34	9.78	9.83	10.26	10.74
	6H	10.13	10.49	10.66	11.01	11.51	10.13	10.49	10.66	11.01	11.51
	8H	10.48	10.79	11.01	11.29	11.87	10.48	10.79	11.01	11.29	11.87