

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P866516

Luminaire Tested: PRLX-2004-M-930-65L-G-U-S-X-X-BLAK-X

Issue Date: 8/20/2024

Test Information

Test Method: LM-79-2019
Report Number: P866516
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2304-993-45)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 8/20/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: Prenalux
Catalog Number: PRLX-2004-M-930-65L-G-U-S-X-X-BLAK-X
Description: PRENATALUX 3D PRINTED PENDANT LED LUMINAIRE, MEDIUM LIGHT ENGINE, GLOBE LENS,
BELL WITH BLACK INTERIOR SHADE.
LIGHT LEVEL 7
Light Source: 3000K CCT, 90 CRI LEDS
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 843.8 lumens
Efficiency: N/A
Efficacy: 14.4 lumens/watt
Spacing Criteria (0/90/45): 1.25 / 1.25 / 1.18
Luminous Opening: Circular (Dia: 1.31' x H: 0')
CIE Type: Direct

Input Watts (W): 58.6
Input Voltage (V): 120
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: 0.333 HR
Operation Time: 3 HR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P866516

CATALOG NUMBER: PRLX-2004-M-930-65L-G-U-S-X-X-BLAK-X

Luminous Intensity Polar Plot

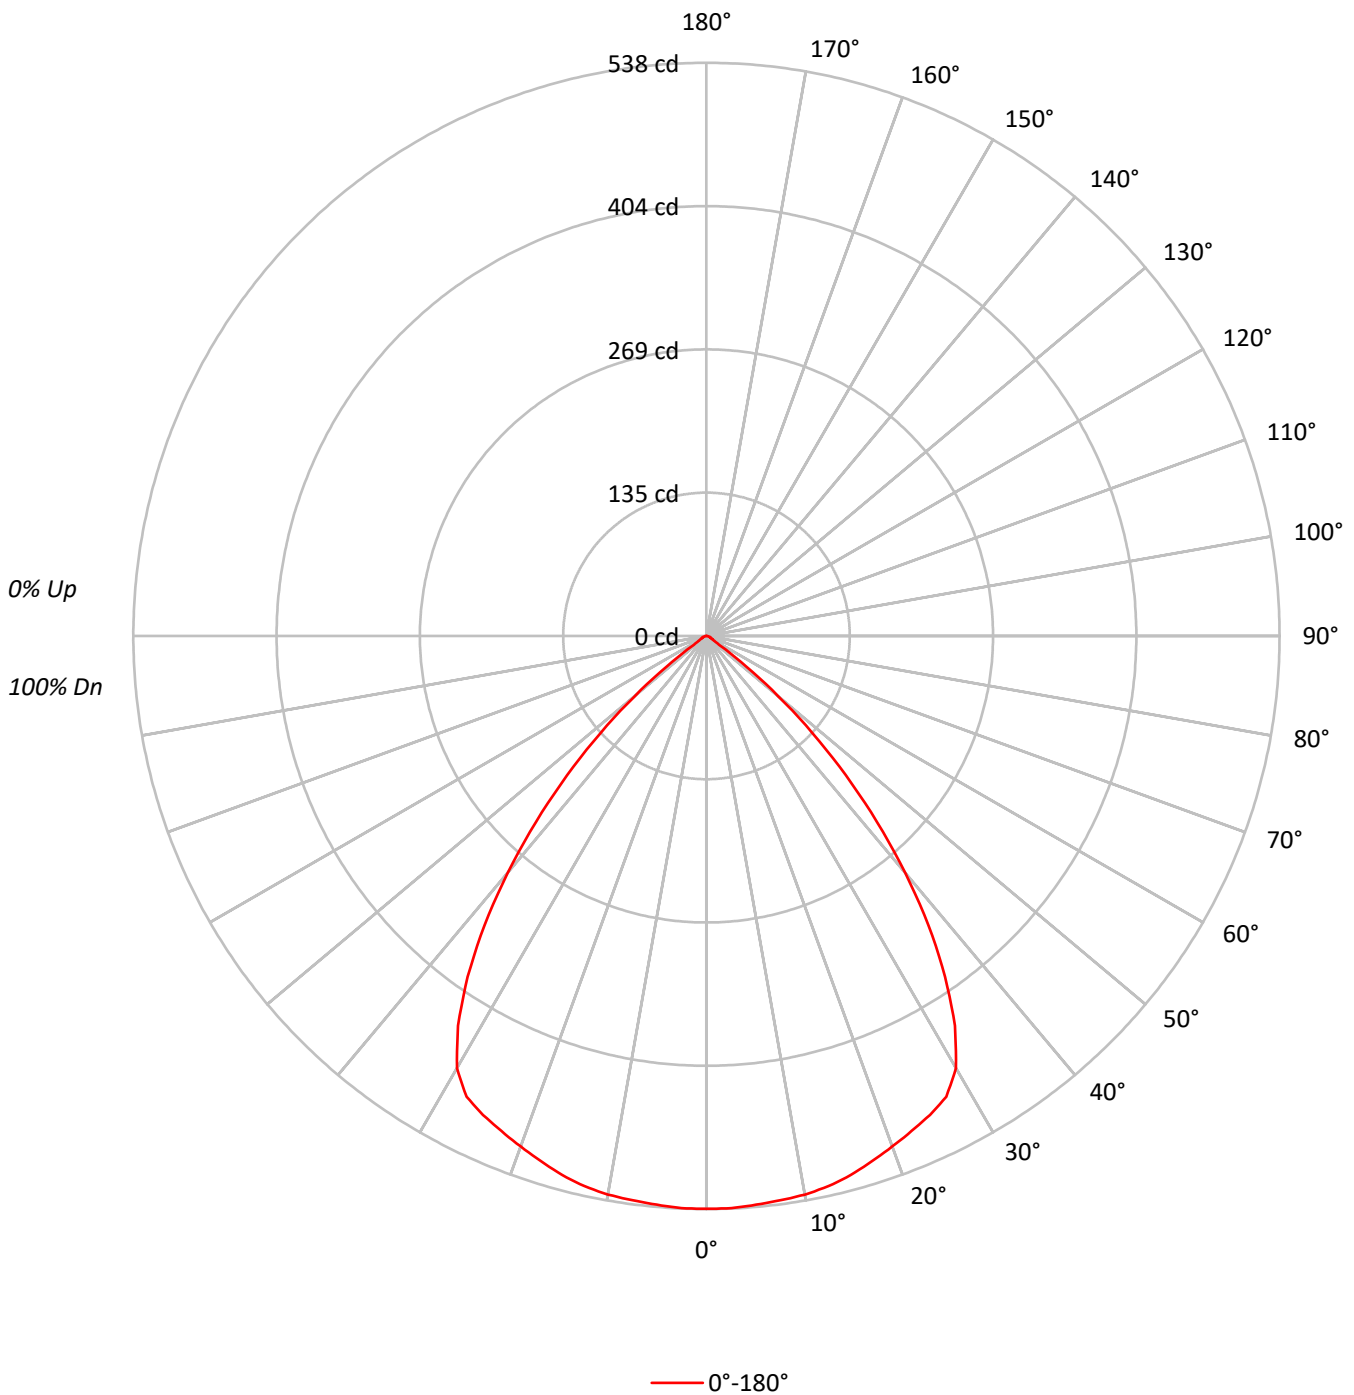



TEST NUMBER: P866516

CATALOG NUMBER: PRLX-2004-M-930-65L-G-U-S-X-X-BLAK-X

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	113	110	107	104	110	107	105	102	103	101	99	99	98	96	96	95	94	92
2	106	100	96	92	104	99	94	91	95	92	89	92	89	87	89	87	85	83
3	99	92	86	82	97	91	85	81	88	83	80	85	82	78	83	80	77	76
4	93	85	78	73	91	83	77	73	81	76	72	79	75	71	77	73	70	69
5	88	78	71	66	86	77	70	66	75	69	65	73	68	65	72	67	64	62
6	82	72	65	60	80	71	64	60	69	64	59	68	63	59	66	62	58	57
7	77	66	59	55	76	66	59	54	64	58	54	63	58	54	62	57	53	52
8	73	62	55	50	71	61	54	50	60	54	50	59	53	49	58	53	49	48
9	68	57	50	46	67	57	50	46	56	50	46	55	49	45	54	49	45	44
10	64	53	47	42	63	53	47	42	52	46	42	51	46	42	50	45	42	40

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	4278
5°	4280
10°	4302
15°	4314
20°	4318
25°	4356
30°	4304
35°	3795
40°	3016
45°	2081
50°	1092
55°	216
60°	110
65°	98
70°	81
75°	52
80°	78
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 2081 cd/sqm

TEST NUMBER: P866516

CATALOG NUMBER: PRLX-2004-M-930-65L-G-U-S-X-X-BLAK-X

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	51.0	6.1
10°-20°	147.8	17.5
20°-30°	228.2	27.0
30°-40°	240.7	28.5
40°-50°	142.3	16.9
50°-60°	25.9	3.1
60°-70°	4.7	0.6
70°-80°	2.5	0.3
80°-90°	0.7	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	427.0	50.6
0°-40°	667.7	79.1
0°-60°	835.9	99.1
0°-90°	843.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	843.8	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	538	
5°	536	51
15°	524	148
25°	496	228
35°	391	241
45°	185	142
55°	16	26
65°	5	5
75°	2	3
85°	0	1
90°	0	

TEST NUMBER: P866516

CATALOG NUMBER: PRLX-2004-M-930-65L-G-U-S-X-X-BLAK-X

CANDELA DISTRIBUTION (FULL):

	0°
0°	537.7
2.5°	537.7
5°	535.9
7.5°	534.2
10°	532.5
12.5°	529.0
15°	523.8
17.5°	516.9
20°	510.0
22.5°	503.1
25°	496.2
27.5°	487.5
30°	468.5
32.5°	433.9
35°	390.7
37.5°	342.3
40°	290.4
42.5°	236.8
45°	185.0
47.5°	134.8
50°	88.2
52.5°	46.7
55°	15.6
57.5°	8.6
60°	6.9
62.5°	5.2
65°	5.2
67.5°	3.5
70°	3.5
72.5°	3.5
75°	1.7
77.5°	1.7
80°	1.7
82.5°	1.7
85°	0.0
87.5°	0.0
90°	0.0



TEST NUMBER: P866516
 CATALOG NUMBER: PRLX-2004-M-930-65L-G-U-S-X-X-BLAK-X

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	12H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
4H	2H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	12H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
8H	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.31	0.00	0.00	0.00	0.00	0.31
	12H	0.00	0.00	0.00	0.00	0.41	0.00	0.00	0.00	0.00	0.41
12H	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.45	0.00	0.00	0.00	0.00	0.45