

Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P866530

Luminaire Tested: PRLX-2004-M-930-75L-L-U-S-X-X-GREY-X

Issue Date: 8/20/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P866530  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2304-993-56)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 8/20/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: Prenalux  
Catalog Number: PRLX-2004-M-930-75L-L-U-S-X-X-GREY-X  
Description: PRENTALUX 3D PRINTED PENDANT LED LUMINAIRE, MEDIUM LIGHT ENGINE, FLAT LENS,  
BELL WITH GRAY INTERIOR SHADE.  
LIGHT LEVEL 8  
Light Source: 3000K CCT, 90 CRI LEDS  
Ballast/Driver: -


**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 3818.6 lumens  
Efficiency: N/A  
Efficacy: 54.8 lumens/watt  
Spacing Criteria (0/90/45): 1.02 / 1.02 / 1  
Luminous Opening: Circular (Dia: 1.31' x H: 0')  
CIE Type: Direct  
  
Input Watts (W): 69.7  
Input Voltage (V): 120  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: 0.333 HR  
Operation Time: 3 HR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P866530

CATALOG NUMBER: PRLX-2004-M-930-75L-L-U-S-X-X-GREY-X

### Luminous Intensity Polar Plot

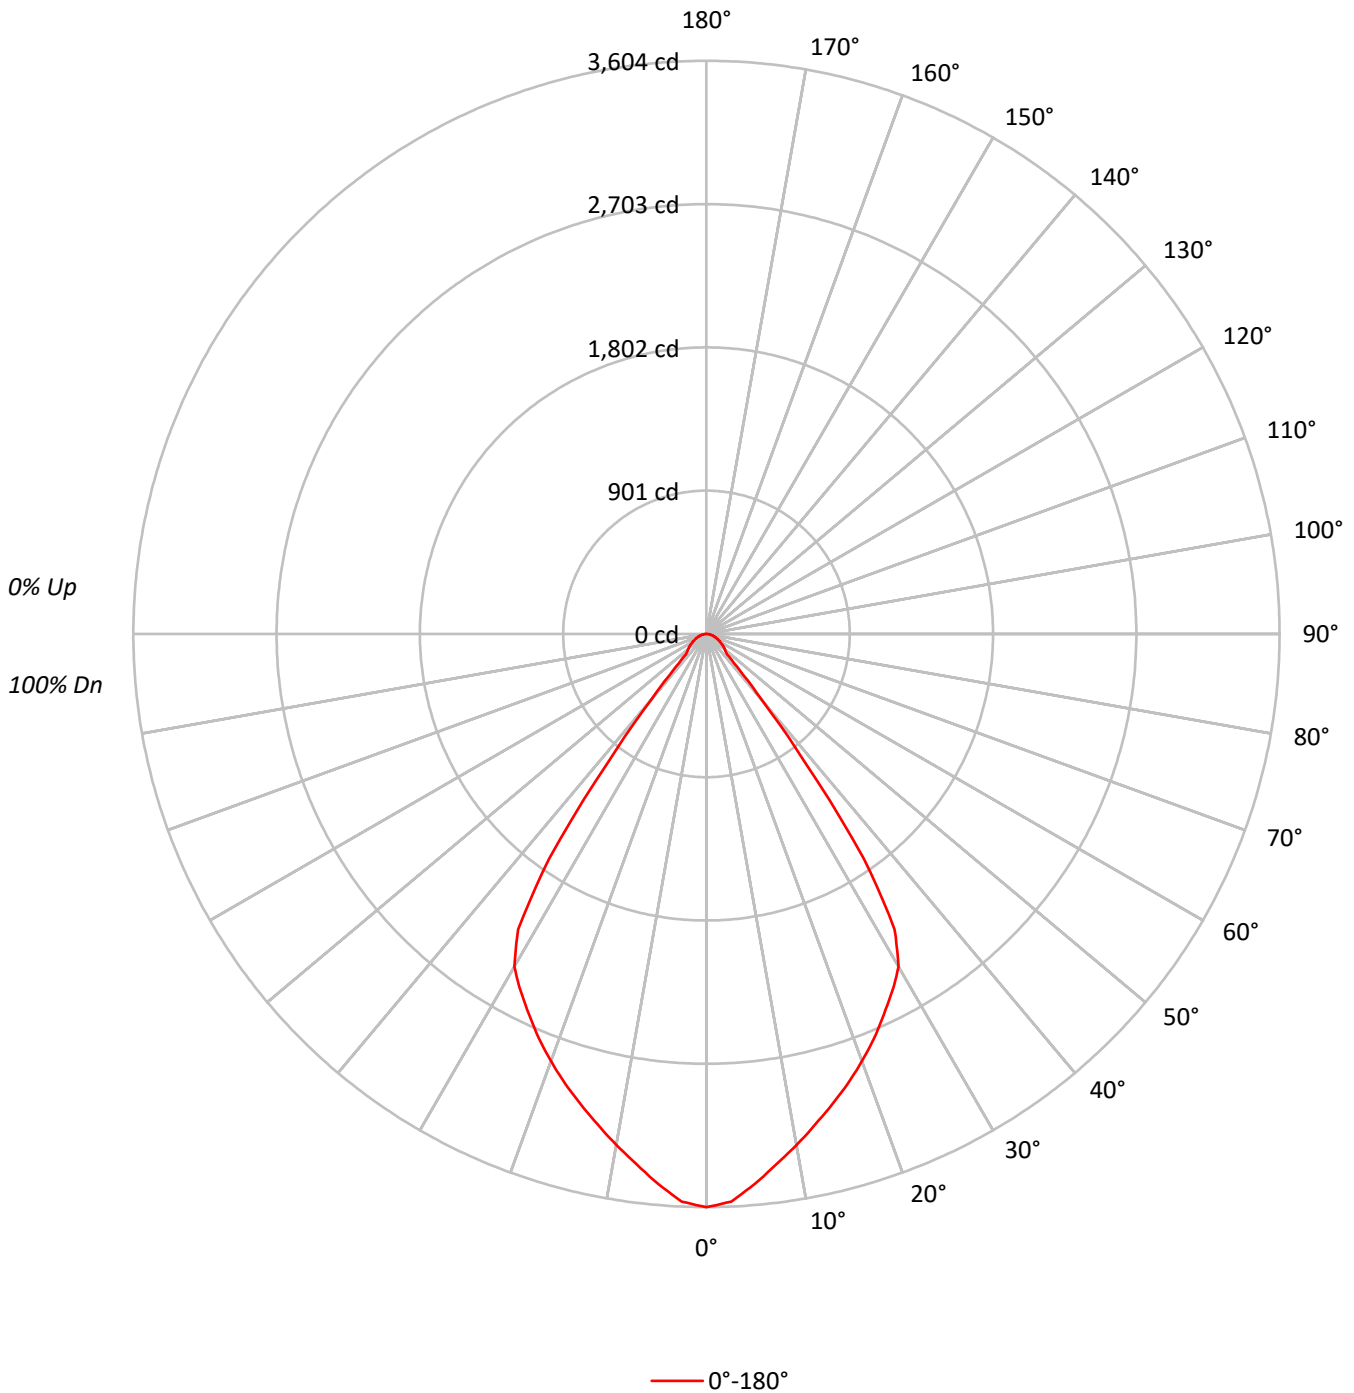



TEST NUMBER: P866530

CATALOG NUMBER: PRLX-2004-M-930-75L-L-U-S-X-X-GREY-X

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	113	110	107	104	110	107	105	103	103	101	100	100	98	97	96	95	94	92
2	106	101	97	93	104	99	95	92	96	93	90	93	90	88	90	88	86	84
3	101	93	88	84	98	92	87	83	89	85	82	87	83	80	85	82	79	77
4	95	87	81	76	93	85	80	76	83	78	75	81	77	74	79	76	73	71
5	90	81	74	70	88	80	74	69	78	73	69	76	72	68	74	71	67	66
6	85	75	69	64	83	74	68	64	73	67	63	71	67	63	70	66	62	61
7	80	70	64	59	79	70	63	59	68	63	59	67	62	58	66	61	58	57
8	76	66	59	55	75	65	59	55	64	59	55	63	58	54	62	57	54	53
9	72	62	55	51	71	61	55	51	60	55	51	59	54	51	58	54	51	49
10	68	58	52	48	67	58	52	48	57	51	48	56	51	47	55	51	47	46

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	28677
5°	27734
10°	26363
15°	25203
20°	24201
25°	23166
30°	22191
35°	16739
40°	5573
45°	2065
50°	1876
55°	1716
60°	1555
65°	1427
70°	1344
75°	1288
80°	1187
85°	1095

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 2065 cd/sqm

TEST NUMBER: P866530

CATALOG NUMBER: PRLX-2004-M-930-75L-L-U-S-X-X-GREY-X

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	324.8	8.5
10°-20°	861.8	22.6
20°-30°	1216.0	31.8
30°-40°	982.8	25.7
40°-50°	188.1	4.9
50°-60°	111.2	2.9
60°-70°	76.0	2.0
70°-80°	44.2	1.2
80°-90°	13.8	0.4
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2402.6	62.9
0°-40°	3385.3	88.7
0°-60°	3684.6	96.5
0°-90°	3818.6	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3818.6	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	3604	
5°	3473	325
15°	3060	862
25°	2639	1216
35°	1724	983
45°	184	188
55°	124	111
65°	76	76
75°	42	44
85°	12	14
90°	0	

TEST NUMBER: P866530

CATALOG NUMBER: PRLX-2004-M-930-75L-L-U-S-X-X-GREY-X

**CANDELA DISTRIBUTION (FULL):**

0°	
0°	3604.5
2.5°	3572.6
5°	3472.8
7.5°	3363.1
10°	3263.4
12.5°	3159.7
15°	3059.9
17.5°	2962.2
20°	2858.5
22.5°	2752.7
25°	2639.0
27.5°	2531.3
30°	2415.6
32.5°	2202.2
35°	1723.5
37.5°	1017.3
40°	536.6
42.5°	301.2
45°	183.5
47.5°	161.6
50°	151.6
52.5°	137.6
55°	123.7
57.5°	111.7
60°	97.7
62.5°	87.8
65°	75.8
67.5°	65.8
70°	57.8
72.5°	49.9
75°	41.9
77.5°	33.9
80°	25.9
82.5°	19.9
85°	12.0
87.5°	6.0
90°	0.0



TEST NUMBER: P866530  
 CATALOG NUMBER: PRLX-2004-M-930-75L-L-U-S-X-X-GREY-X

**CIE UGR TABLE:**

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.63	9.68	8.99	9.99	10.30	8.63	9.68	8.99	9.99	10.30
	3H	10.09	11.02	10.47	11.35	11.72	10.09	11.02	10.47	11.35	11.72
	4H	10.70	11.56	11.10	11.91	12.30	10.70	11.56	11.10	11.91	12.30
	6H	11.15	11.94	11.57	12.31	12.71	11.15	11.94	11.57	12.31	12.71
	8H	11.32	12.06	11.75	12.45	12.86	11.32	12.06	11.75	12.45	12.86
	12H	11.42	12.13	11.86	12.51	12.95	11.42	12.13	11.86	12.51	12.95
4H	2H	9.05	9.91	9.45	10.26	10.65	9.05	9.91	9.45	10.26	10.65
	3H	10.74	11.45	11.16	11.86	12.26	10.74	11.45	11.16	11.86	12.26
	4H	11.48	12.11	11.92	12.54	12.98	11.48	12.11	11.92	12.54	12.98
	6H	12.07	12.61	12.54	13.06	13.54	12.07	12.61	12.54	13.06	13.54
	8H	12.29	12.79	12.76	13.24	13.72	12.29	12.79	12.76	13.24	13.72
	12H	12.44	12.88	12.93	13.36	13.84	12.44	12.88	12.93	13.36	13.84
8H	4H	11.71	12.21	12.18	12.66	13.14	11.71	12.21	12.18	12.66	13.14
	6H	12.44	12.84	12.94	13.34	13.82	12.44	12.84	12.94	13.34	13.82
	8H	12.74	13.10	13.28	13.62	14.12	12.74	13.10	13.28	13.62	14.12
	12H	12.99	13.30	13.51	13.80	14.37	12.99	13.30	13.51	13.80	14.37
12H	4H	11.71	12.15	12.20	12.63	13.11	11.71	12.15	12.20	12.63	13.11
	6H	12.48	12.83	13.01	13.36	13.85	12.48	12.83	13.01	13.36	13.85
	8H	12.85	13.16	13.37	13.66	14.23	12.85	13.16	13.37	13.66	14.23