

Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P866572

Luminaire Tested: PRLX-2004-M-935-55L-G-U-S-X-X-BLAK-X

Issue Date: 8/20/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P866572  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2304-993-45)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 8/20/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: Pentalux  
Catalog Number: PRLX-2004-M-935-55L-G-U-S-X-X-BLAK-X  
Description: PRENTALUX 3D PRINTED PENDANT LED LUMINAIRE, MEDIUM LIGHT ENGINE, GLOBE LENS,  
BELL WITH BLACK INTERIOR SHADE.  
LIGHT LEVEL 6  
Light Source: 3500K CCT, 90 CRI LEDS  
Ballast/Driver: -


**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 728.5 lumens  
Efficiency: N/A  
Efficacy: 15.1 lumens/watt  
Spacing Criteria (0/90/45): 1.25 / 1.25 / 1.18  
Luminous Opening: Circular (Dia: 1.31' x H: 0')  
CIE Type: Direct  
  
Input Watts (W): 48.3  
Input Voltage (V): 120  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: 0.333 HR  
Operation Time: 3 HR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P866572

CATALOG NUMBER: PRLX-2004-M-935-55L-G-U-S-X-X-BLAK-X

### Luminous Intensity Polar Plot

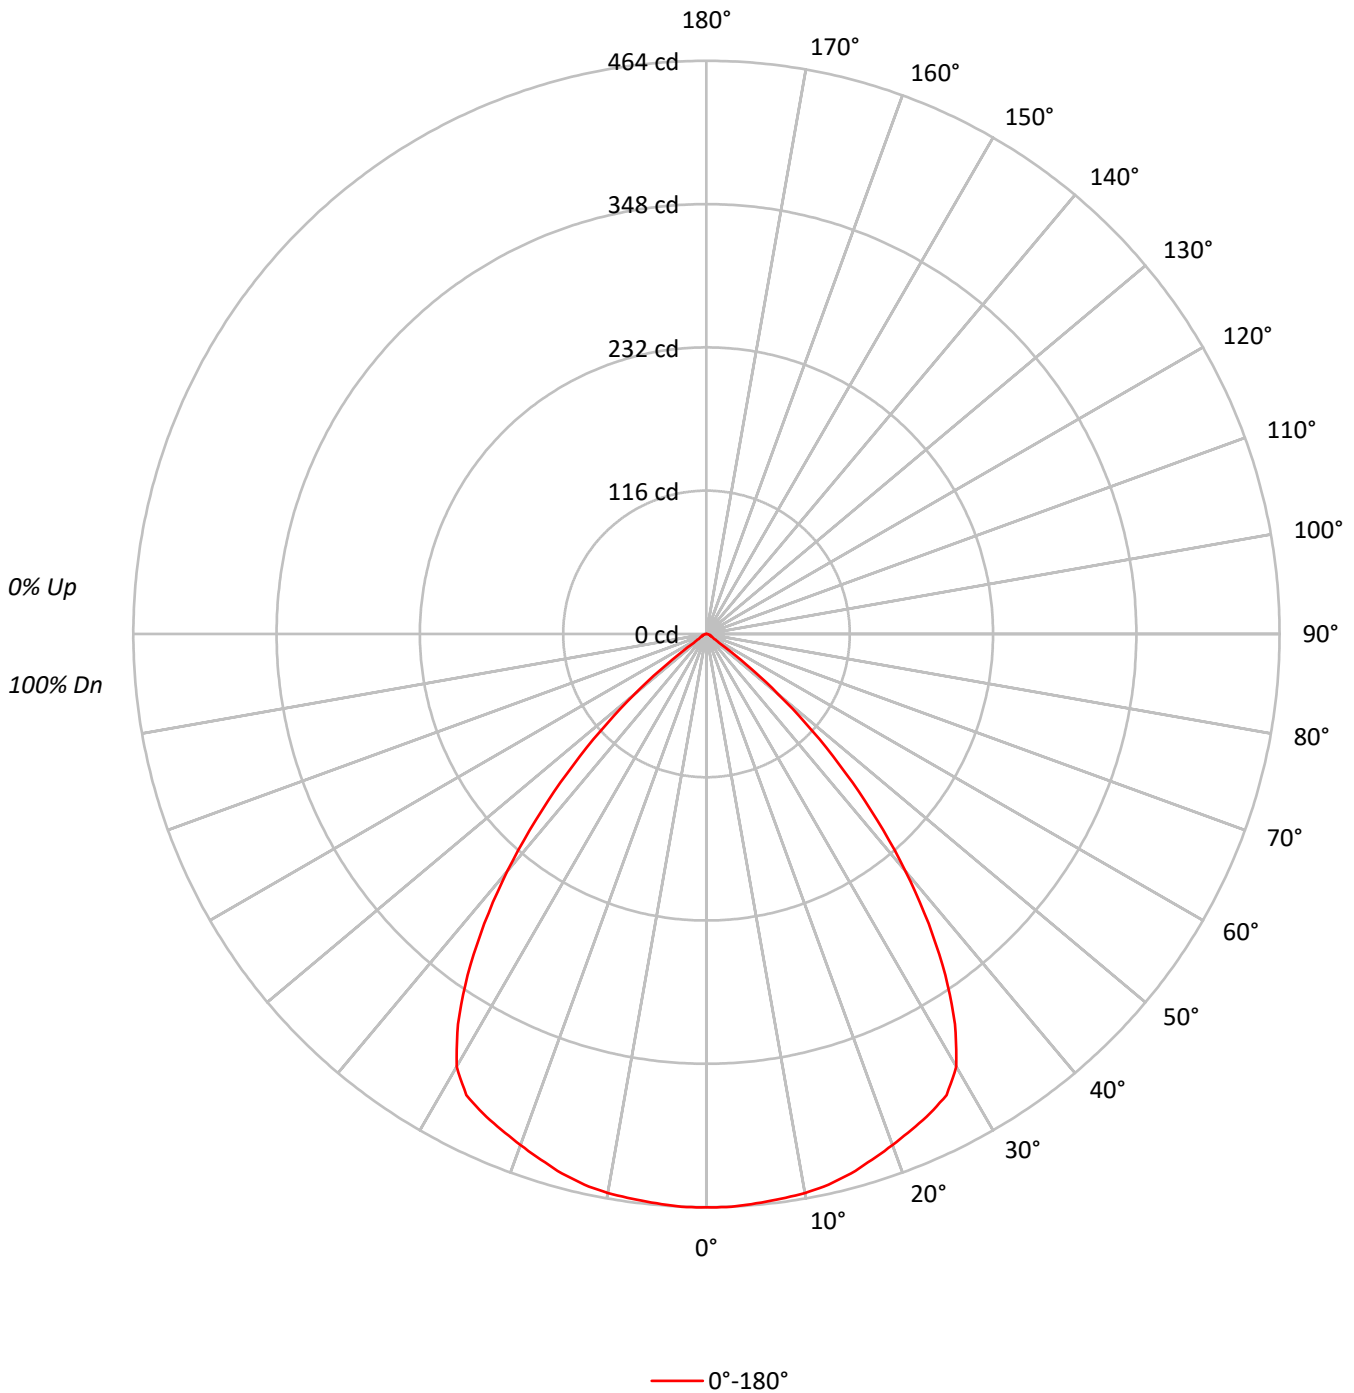



TEST NUMBER: P866572

CATALOG NUMBER: PRLX-2004-M-935-55L-G-U-S-X-X-BLAK-X

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	113	110	107	104	110	107	105	102	103	101	99	99	98	96	96	95	94	92
2	106	100	96	92	104	99	94	91	95	92	89	92	89	87	89	87	85	83
3	99	92	86	82	97	91	85	81	88	83	80	85	82	78	83	80	77	75
4	93	85	78	73	91	83	77	73	81	76	72	79	75	71	77	73	70	68
5	88	78	71	66	86	77	70	66	75	69	65	73	68	65	72	67	64	62
6	82	72	65	60	80	71	64	60	69	64	59	68	63	59	66	62	58	57
7	77	66	59	55	76	66	59	54	64	58	54	63	58	54	62	57	53	52
8	73	62	55	50	71	61	54	50	60	54	50	59	53	49	58	53	49	48
9	68	57	50	46	67	57	50	46	56	50	46	55	49	45	54	49	45	44
10	64	53	47	42	63	53	47	42	52	46	42	51	46	42	50	45	42	40

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	3693
5°	3695
10°	3714
15°	3725
20°	3728
25°	3760
30°	3716
35°	3276
40°	2604
45°	1797
50°	942
55°	186
60°	95
65°	85
70°	70
75°	46
80°	69
85°	0

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 1797 cd/sqm

TEST NUMBER: P866572

CATALOG NUMBER: PRLX-2004-M-935-55L-G-U-S-X-X-BLAK-X

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	44.1	6.1
10°-20°	127.6	17.5
20°-30°	197.0	27.0
30°-40°	207.8	28.5
40°-50°	122.8	16.9
50°-60°	22.3	3.1
60°-70°	4.1	0.6
70°-80°	2.2	0.3
80°-90°	0.6	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	368.7	50.6
0°-40°	576.4	79.1
0°-60°	721.6	99.1
0°-90°	728.5	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	728.5	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	464	
5°	463	44
15°	452	128
25°	428	197
35°	337	208
45°	160	123
55°	13	22
65°	4	4
75°	2	2
85°	0	1
90°	0	

TEST NUMBER: P866572

CATALOG NUMBER: PRLX-2004-M-935-55L-G-U-S-X-X-BLAK-X

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	464.2
2.5°	464.2
5°	462.7
7.5°	461.2
10°	459.7
12.5°	456.7
15°	452.2
17.5°	446.2
20°	440.3
22.5°	434.3
25°	428.3
27.5°	420.9
30°	404.5
32.5°	374.6
35°	337.3
37.5°	295.5
40°	250.7
42.5°	204.5
45°	159.7
47.5°	116.4
50°	76.1
52.5°	40.3
55°	13.4
57.5°	7.5
60°	6.0
62.5°	4.5
65°	4.5
67.5°	3.0
70°	3.0
72.5°	3.0
75°	1.5
77.5°	1.5
80°	1.5
82.5°	1.5
85°	0.0
87.5°	0.0
90°	0.0



TEST NUMBER: P866572  
 CATALOG NUMBER: PRLX-2004-M-935-55L-G-U-S-X-X-BLAK-X

**CIE UGR TABLE:**

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	12H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
4H	2H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	12H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
8H	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	12H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
12H	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.02	0.00	0.00	0.00	0.00	0.02