

Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P866583

Luminaire Tested: PRLX-2004-M-935-65L-G-U-S-X-X-WHHR-X

Issue Date: 8/20/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P866583  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2304-993-42)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 8/20/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: Pentalux  
Catalog Number: PRLX-2004-M-935-65L-G-U-S-X-X-WHHR-X  
Description: PRENTALUX 3D PRINTED PENDANT LED LUMINAIRE, MEDIUM LIGHT ENGINE, GLOBE LENS,  
BELL WITH WHITE INTERIOR SHADE.  
LIGHT LEVEL 7  
Light Source: 3500K CCT, 90 CRI LEDS  
Ballast/Driver: -


**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 3978.4 lumens  
Efficiency: N/A  
Efficacy: 67.9 lumens/watt  
Spacing Criteria (0/90/45): 1.2 / 1.2 / 1.2  
Luminous Opening: Circular (Dia: 1.31' x H: 0')  
CIE Type: Direct  
  
Input Watts (W): 58.6  
Input Voltage (V): 120  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: 0.5 HR  
Operation Time: 3 HR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P866583

CATALOG NUMBER: PRLX-2004-M-935-65L-G-U-S-X-X-WHHR-X

### Luminous Intensity Polar Plot

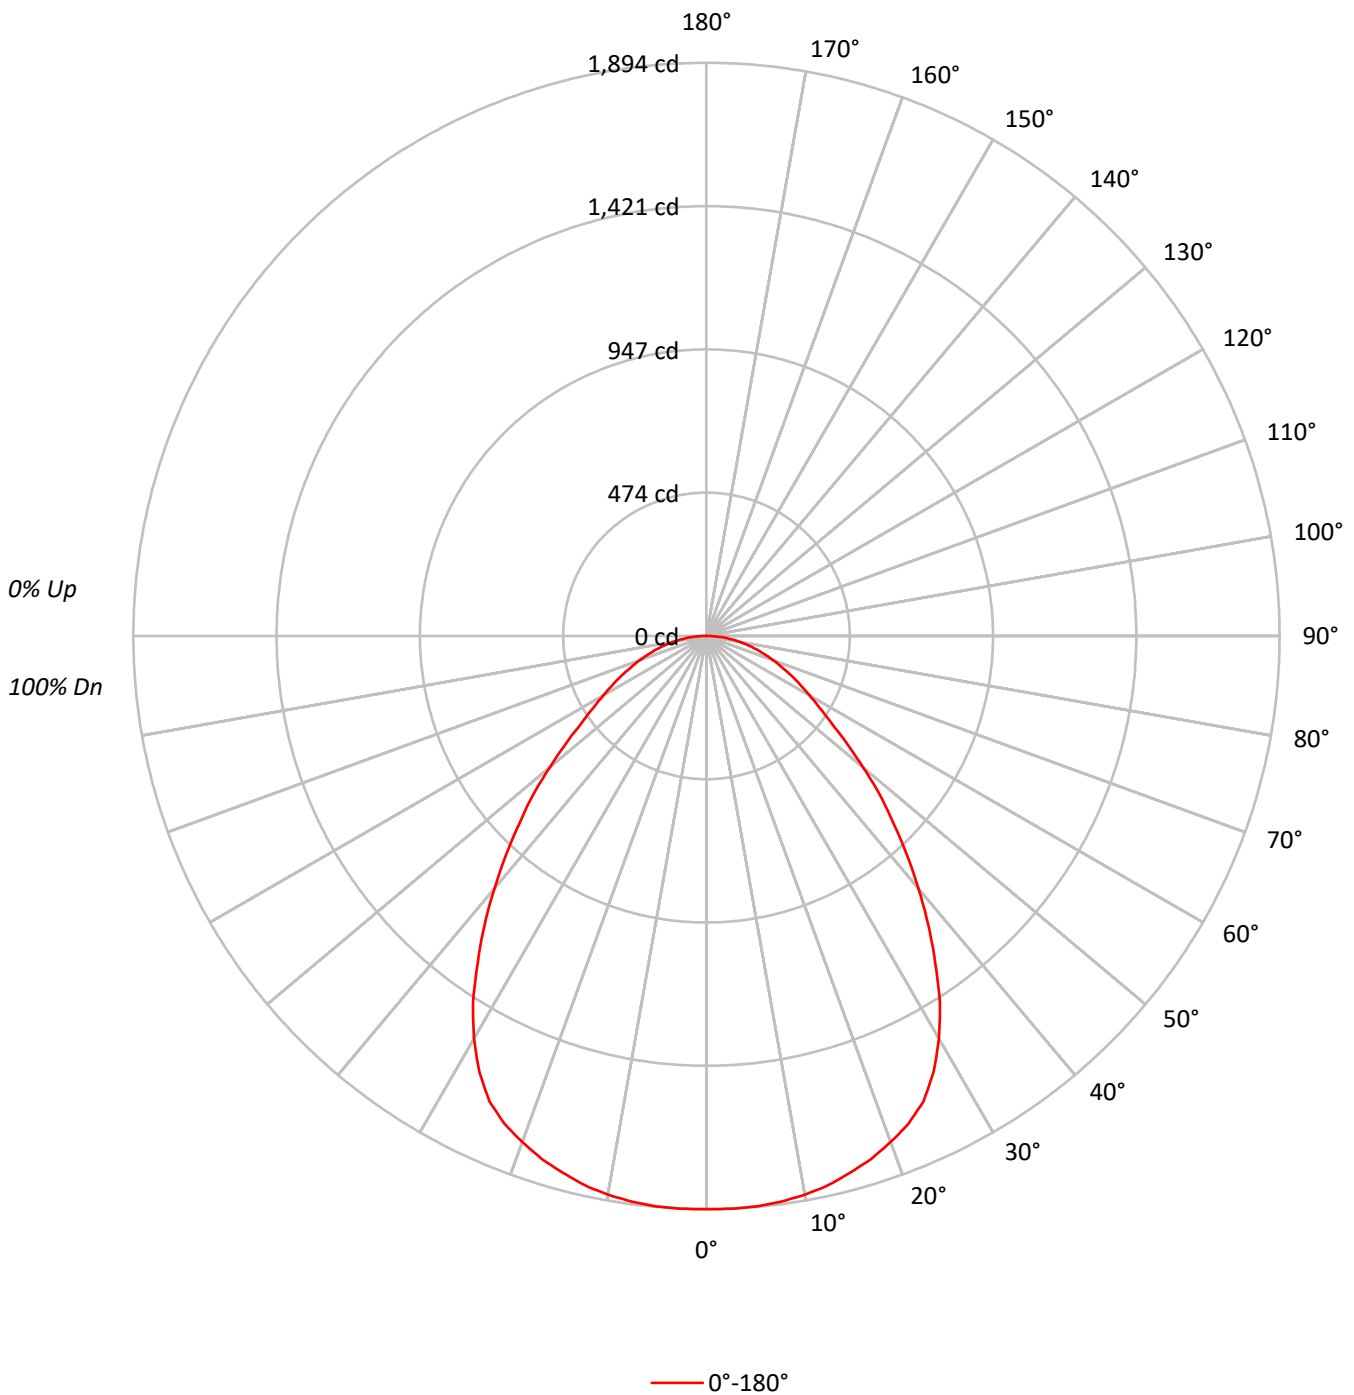



TEST NUMBER: P866583

CATALOG NUMBER: PRLX-2004-M-935-65L-G-U-S-X-X-WHHR-X

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	110	106	102	99	107	104	100	97	99	97	94	96	93	91	92	90	89	87
2	101	94	88	83	99	92	87	82	89	84	80	86	82	78	83	79	77	75
3	94	84	77	71	91	83	76	70	80	74	69	77	72	68	75	70	67	65
4	87	76	68	62	84	74	67	61	72	66	61	70	64	60	68	63	59	57
5	80	69	60	54	78	67	60	54	65	59	53	64	58	53	62	57	52	50
6	75	62	54	48	73	61	54	48	60	53	48	58	52	47	57	51	47	45
7	70	57	49	43	68	56	49	43	55	48	43	53	47	43	52	47	42	40
8	65	53	45	39	64	52	44	39	51	44	39	49	43	39	48	43	38	37
9	61	49	41	36	60	48	41	36	47	40	35	46	40	35	45	39	35	33
10	57	45	38	33	56	45	37	33	44	37	32	43	37	32	42	36	32	31

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	15071
5°	15115
10°	15146
15°	15123
20°	15068
25°	14895
30°	14113
35°	12797
40°	11320
45°	9823
50°	8361
55°	7021
60°	6258
65°	5811
70°	5457
75°	5204
80°	5012
85°	4829

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 9823 cd/sqm

TEST NUMBER: P866583

CATALOG NUMBER: PRLX-2004-M-935-65L-G-U-S-X-X-WHHR-X

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	180.1	4.5
10°-20°	518.4	13.0
20°-30°	774.8	19.5
30°-40°	822.3	20.7
40°-50°	675.4	17.0
50°-60°	462.0	11.6
60°-70°	307.1	7.7
70°-80°	179.8	4.5
80°-90°	58.6	1.5
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1473.2	37.0
0°-40°	2295.5	57.7
0°-60°	3432.9	86.3
0°-90°	3978.4	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3978.4	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	1894	
5°	1893	180
15°	1836	518
25°	1697	775
35°	1318	822
45°	873	675
55°	506	462
65°	309	307
75°	169	180
85°	53	59
90°	0	

TEST NUMBER: P866583

CATALOG NUMBER: PRLX-2004-M-935-65L-G-U-S-X-X-WHHR-X

**CANDELA DISTRIBUTION (FULL):**

0°	
0°	1894.3
2.5°	1894.3
5°	1892.6
7.5°	1885.5
10°	1874.9
12.5°	1859.1
15°	1836.1
17.5°	1811.4
20°	1779.7
22.5°	1744.4
25°	1696.8
27.5°	1624.5
30°	1536.3
32.5°	1435.7
35°	1317.6
37.5°	1204.7
40°	1090.0
42.5°	978.9
45°	873.1
47.5°	776.1
50°	675.5
52.5°	585.6
55°	506.2
57.5°	444.5
60°	393.3
62.5°	349.2
65°	308.7
67.5°	269.9
70°	234.6
72.5°	201.1
75°	169.3
77.5°	139.3
80°	109.4
82.5°	81.1
85°	52.9
87.5°	26.5
90°	0.0

TEST NUMBER: P866583  
 CATALOG NUMBER: PRLX-2004-M-935-65L-G-U-S-X-X-WHHR-X

**CIE UGR TABLE:**

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	17.55	19.03	17.92	19.34	19.65	17.55	19.03	17.92	19.34	19.65
	3H	19.14	20.46	19.51	20.79	21.15	19.14	20.46	19.51	20.79	21.15
	4H	19.78	21.01	20.18	21.36	21.74	19.78	21.01	20.18	21.36	21.74
	6H	20.30	21.44	20.71	21.81	22.20	20.30	21.44	20.71	21.81	22.20
	8H	20.49	21.58	20.92	21.97	22.37	20.49	21.58	20.92	21.97	22.37
	12H	20.63	21.67	21.06	22.05	22.48	20.63	21.67	21.06	22.05	22.48
4H	2H	18.08	19.32	18.48	19.67	20.05	18.08	19.32	18.48	19.67	20.05
	3H	19.90	20.93	20.31	21.33	21.73	19.90	20.93	20.31	21.33	21.73
	4H	20.68	21.61	21.11	22.02	22.46	20.68	21.61	21.11	22.02	22.46
	6H	21.35	22.15	21.80	22.59	23.06	21.35	22.15	21.80	22.59	23.06
	8H	21.59	22.35	22.06	22.79	23.26	21.59	22.35	22.06	22.79	23.26
	12H	21.79	22.46	22.27	22.94	23.41	21.79	22.46	22.27	22.94	23.41
8H	4H	20.97	21.73	21.44	22.17	22.64	20.97	21.73	21.44	22.17	22.64
	6H	21.78	22.40	22.28	22.89	23.37	21.78	22.40	22.28	22.89	23.37
	8H	22.11	22.67	22.63	23.18	23.67	22.11	22.67	22.63	23.18	23.67
	12H	22.40	22.90	22.91	23.39	23.96	22.40	22.90	22.91	23.39	23.96
12H	4H	21.00	21.68	21.49	22.16	22.63	21.00	21.68	21.49	22.16	22.63
	6H	21.84	22.40	22.36	22.91	23.40	21.84	22.40	22.36	22.91	23.40
	8H	22.24	22.74	22.75	23.23	23.80	22.24	22.74	22.75	23.23	23.80