

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P866586

Luminaire Tested: PRLX-2004-M-935-65L-L-U-S-X-X-GREY-X

Issue Date: 8/20/2024

Test Information

Test Method: LM-79-2019
Report Number: P866586
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2304-993-56)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 8/20/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: Prenalux
Catalog Number: PRLX-2004-M-935-65L-L-U-S-X-X-GREY-X
Description: PRENTALUX 3D PRINTED PENDANT LED LUMINAIRE, MEDIUM LIGHT ENGINE, FLAT LENS,
BELL WITH GRAY INTERIOR SHADE.
LIGHT LEVEL 7
Light Source: 3500K CCT, 90 CRI LEDS
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 3376.5 lumens
Efficiency: N/A
Efficacy: 57.6 lumens/watt
Spacing Criteria (0/90/45): 1.02 / 1.02 / 1
Luminous Opening: Circular (Dia: 1.31' x H: 0')
CIE Type: Direct

Input Watts (W): 58.6
Input Voltage (V): 120
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: 0.333 HR
Operation Time: 3 HR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P866586

CATALOG NUMBER: PRLX-2004-M-935-65L-L-U-S-X-X-GREY-X

Luminous Intensity Polar Plot

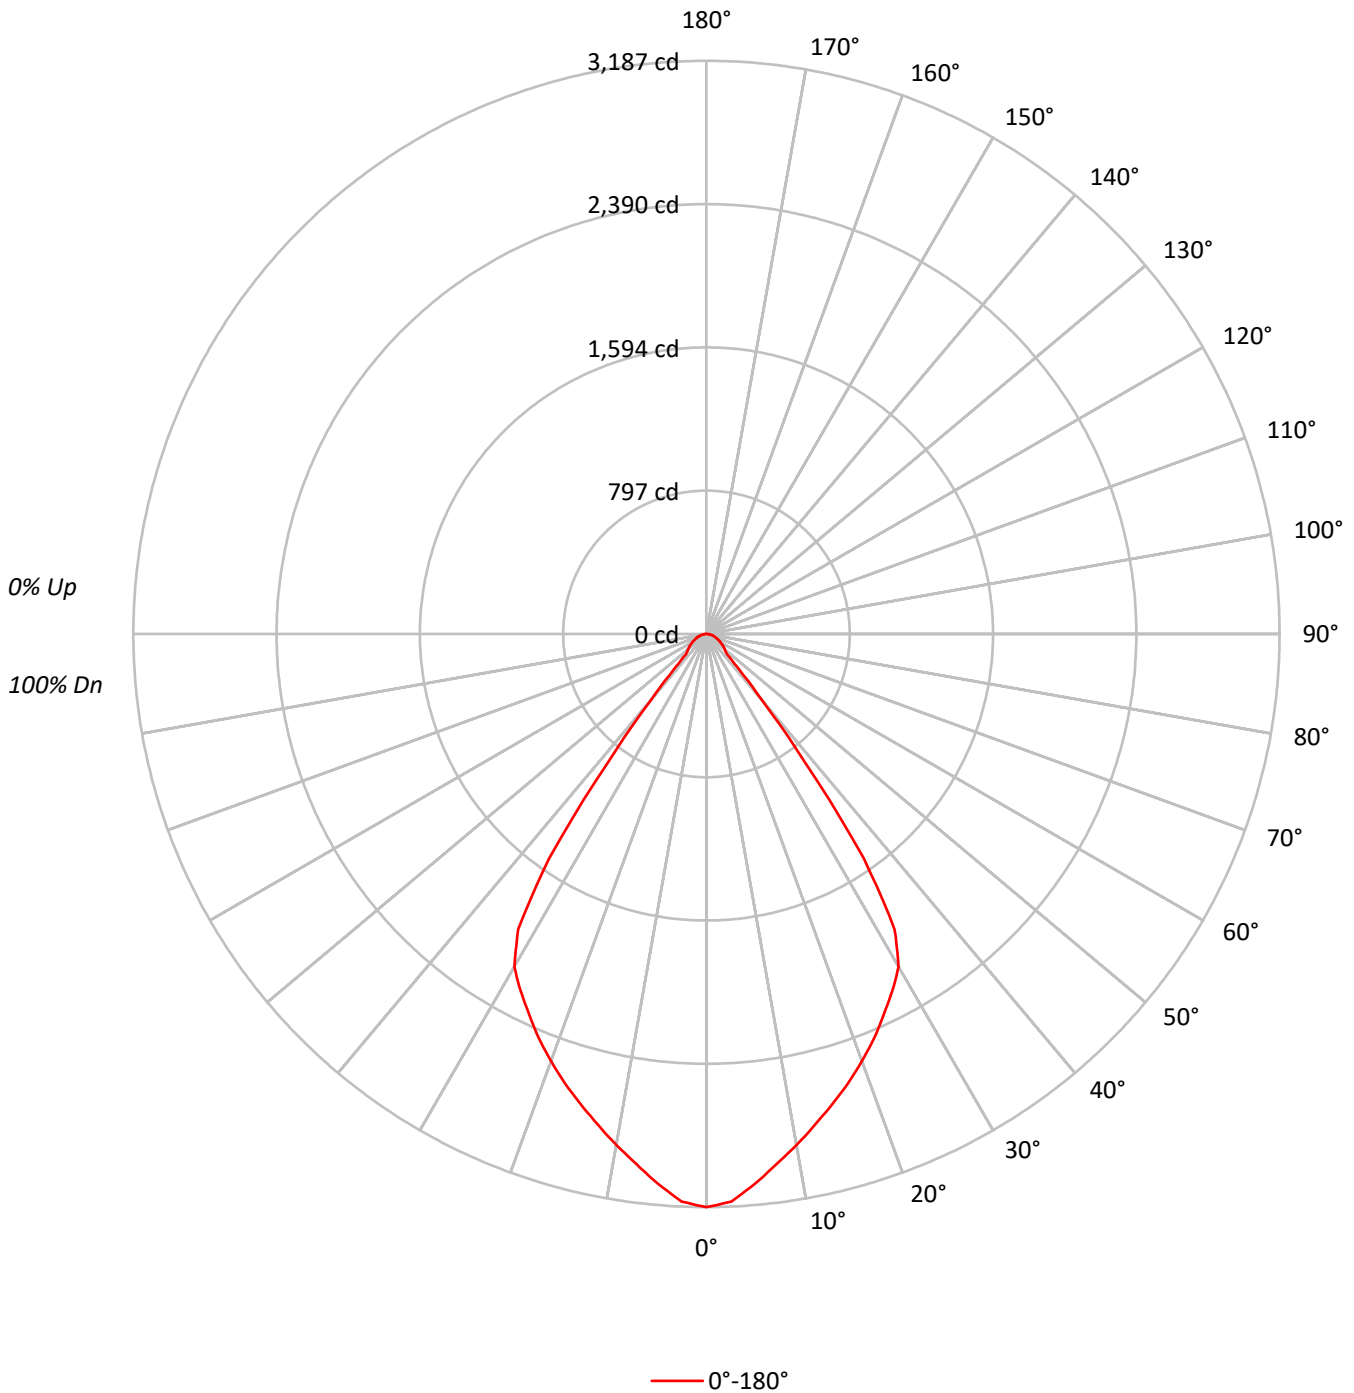



TEST NUMBER: P866586

CATALOG NUMBER: PRLX-2004-M-935-65L-L-U-S-X-X-GREY-X

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	113	110	107	104	110	107	105	103	103	101	100	100	98	97	96	95	94	92
2	106	101	97	93	104	99	95	92	96	93	90	93	90	88	90	88	86	84
3	101	93	88	84	98	92	87	83	89	85	82	87	83	80	85	82	79	77
4	95	87	81	76	93	85	80	76	83	78	75	81	77	74	79	76	73	71
5	90	81	74	70	88	80	74	69	78	73	69	76	72	68	74	71	67	66
6	85	75	69	64	83	74	68	64	73	67	63	71	67	63	70	66	62	61
7	80	70	64	59	79	70	63	59	68	63	59	67	62	58	66	61	58	57
8	76	66	59	55	75	65	59	55	64	59	55	63	58	54	62	57	54	53
9	72	62	55	51	71	61	55	51	60	55	51	59	54	51	58	54	51	49
10	68	58	52	48	67	58	52	48	57	51	48	56	51	47	55	51	47	46

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	25357
5°	24524
10°	23311
15°	22285
20°	21399
25°	20484
30°	19622
35°	14800
40°	4928
45°	1826
50°	1659
55°	1517
60°	1375
65°	1261
70°	1191
75°	1137
80°	1049
85°	968

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 1826 cd/sqm

TEST NUMBER: P866586

CATALOG NUMBER: PRLX-2004-M-935-65L-L-U-S-X-X-GREY-X

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	287.2	8.5
10°-20°	762.0	22.6
20°-30°	1075.2	31.8
30°-40°	869.0	25.7
40°-50°	166.3	4.9
50°-60°	98.3	2.9
60°-70°	67.2	2.0
70°-80°	39.1	1.2
80°-90°	12.2	0.4
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2124.5	62.9
0°-40°	2993.4	88.7
0°-60°	3258.1	96.5
0°-90°	3376.5	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3376.5	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	3187	
5°	3071	287
15°	2706	762
25°	2334	1075
35°	1524	869
45°	162	166
55°	109	98
65°	67	67
75°	37	39
85°	11	12
90°	0	

TEST NUMBER: P866586

CATALOG NUMBER: PRLX-2004-M-935-65L-L-U-S-X-X-GREY-X

CANDELA DISTRIBUTION (FULL):

	0°
0°	3187.2
2.5°	3159.0
5°	3070.8
7.5°	2973.8
10°	2885.6
12.5°	2793.9
15°	2705.7
17.5°	2619.3
20°	2527.5
22.5°	2434.1
25°	2333.5
27.5°	2238.3
30°	2136.0
32.5°	1947.2
35°	1523.9
37.5°	899.5
40°	474.5
42.5°	266.3
45°	162.3
47.5°	142.9
50°	134.0
52.5°	121.7
55°	109.4
57.5°	98.8
60°	86.4
62.5°	77.6
65°	67.0
67.5°	58.2
70°	51.2
72.5°	44.1
75°	37.0
77.5°	30.0
80°	22.9
82.5°	17.6
85°	10.6
87.5°	5.3
90°	0.0

TEST NUMBER: P866586
 CATALOG NUMBER: PRLX-2004-M-935-65L-L-U-S-X-X-GREY-X

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.20	9.25	8.57	9.56	9.88	8.20	9.25	8.57	9.56	9.88
	3H	9.66	10.59	10.05	10.92	11.29	9.66	10.59	10.05	10.92	11.29
	4H	10.27	11.13	10.68	11.48	11.87	10.27	11.13	10.68	11.48	11.87
	6H	10.73	11.51	11.14	11.89	12.28	10.73	11.51	11.14	11.89	12.28
	8H	10.89	11.63	11.33	12.03	12.43	10.89	11.63	11.33	12.03	12.43
	12H	11.00	11.70	11.43	12.09	12.52	11.00	11.70	11.43	12.09	12.52
4H	2H	8.62	9.48	9.03	9.83	10.22	8.62	9.48	9.03	9.83	10.22
	3H	10.32	11.02	10.74	11.43	11.84	10.32	11.02	10.74	11.43	11.84
	4H	11.06	11.69	11.49	12.11	12.56	11.06	11.69	11.49	12.11	12.56
	6H	11.65	12.19	12.12	12.64	13.11	11.65	12.19	12.12	12.64	13.11
	8H	11.86	12.37	12.34	12.82	13.29	11.86	12.37	12.34	12.82	13.29
	12H	12.01	12.45	12.50	12.94	13.41	12.01	12.45	12.50	12.94	13.41
8H	4H	11.28	11.79	11.76	12.24	12.71	11.28	11.79	11.76	12.24	12.71
	6H	12.01	12.41	12.52	12.91	13.40	12.01	12.41	12.52	12.91	13.40
	8H	12.32	12.68	12.85	13.20	13.69	12.32	12.68	12.85	13.20	13.69
	12H	12.56	12.87	13.08	13.37	13.95	12.56	12.87	13.08	13.37	13.95
12H	4H	11.28	11.72	11.77	12.21	12.69	11.28	11.72	11.77	12.21	12.69
	6H	12.05	12.41	12.58	12.93	13.43	12.05	12.41	12.58	12.93	13.43
	8H	12.42	12.73	12.94	13.23	13.81	12.42	12.73	12.94	13.23	13.81