

Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P866620

Luminaire Tested: PRLX-2004-M-940-35L-G-U-S-X-X-BLAK-X

Issue Date: 8/20/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P866620  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2304-993-45)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 8/20/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: Prenalux  
Catalog Number: PRLX-2004-M-940-35L-G-U-S-X-X-BLAK-X  
Description: PRENTALUX 3D PRINTED PENDANT LED LUMINAIRE, MEDIUM LIGHT ENGINE, GLOBE LENS,  
BELL WITH BLACK INTERIOR SHADE.  
LIGHT LEVEL 4  
Light Source: 4000K CCT, 90 CRI LEDS  
Ballast/Driver: -


**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 490.6 lumens  
Efficiency: N/A  
Efficacy: 16.4 lumens/watt  
Spacing Criteria (0/90/45): 1.25 / 1.25 / 1.18  
Luminous Opening: Circular (Dia: 1.31' x H: 0')  
CIE Type: Direct  
  
Input Watts (W): 30  
Input Voltage (V): 120  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: 0.333 HR  
Operation Time: 3 HR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P866620

CATALOG NUMBER: PRLX-2004-M-940-35L-G-U-S-X-X-BLAK-X

### Luminous Intensity Polar Plot

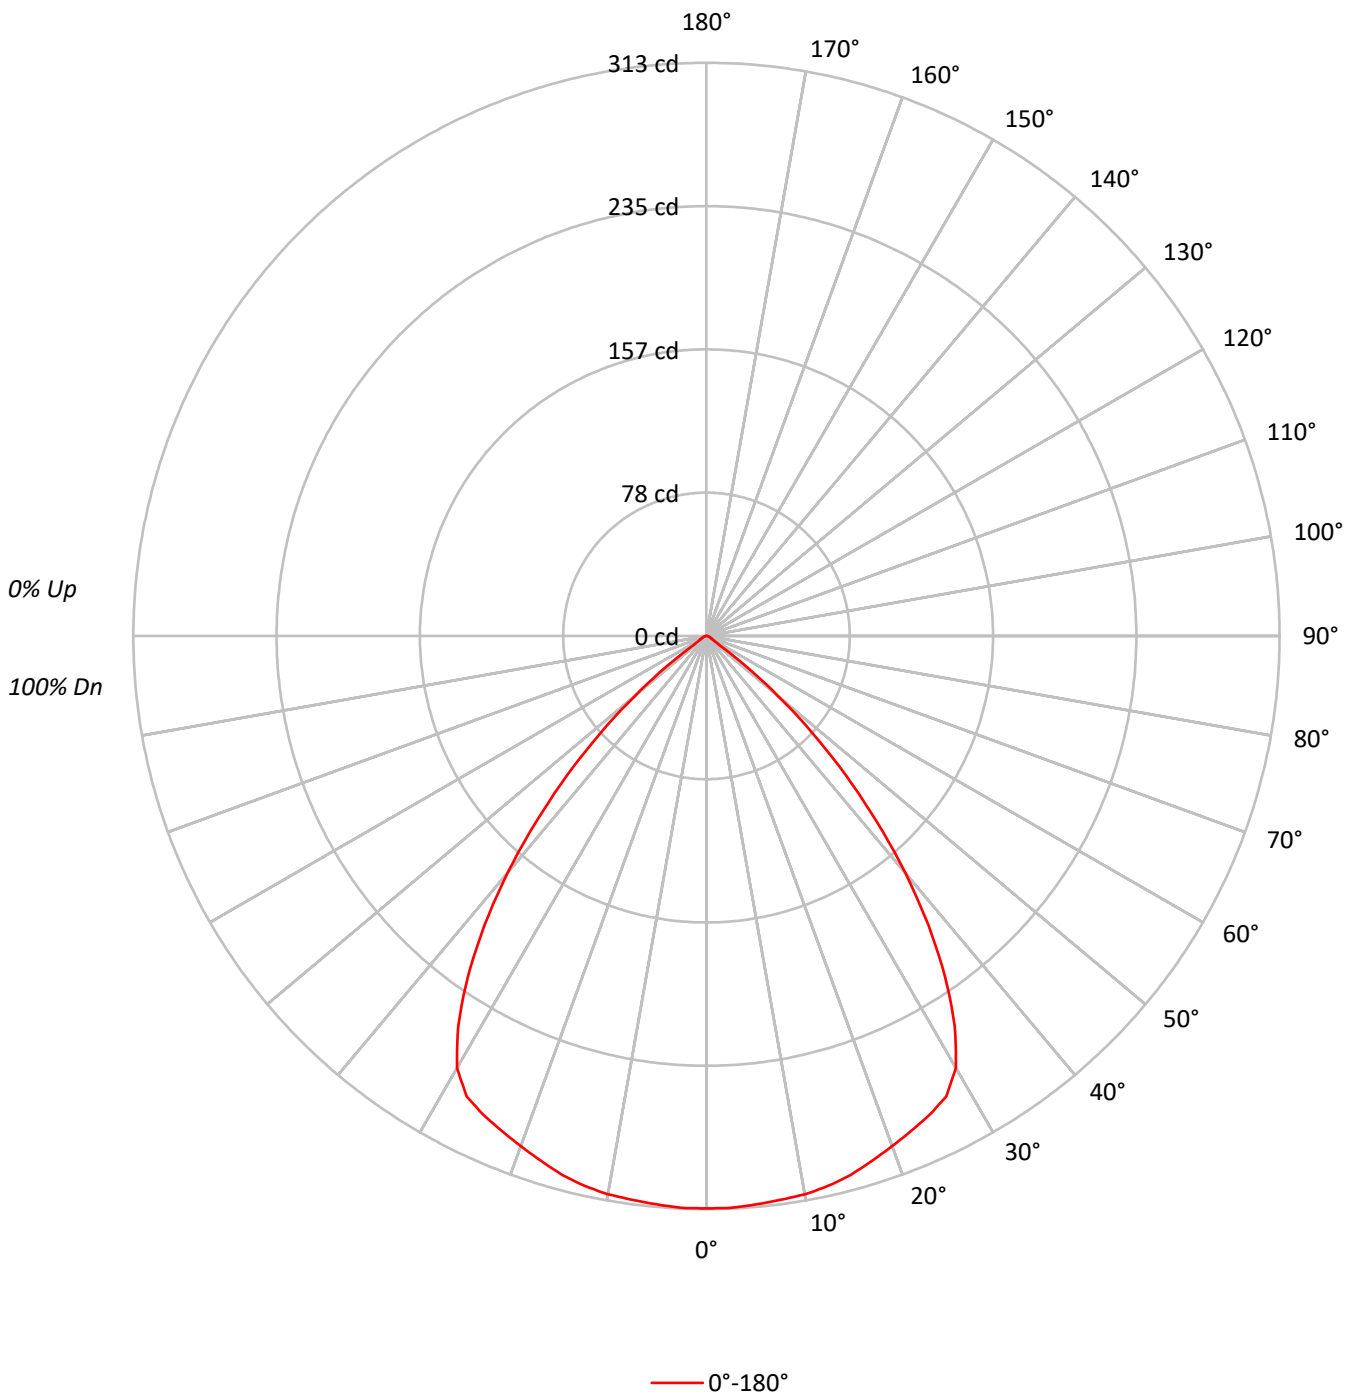



TEST NUMBER: P866620

CATALOG NUMBER: PRLX-2004-M-940-35L-G-U-S-X-X-BLAK-X

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20			
RC	80				70				50				30				10	0		
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50	30	10	0
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102	102	102	100
1	113	110	107	104	110	107	105	102	103	101	99		99	98	96		96	95	94	92
2	106	100	96	92	104	99	94	91	95	92	89		92	89	87		89	87	85	83
3	99	92	86	82	97	91	85	81	88	83	80		85	82	78		83	80	77	76
4	93	85	78	73	91	83	77	73	81	76	72		79	75	71		77	73	70	69
5	88	78	71	66	86	77	70	66	75	69	65		73	68	65		72	67	64	62
6	82	72	65	60	80	71	64	60	69	64	59		68	63	59		66	62	58	57
7	77	66	59	55	76	66	59	54	64	58	54		63	58	54		62	57	53	52
8	73	62	55	50	71	61	54	50	60	54	50		59	53	49		58	53	49	48
9	68	57	50	46	67	57	50	46	56	50	46		55	49	45		54	49	45	44
10	64	53	47	42	63	53	47	42	52	46	42		51	46	42		50	45	42	40

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	2487
5°	2488
10°	2501
15°	2509
20°	2510
25°	2533
30°	2502
35°	2207
40°	1754
45°	1211
50°	635
55°	125
60°	64
65°	56
70°	47
75°	31
80°	46
85°	0

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 1211 cd/sqm

TEST NUMBER: P866620

CATALOG NUMBER: PRLX-2004-M-940-35L-G-U-S-X-X-BLAK-X

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	29.7	6.1
10°-20°	86.0	17.5
20°-30°	132.7	27.0
30°-40°	139.9	28.5
40°-50°	82.7	16.9
50°-60°	15.0	3.1
60°-70°	2.7	0.6
70°-80°	1.4	0.3
80°-90°	0.4	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	248.3	50.6
0°-40°	388.2	79.1
0°-60°	486.0	99.1
0°-90°	490.6	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	490.6	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	313	
5°	312	30
15°	305	86
25°	288	133
35°	227	140
45°	108	83
55°	9	15
65°	3	3
75°	1	1
85°	0	0
90°	0	

TEST NUMBER: P866620

CATALOG NUMBER: PRLX-2004-M-940-35L-G-U-S-X-X-BLAK-X

**CANDELA DISTRIBUTION (FULL):**

0°	
0°	312.6
2.5°	312.6
5°	311.6
7.5°	310.6
10°	309.6
12.5°	307.6
15°	304.6
17.5°	300.6
20°	296.5
22.5°	292.5
25°	288.5
27.5°	283.5
30°	272.4
32.5°	252.3
35°	227.2
37.5°	199.0
40°	168.9
42.5°	137.7
45°	107.6
47.5°	78.4
50°	51.3
52.5°	27.1
55°	9.0
57.5°	5.0
60°	4.0
62.5°	3.0
65°	3.0
67.5°	2.0
70°	2.0
72.5°	2.0
75°	1.0
77.5°	1.0
80°	1.0
82.5°	1.0
85°	0.0
87.5°	0.0
90°	0.0



TEST NUMBER: P866620  
 CATALOG NUMBER: PRLX-2004-M-940-35L-G-U-S-X-X-BLAK-X

**CIE UGR TABLE:**

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	12H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
4H	2H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	3H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	12H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
8H	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	12H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
12H	4H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	6H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	8H	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00