

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P866649

Luminaire Tested: PRLX-2004-M-940-65L-L-U-S-X-X-BRSS-X

Issue Date: 8/20/2024

Test Information

Test Method: LM-79-2019
Report Number: P866649
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2304-993-55)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 8/20/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: Prenalux
Catalog Number: PRLX-2004-M-940-65L-L-U-S-X-X-BRSS-X
Description: PRENTALUX 3D PRINTED PENDANT LED LUMINAIRE, MEDIUM LIGHT ENGINE, FLAT LENS,
BELL WITH BRASS INTERIOR SHADE.
LIGHT LEVEL 7
Light Source: 4000K CCT, 90 CRI LEDS
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 3602.9 lumens
Efficiency: N/A
Efficacy: 61.5 lumens/watt
Spacing Criteria (0/90/45): 1.03 / 1.03 / 1
Luminous Opening: Circular (Dia: 1.31' x H: 0')
CIE Type: Direct

Input Watts (W): 58.6
Input Voltage (V): 120
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: 0.5 HR
Operation Time: 3 HR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P866649

CATALOG NUMBER: PRLX-2004-M-940-65L-L-U-S-X-X-BRSS-X

Luminous Intensity Polar Plot

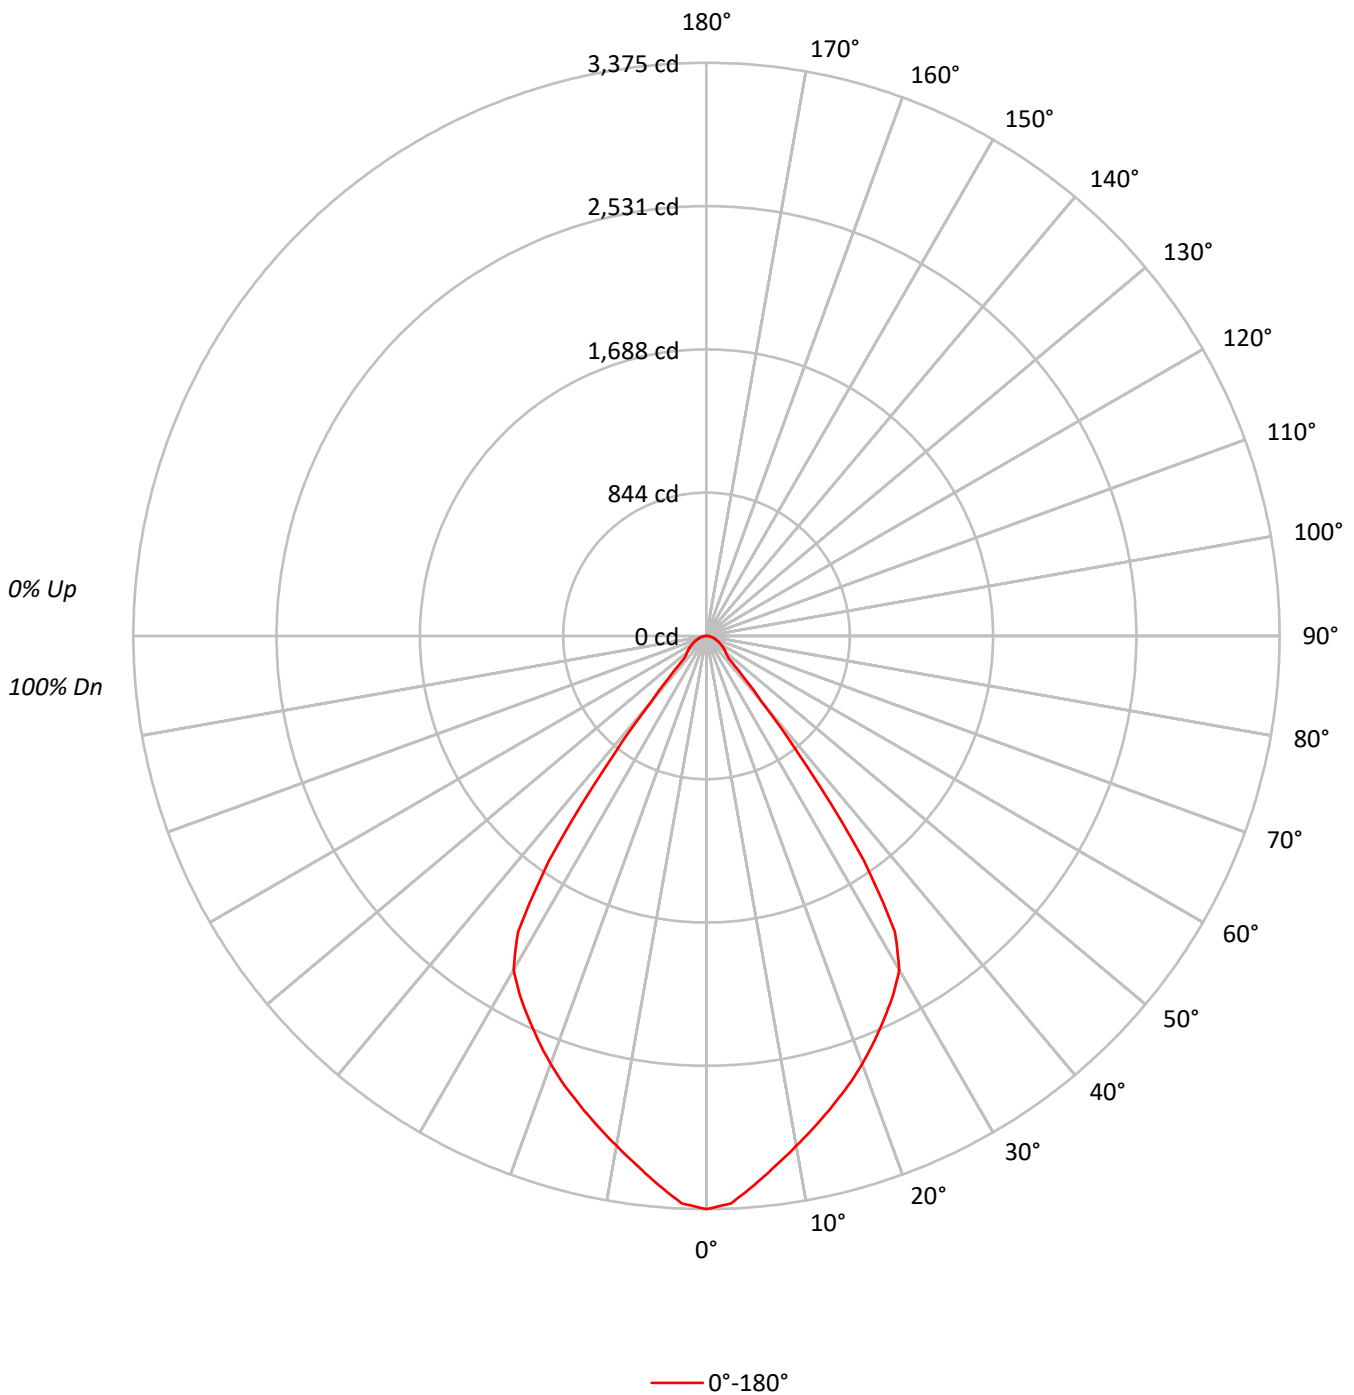



TEST NUMBER: P866649

CATALOG NUMBER: PRLX-2004-M-940-65L-L-U-S-X-X-BRSS-X

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	113	110	107	104	110	107	105	103	103	101	99	100	98	97	96	95	94	92
2	106	101	96	93	104	99	95	92	96	93	90	93	90	88	90	88	86	84
3	100	93	88	83	98	92	87	83	89	85	81	87	83	80	84	81	79	77
4	95	87	80	76	93	85	80	75	83	78	74	81	77	74	79	76	73	71
5	90	80	74	69	88	79	73	69	78	72	68	76	71	68	74	70	67	66
6	85	75	68	64	83	74	68	64	73	67	63	71	66	63	70	66	62	61
7	80	70	64	59	79	69	63	59	68	62	58	67	62	58	66	61	58	56
8	76	66	59	55	75	65	59	55	64	58	54	63	58	54	62	57	54	52
9	72	62	55	51	71	61	55	51	60	55	51	59	54	51	58	54	50	49
10	68	58	52	48	67	58	52	48	57	51	47	56	51	47	55	50	47	46

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	26852
5°	25911
10°	24627
15°	23602
20°	22712
25°	21779
30°	20853
35°	15702
40°	5292
45°	2058
50°	1826
55°	1682
60°	1545
65°	1406
70°	1303
75°	1263
80°	1196
85°	1196

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 2058 cd/sqm

TEST NUMBER: P866649

CATALOG NUMBER: PRLX-2004-M-940-65L-L-U-S-X-X-BRSS-X

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	303.6	8.4
10°-20°	807.2	22.4
20°-30°	1142.5	31.7
30°-40°	927.1	25.7
40°-50°	182.0	5.1
50°-60°	108.6	3.0
60°-70°	74.8	2.1
70°-80°	43.3	1.2
80°-90°	13.7	0.4
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2253.3	62.5
0°-40°	3180.4	88.3
0°-60°	3471.1	96.3
0°-90°	3602.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3602.9	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	3375	
5°	3244	304
15°	2866	807
25°	2481	1143
35°	1617	927
45°	183	182
55°	121	109
65°	75	75
75°	41	43
85°	13	14
90°	0	

TEST NUMBER: P866649

CATALOG NUMBER: PRLX-2004-M-940-65L-L-U-S-X-X-BRSS-X

CANDELA DISTRIBUTION (FULL):

	0°
0°	3375.2
2.5°	3343.5
5°	3244.5
7.5°	3143.7
10°	3048.5
12.5°	2957.0
15°	2865.6
17.5°	2776.0
20°	2682.6
22.5°	2581.8
25°	2481.0
27.5°	2382.1
30°	2270.0
32.5°	2064.7
35°	1616.7
37.5°	981.9
40°	509.6
42.5°	287.5
45°	182.9
47.5°	158.7
50°	147.5
52.5°	134.4
55°	121.3
57.5°	108.3
60°	97.1
62.5°	85.9
65°	74.7
67.5°	65.3
70°	56.0
72.5°	48.5
75°	41.1
77.5°	33.6
80°	26.1
82.5°	18.7
85°	13.1
87.5°	5.6
90°	0.0

TEST NUMBER: P866649
 CATALOG NUMBER: PRLX-2004-M-940-65L-L-U-S-X-X-BRSS-X

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	8.62	9.67	8.98	9.99	10.30	8.62	9.67	8.98	9.99	10.30
	3H	10.11	11.04	10.49	11.38	11.75	10.11	11.04	10.49	11.38	11.75
	4H	10.72	11.59	11.13	11.94	12.33	10.72	11.59	11.13	11.94	12.33
	6H	11.20	11.99	11.62	12.37	12.77	11.20	11.99	11.62	12.37	12.77
	8H	11.36	12.11	11.80	12.50	12.91	11.36	12.11	11.80	12.50	12.91
	12H	11.48	12.19	11.91	12.58	13.01	11.48	12.19	11.91	12.58	13.01
4H	2H	9.06	9.92	9.46	10.28	10.66	9.06	9.92	9.46	10.28	10.66
	3H	10.77	11.48	11.19	11.89	12.29	10.77	11.48	11.19	11.89	12.29
	4H	11.52	12.15	11.95	12.57	13.02	11.52	12.15	11.95	12.57	13.02
	6H	12.13	12.68	12.60	13.13	13.60	12.13	12.68	12.60	13.13	13.60
	8H	12.34	12.85	12.81	13.30	13.77	12.34	12.85	12.81	13.30	13.77
	12H	12.51	12.95	13.00	13.43	13.91	12.51	12.95	13.00	13.43	13.91
8H	4H	11.75	12.25	12.22	12.70	13.18	11.75	12.25	12.22	12.70	13.18
	6H	12.51	12.91	13.01	13.41	13.90	12.51	12.91	13.01	13.41	13.90
	8H	12.80	13.16	13.33	13.68	14.18	12.80	13.16	13.33	13.68	14.18
	12H	13.07	13.38	13.59	13.88	14.46	13.07	13.38	13.59	13.88	14.46
12H	4H	11.75	12.19	12.24	12.68	13.16	11.75	12.19	12.24	12.68	13.16
	6H	12.55	12.91	13.08	13.43	13.92	12.55	12.91	13.08	13.43	13.92
	8H	12.90	13.21	13.42	13.71	14.29	12.90	13.21	13.42	13.71	14.29