

Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P865753

Luminaire Tested: PRLX-2004-S-927-15L-L-U-S-X-X-BRSS-X

Issue Date: 8/20/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P865753  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2304-993-24)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 8/20/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: Prenalux  
Catalog Number: PRLX-2004-S-927-15L-L-U-S-X-X-BRSS-X  
Description: PRENTALUX 3D PRINTED PENDANT LED LUMINAIRE, SMALL LIGHT ENGINE, FLAT LENS, BELL WITH BRASS INTERIOR SHADE.  
LIGHT LEVEL 3  
Light Source: 2700K CCT, 90 CRI LEDS  
Ballast/Driver: -


**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 691.6 lumens  
Efficiency: N/A  
Efficacy: 44.3 lumens/watt  
Spacing Criteria (0/90/45): 1.06 / 1.06 / 1.02  
Luminous Opening: Circular (Dia: 0.92' x H: 0')  
CIE Type: Direct  
  
Input Watts (W): 15.6  
Input Voltage (V): 120  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: 0.5 HR  
Operation Time: 3 HR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P865753

CATALOG NUMBER: PRLX-2004-S-927-15L-L-U-S-X-X-BRSS-X

### Luminous Intensity Polar Plot

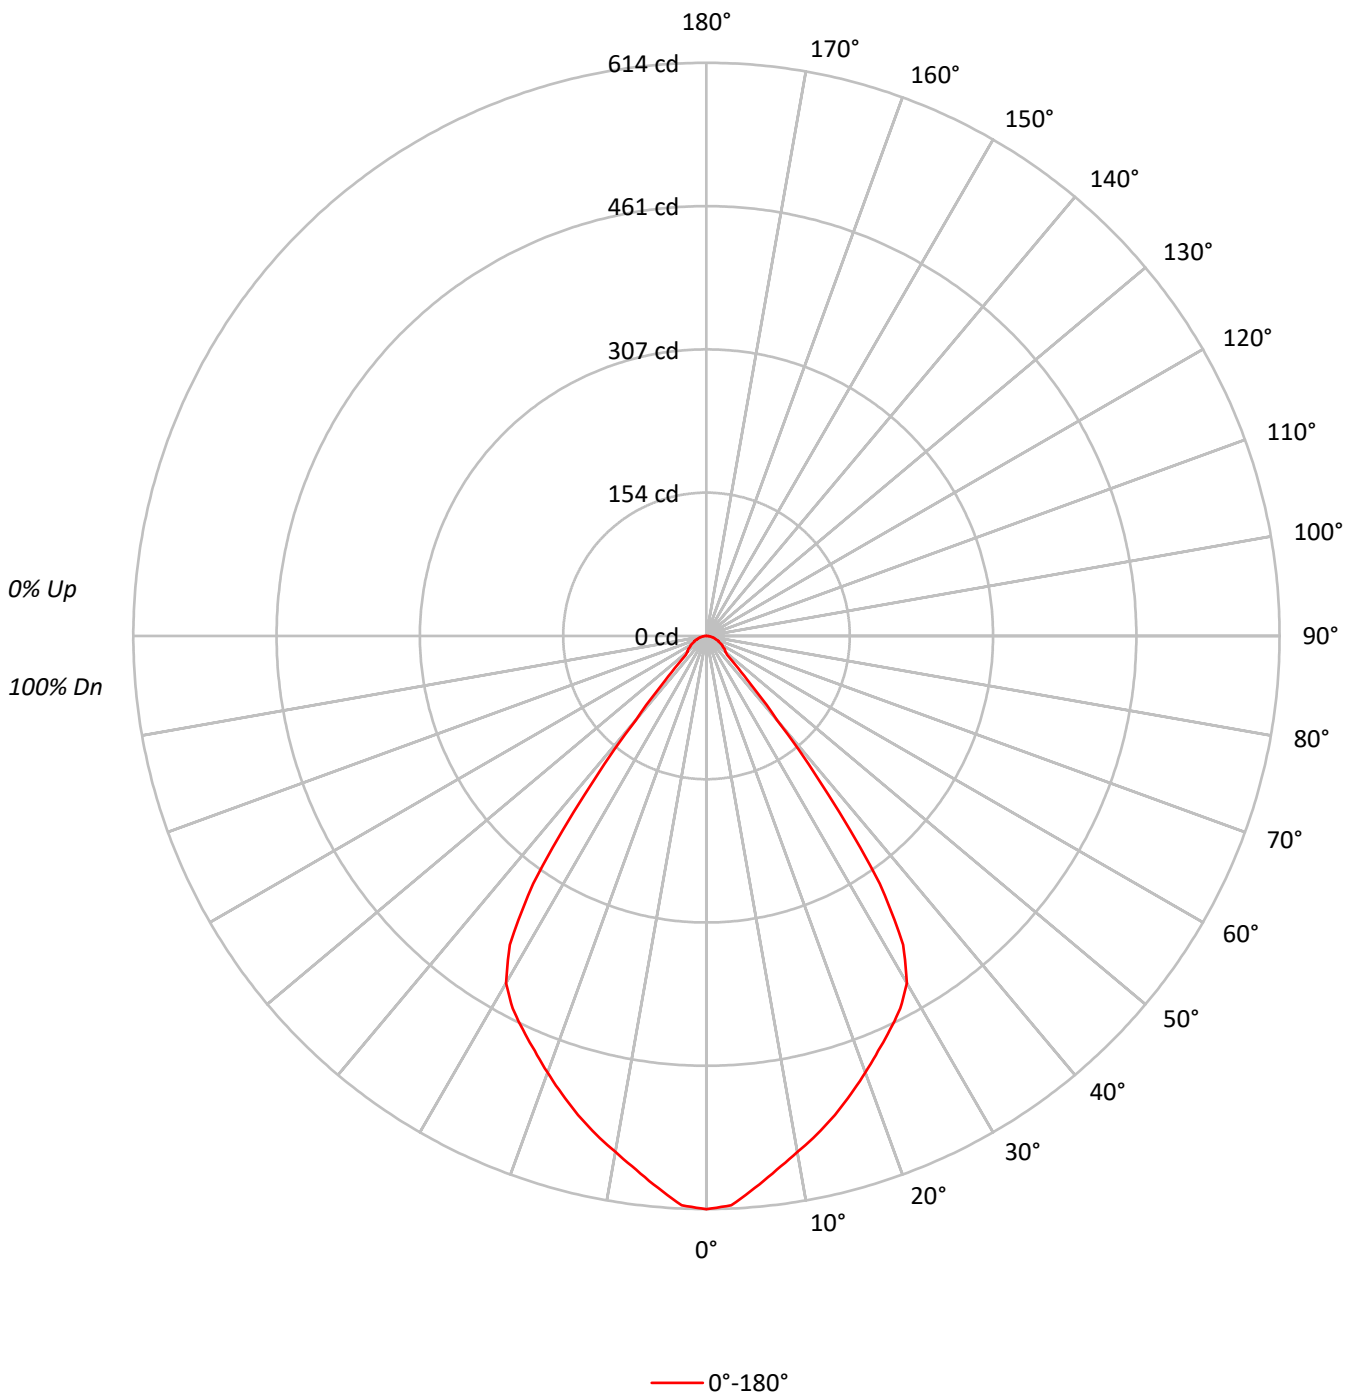



TEST NUMBER: P865753

CATALOG NUMBER: PRLX-2004-S-927-15L-L-U-S-X-X-BRSS-X

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	113	110	107	104	110	107	105	103	103	101	99	99	98	96	96	95	94	92
2	106	101	96	92	104	99	95	91	96	92	89	93	90	87	90	88	86	84
3	100	93	87	83	98	92	86	82	89	85	81	86	83	80	84	81	78	77
4	94	86	80	75	93	85	79	75	83	78	74	81	76	73	79	75	72	70
5	89	80	73	69	87	79	73	68	77	72	68	75	71	67	74	70	67	65
6	84	74	68	63	83	74	67	63	72	67	62	71	66	62	69	65	62	60
7	80	69	63	58	78	69	62	58	67	62	58	66	61	57	65	60	57	56
8	75	65	58	54	74	64	58	54	63	58	54	62	57	53	61	57	53	52
9	71	61	54	50	70	60	54	50	59	54	50	58	53	50	58	53	50	48
10	68	57	51	47	67	57	51	47	56	50	47	55	50	46	54	50	46	45

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	10016
5°	9720
10°	9296
15°	8971
20°	8639
25°	8375
30°	8087
35°	6447
40°	2502
45°	996
50°	670
55°	648
60°	626
65°	556
70°	515
75°	529
80°	451
85°	449

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 996 cd/sqm

TEST NUMBER: P865753

CATALOG NUMBER: PRLX-2004-S-927-15L-L-U-S-X-X-BRSS-X

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	55.7	8.0
10°-20°	149.5	21.6
20°-30°	214.3	31.0
30°-40°	185.1	26.8
40°-50°	40.7	5.9
50°-60°	20.4	2.9
60°-70°	14.7	2.1
70°-80°	8.7	1.3
80°-90°	2.6	0.4
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	419.4	60.6
0°-40°	604.5	87.4
0°-60°	665.6	96.2
0°-90°	691.6	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	691.6	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	614	
5°	594	56
15°	531	149
25°	465	214
35°	324	185
45°	43	41
55°	23	20
65°	14	15
75°	8	9
85°	2	3
90°	0	

TEST NUMBER: P865753

CATALOG NUMBER: PRLX-2004-S-927-15L-L-U-S-X-X-BRSS-X

**CANDELA DISTRIBUTION (FULL):**

0°	
0°	614.1
2.5°	610.5
5°	593.7
7.5°	576.9
10°	561.3
12.5°	546.9
15°	531.3
17.5°	514.5
20°	497.7
22.5°	480.9
25°	465.4
27.5°	449.8
30°	429.4
32.5°	392.2
35°	323.8
37.5°	214.7
40°	117.5
42.5°	69.6
45°	43.2
47.5°	30.0
50°	26.4
52.5°	25.2
55°	22.8
57.5°	20.4
60°	19.2
62.5°	16.8
65°	14.4
67.5°	13.2
70°	10.8
72.5°	9.6
75°	8.4
77.5°	7.2
80°	4.8
82.5°	3.6
85°	2.4
87.5°	1.2
90°	0.0



TEST NUMBER: P865753  
 CATALOG NUMBER: PRLX-2004-S-927-15L-L-U-S-X-X-BRSS-X

**CIE UGR TABLE:**

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	5.26	6.32	5.62	6.64	6.95	5.26	6.32	5.62	6.64	6.95
	3H	6.89	7.83	7.27	8.16	8.53	6.89	7.83	7.27	8.16	8.53
	4H	7.56	8.44	7.97	8.79	9.18	7.56	8.44	7.97	8.79	9.18
	6H	8.10	8.90	8.52	9.27	9.67	8.10	8.90	8.52	9.27	9.67
	8H	8.24	9.00	8.68	9.39	9.80	8.24	9.00	8.68	9.39	9.80
	12H	8.35	9.07	8.78	9.45	9.88	8.35	9.07	8.78	9.45	9.88
4H	2H	5.73	6.60	6.13	6.95	7.34	5.73	6.60	6.13	6.95	7.34
	3H	7.56	8.28	7.98	8.69	9.09	7.56	8.28	7.98	8.69	9.09
	4H	8.39	9.03	8.83	9.45	9.90	8.39	9.03	8.83	9.45	9.90
	6H	9.05	9.60	9.52	10.05	10.52	9.05	9.60	9.52	10.05	10.52
	8H	9.24	9.75	9.72	10.20	10.68	9.24	9.75	9.72	10.20	10.68
	12H	9.39	9.84	9.88	10.32	10.80	9.39	9.84	9.88	10.32	10.80
8H	4H	8.66	9.17	9.14	9.62	10.10	8.66	9.17	9.14	9.62	10.10
	6H	9.44	9.85	9.95	10.35	10.83	9.44	9.85	9.95	10.35	10.83
	8H	9.71	10.07	10.24	10.59	11.09	9.71	10.07	10.24	10.59	11.09
	12H	9.95	10.27	10.47	10.76	11.34	9.95	10.27	10.47	10.76	11.34
12H	4H	8.66	9.11	9.15	9.60	10.07	8.66	9.11	9.15	9.60	10.07
	6H	9.47	9.84	10.00	10.36	10.85	9.47	9.84	10.00	10.36	10.85
	8H	9.80	10.12	10.32	10.62	11.19	9.80	10.12	10.32	10.62	11.19