

Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P865799

Luminaire Tested: PRLX-2004-S-930-20L-G-U-S-X-X-WHHR-X

Issue Date: 8/20/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P865799  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2304-993-11)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 8/20/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: Prenalux  
Catalog Number: PRLX-2004-S-930-20L-G-U-S-X-X-WHHR-X  
Description: PRENTALUX 3D PRINTED PENDANT LED LUMINAIRE, SMALL LIGHT ENGINE, GLOBE LENS,  
BELL WITH WHITE INTERIOR SHADE.  
LIGHT LEVEL 4  
Light Source: 3000K CCT, 90 CRI LEDS  
Ballast/Driver: -


**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 1034.2 lumens  
Efficiency: N/A  
Efficacy: 47.4 lumens/watt  
Spacing Criteria (0/90/45): 1.18 / 1.18 / 1.21  
Luminous Opening: Circular (Dia: 0.92' x H: 0')  
CIE Type: Direct  
  
Input Watts (W): 21.8  
Input Voltage (V): 120  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: 0.5 HR  
Operation Time: 3 HR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P865799

CATALOG NUMBER: PRLX-2004-S-930-20L-G-U-S-X-X-WHHR-X

### Luminous Intensity Polar Plot

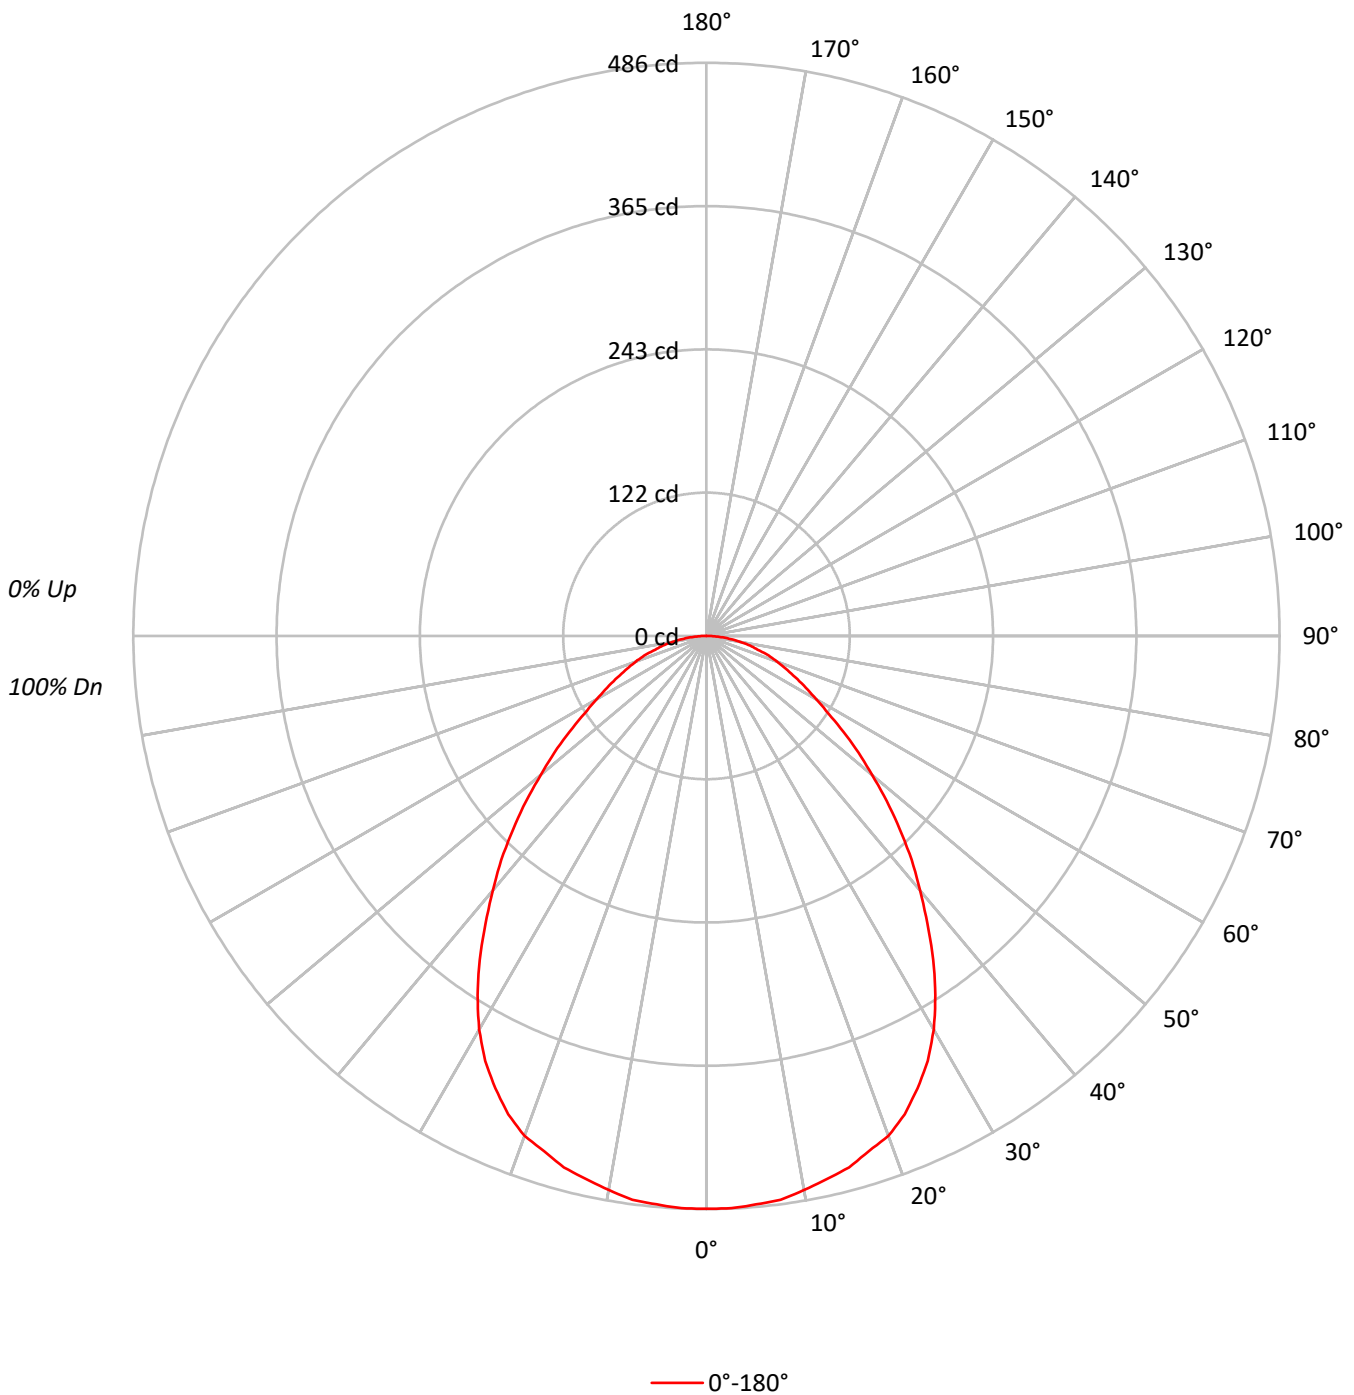



TEST NUMBER: P865799

CATALOG NUMBER: PRLX-2004-S-930-20L-G-U-S-X-X-WHHR-X

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	110	106	102	98	107	103	100	97	99	96	94	95	93	91	92	90	88	86
2	101	94	88	83	99	92	86	82	88	84	80	85	81	78	82	79	76	74
3	93	84	76	70	91	82	75	70	79	73	69	77	72	67	74	70	66	64
4	86	75	67	61	84	74	66	61	71	65	60	69	64	59	67	62	58	56
5	80	68	60	54	78	67	59	53	65	58	53	63	57	52	61	56	52	50
6	74	62	54	48	72	61	53	47	59	52	47	58	51	47	56	50	46	44
7	69	56	48	43	67	56	48	42	54	47	42	53	47	42	52	46	42	40
8	65	52	44	38	63	51	44	38	50	43	38	49	43	38	48	42	38	36
9	61	48	40	35	59	47	40	35	46	39	35	45	39	35	44	39	34	33
10	57	44	37	32	56	44	37	32	43	36	32	42	36	32	41	36	32	30

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	7922
5°	7923
10°	7900
15°	7879
20°	7830
25°	7620
30°	7258
35°	6676
40°	5998
45°	5342
50°	4649
55°	4029
60°	3497
65°	3203
70°	3047
75°	2829
80°	2761
85°	2582

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 5342 cd/sqm

TEST NUMBER: P865799

CATALOG NUMBER: PRLX-2004-S-930-20L-G-U-S-X-X-WHHR-X

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	46.0	4.4
10°-20°	131.5	12.7
20°-30°	194.3	18.8
30°-40°	208.8	20.2
40°-50°	178.8	17.3
50°-60°	127.7	12.3
60°-70°	83.2	8.0
70°-80°	48.8	4.7
80°-90°	15.3	1.5
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	371.8	35.9
0°-40°	580.6	56.1
0°-60°	887.0	85.8
0°-90°	1034.2	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1034.2	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	486	
5°	484	46
15°	467	131
25°	423	194
35°	335	209
45°	232	179
55°	142	128
65°	83	83
75°	45	49
85°	14	15
90°	0	

TEST NUMBER: P865799

CATALOG NUMBER: PRLX-2004-S-930-20L-G-U-S-X-X-WHHR-X

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	485.7
2.5°	485.7
5°	483.9
7.5°	482.2
10°	477.0
12.5°	471.8
15°	466.6
17.5°	458.0
20°	451.1
22.5°	439.0
25°	423.4
27.5°	406.2
30°	385.4
32.5°	361.2
35°	335.3
37.5°	307.6
40°	281.7
42.5°	257.5
45°	231.6
47.5°	207.4
50°	183.2
52.5°	162.5
55°	141.7
57.5°	122.7
60°	107.2
62.5°	95.1
65°	83.0
67.5°	72.6
70°	63.9
72.5°	55.3
75°	44.9
77.5°	38.0
80°	29.4
82.5°	20.7
85°	13.8
87.5°	6.9
90°	0.0



TEST NUMBER: P865799  
 CATALOG NUMBER: PRLX-2004-S-930-20L-G-U-S-X-X-WHHR-X

**CIE UGR TABLE:**

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	15.75	17.25	16.12	17.56	17.87	15.75	17.25	16.12	17.56	17.87
	3H	17.28	18.62	17.66	18.95	19.31	17.28	18.62	17.66	18.95	19.31
	4H	17.90	19.16	18.30	19.51	19.89	17.90	19.16	18.30	19.51	19.89
	6H	18.42	19.58	18.83	19.95	20.34	18.42	19.58	18.83	19.95	20.34
	8H	18.59	19.70	19.02	20.09	20.49	18.59	19.70	19.02	20.09	20.49
	12H	18.72	19.77	19.15	20.16	20.58	18.72	19.77	19.15	20.16	20.58
4H	2H	16.25	17.51	16.65	17.86	18.24	16.25	17.51	16.65	17.86	18.24
	3H	18.04	19.08	18.45	19.48	19.89	18.04	19.08	18.45	19.48	19.89
	4H	18.79	19.73	19.22	20.15	20.58	18.79	19.73	19.22	20.15	20.58
	6H	19.45	20.27	19.91	20.71	21.17	19.45	20.27	19.91	20.71	21.17
	8H	19.68	20.44	20.14	20.89	21.35	19.68	20.44	20.14	20.89	21.35
	12H	19.85	20.54	20.33	21.01	21.49	19.85	20.54	20.33	21.01	21.49
8H	4H	19.08	19.85	19.54	20.29	20.76	19.08	19.85	19.54	20.29	20.76
	6H	19.88	20.51	20.38	21.00	21.48	19.88	20.51	20.38	21.00	21.48
	8H	20.18	20.75	20.70	21.26	21.75	20.18	20.75	20.70	21.26	21.75
	12H	20.45	20.95	20.96	21.44	22.01	20.45	20.95	20.96	21.44	22.01
12H	4H	19.11	19.80	19.59	20.27	20.75	19.11	19.80	19.59	20.27	20.75
	6H	19.94	20.51	20.45	21.02	21.50	19.94	20.51	20.45	21.02	21.50
	8H	20.30	20.80	20.81	21.30	21.86	20.30	20.80	20.81	21.30	21.86