

Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P865803

Luminaire Tested: PRLX-2004-S-930-20L-L-U-S-X-X-WHHR-X

Issue Date: 8/20/2024

Test Information

Test Method: LM-79-2019
Report Number: P865803
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2304-993-23)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 8/20/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: Prenalux
Catalog Number: PRLX-2004-S-930-20L-L-U-S-X-X-WHHR-X
Description: PRENTALUX 3D PRINTED PENDANT LED LUMINAIRE, SMALL LIGHT ENGINE, FLAT LENS,
BELL WITH WHITE INTERIOR SHADE.
LIGHT LEVEL 4
Light Source: 3000K CCT, 90 CRI LEDS
Ballast/Driver: -

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 1809.5 lumens
Efficiency: N/A
Efficacy: 83.0 lumens/watt
Spacing Criteria (0/90/45): 1.13 / 1.13 / 1.07
Luminous Opening: Circular (Dia: 0.92' x H: 0')
CIE Type: Direct

Input Watts (W): 21.8
Input Voltage (V): 120
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: 0.5 HR
Operation Time: 3 HR
Ambient Temperature (°C): NR
Test Distance: 24 FT

TEST NUMBER: P865803

CATALOG NUMBER: PRLX-2004-S-930-20L-L-U-S-X-X-WHHR-X

Luminous Intensity Polar Plot

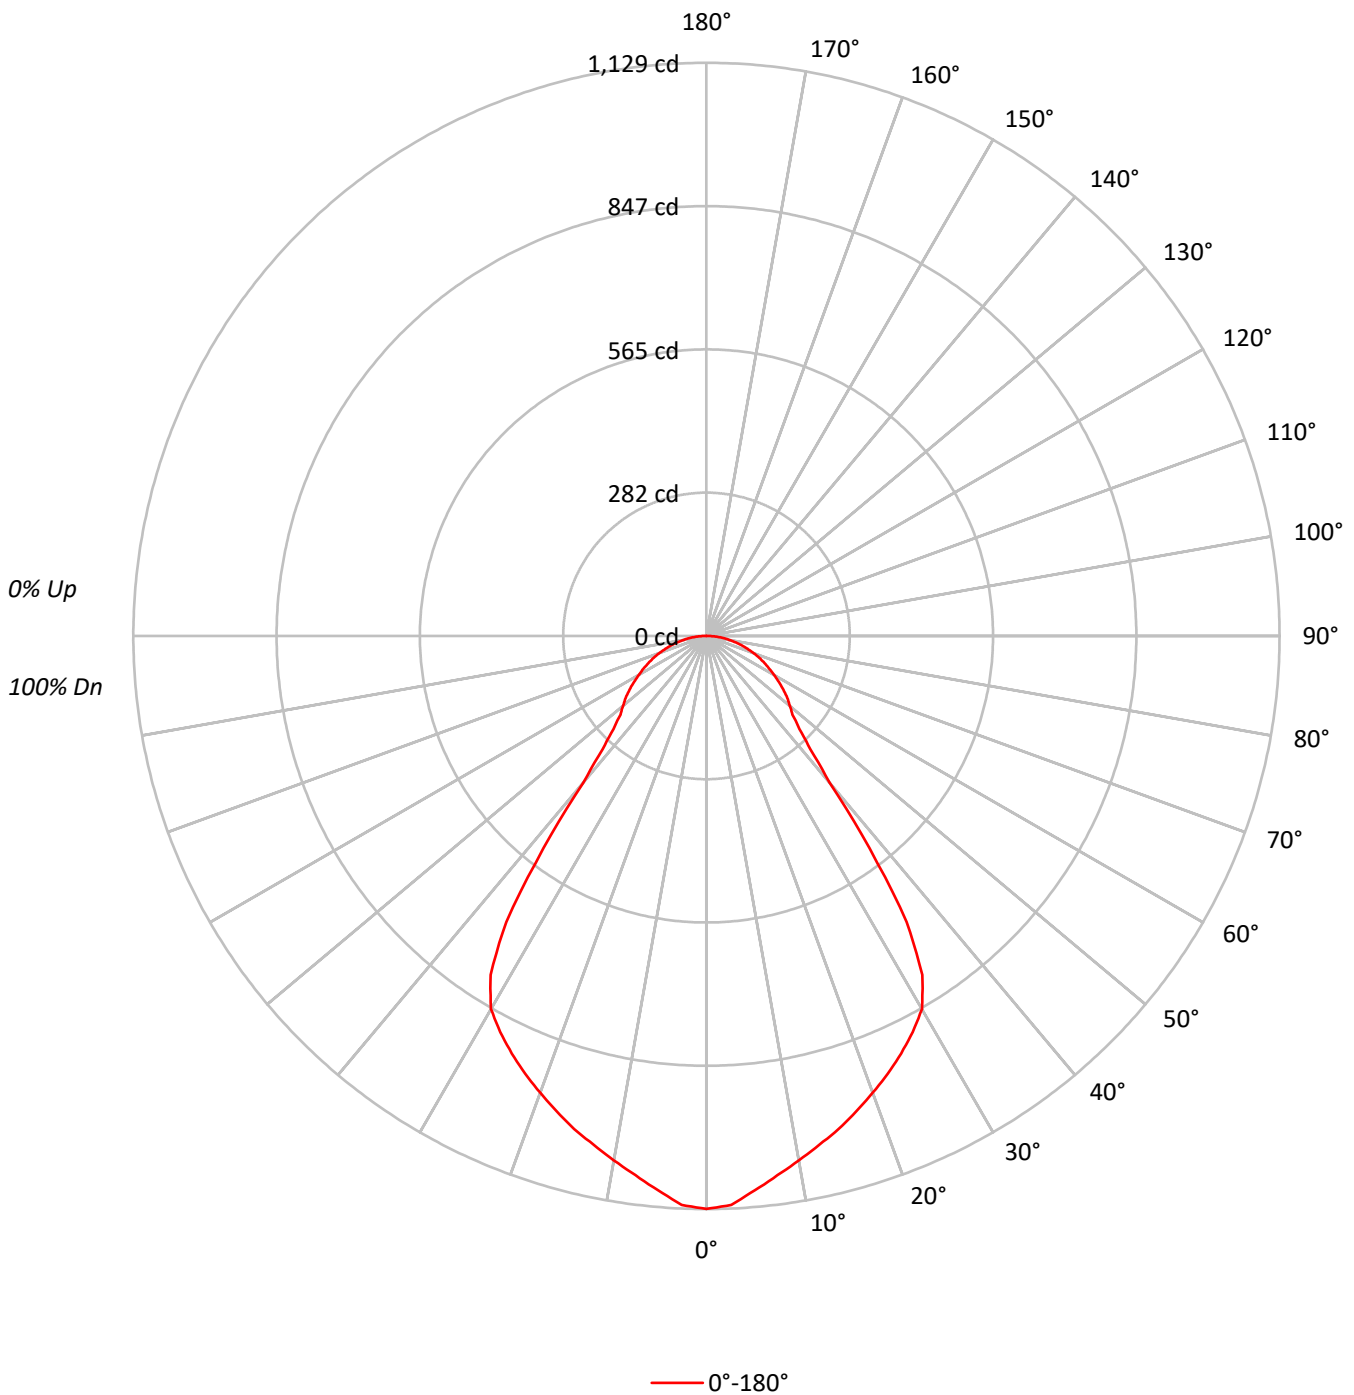



TEST NUMBER: P865803

CATALOG NUMBER: PRLX-2004-S-930-20L-L-U-S-X-X-WHHR-X

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	111	107	103	100	108	104	101	98	100	98	95	96	94	92	93	91	90	88
2	103	96	90	85	100	94	89	84	90	86	82	87	84	80	84	81	79	77
3	95	86	79	74	93	85	78	73	82	76	72	79	75	71	77	73	70	68
4	89	78	71	65	86	77	70	65	75	69	64	72	67	63	70	66	62	60
5	83	72	64	58	81	70	63	58	68	62	57	67	61	57	65	60	56	54
6	77	66	58	52	75	65	57	52	63	57	52	61	56	51	60	55	51	49
7	72	61	53	47	71	60	53	47	58	52	47	57	51	47	56	50	46	45
8	68	56	49	43	67	55	48	43	54	48	43	53	47	43	52	47	43	41
9	64	52	45	40	63	52	45	40	50	44	40	49	44	39	49	43	39	38
10	60	49	42	37	59	48	41	37	47	41	37	46	41	36	45	40	36	35

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	18408
5°	17941
10°	17375
15°	16985
20°	16619
25°	16330
30°	15982
35°	13697
40°	8023
45°	5979
50°	5438
55°	5258
60°	5017
65°	4870
70°	4697
75°	4575
80°	4386
85°	4211

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 5979 cd/sqm

TEST NUMBER: P865803

CATALOG NUMBER: PRLX-2004-S-930-20L-L-U-S-X-X-WHHR-X

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	103.2	5.7
10°-20°	283.4	15.7
20°-30°	417.8	23.1
30°-40°	405.3	22.4
40°-50°	208.8	11.5
50°-60°	165.2	9.1
60°-70°	124.9	6.9
70°-80°	76.2	4.2
80°-90°	24.7	1.4
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	804.4	44.5
0°-40°	1209.7	66.9
0°-60°	1583.7	87.5
0°-90°	1809.5	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1809.5	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1129	
5°	1096	103
15°	1006	283
25°	907	418
35°	688	405
45°	259	209
55°	185	165
65°	126	125
75°	73	76
85°	22	25
90°	0	

TEST NUMBER: P865803

CATALOG NUMBER: PRLX-2004-S-930-20L-L-U-S-X-X-WHHR-X

CANDELA DISTRIBUTION (FULL):

	0°
0°	1128.6
2.5°	1121.7
5°	1095.8
7.5°	1071.6
10°	1049.1
12.5°	1026.6
15°	1005.9
17.5°	981.7
20°	957.5
22.5°	933.3
25°	907.4
27.5°	879.7
30°	848.6
32.5°	791.6
35°	687.9
37.5°	527.1
40°	376.8
42.5°	302.5
45°	259.2
47.5°	229.9
50°	214.3
52.5°	200.5
55°	184.9
57.5°	169.4
60°	153.8
62.5°	140.0
65°	126.2
67.5°	112.3
70°	98.5
72.5°	84.7
75°	72.6
77.5°	58.8
80°	46.7
82.5°	34.6
85°	22.5
87.5°	10.4
90°	0.0



TEST NUMBER: P865803
 CATALOG NUMBER: PRLX-2004-S-930-20L-L-U-S-X-X-WHHR-X

CIE UGR TABLE:

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	16.23	17.60	16.60	17.91	18.22	16.23	17.60	16.60	17.91	18.22
	3H	18.06	19.28	18.43	19.61	19.97	18.06	19.28	18.43	19.61	19.97
	4H	18.79	19.93	19.19	20.28	20.66	18.79	19.93	19.19	20.28	20.66
	6H	19.36	20.42	19.77	20.78	21.18	19.36	20.42	19.77	20.78	21.18
	8H	19.57	20.57	20.00	20.96	21.37	19.57	20.57	20.00	20.96	21.37
	12H	19.72	20.68	20.15	21.06	21.49	19.72	20.68	20.15	21.06	21.49
4H	2H	16.83	17.97	17.23	18.32	18.70	16.83	17.97	17.23	18.32	18.70
	3H	18.87	19.82	19.28	20.23	20.63	18.87	19.82	19.28	20.23	20.63
	4H	19.74	20.60	20.17	21.02	21.46	19.74	20.60	20.17	21.02	21.46
	6H	20.45	21.20	20.92	21.64	22.11	20.45	21.20	20.92	21.64	22.11
	8H	20.72	21.42	21.19	21.86	22.33	20.72	21.42	21.19	21.86	22.33
	12H	20.93	21.54	21.41	22.02	22.50	20.93	21.54	21.41	22.02	22.50
8H	4H	20.05	20.75	20.52	21.19	21.66	20.05	20.75	20.52	21.19	21.66
	6H	20.92	21.49	21.42	21.98	22.46	20.92	21.49	21.42	21.98	22.46
	8H	21.27	21.79	21.79	22.30	22.79	21.27	21.79	21.79	22.30	22.79
	12H	21.58	22.03	22.09	22.52	23.09	21.58	22.03	22.09	22.52	23.09
12H	4H	20.08	20.70	20.57	21.18	21.66	20.08	20.70	20.57	21.18	21.66
	6H	20.98	21.50	21.50	22.01	22.50	20.98	21.50	21.50	22.01	22.50
	8H	21.41	21.86	21.92	22.35	22.92	21.41	21.86	21.92	22.35	22.92