

Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for  
Cooper Lighting Solutions

Brand: PrentaLux

Report Number: P865869

Luminaire Tested: PRLX-2004-S-940-15L-G-U-S-X-X-BRSS-X

Issue Date: 8/20/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P865869  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2304-993-12)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 8/20/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: Prenalux  
Catalog Number: PRLX-2004-S-940-15L-G-U-S-X-X-BRSS-X  
Description: PRENTALUX 3D PRINTED PENDANT LED LUMINAIRE, SMALL LIGHT ENGINE, GLOBE LENS,  
BELL WITH BRASS INTERIOR SHADE.  
LIGHT LEVEL 3  
Light Source: 4000K CCT, 90 CRI LEDS  
Ballast/Driver: -


**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 294.5 lumens  
Efficiency: N/A  
Efficacy: 18.9 lumens/watt  
Spacing Criteria (0/90/45): 1.17 / 1.17 / 1.16  
Luminous Opening: Circular (Dia: 0.92' x H: 0')  
CIE Type: Direct  
  
Input Watts (W): 15.6  
Input Voltage (V): 120  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: 0.5 HR  
Operation Time: 3 HR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT

TEST NUMBER: P865869

CATALOG NUMBER: PRLX-2004-S-940-15L-G-U-S-X-X-BRSS-X

### Luminous Intensity Polar Plot

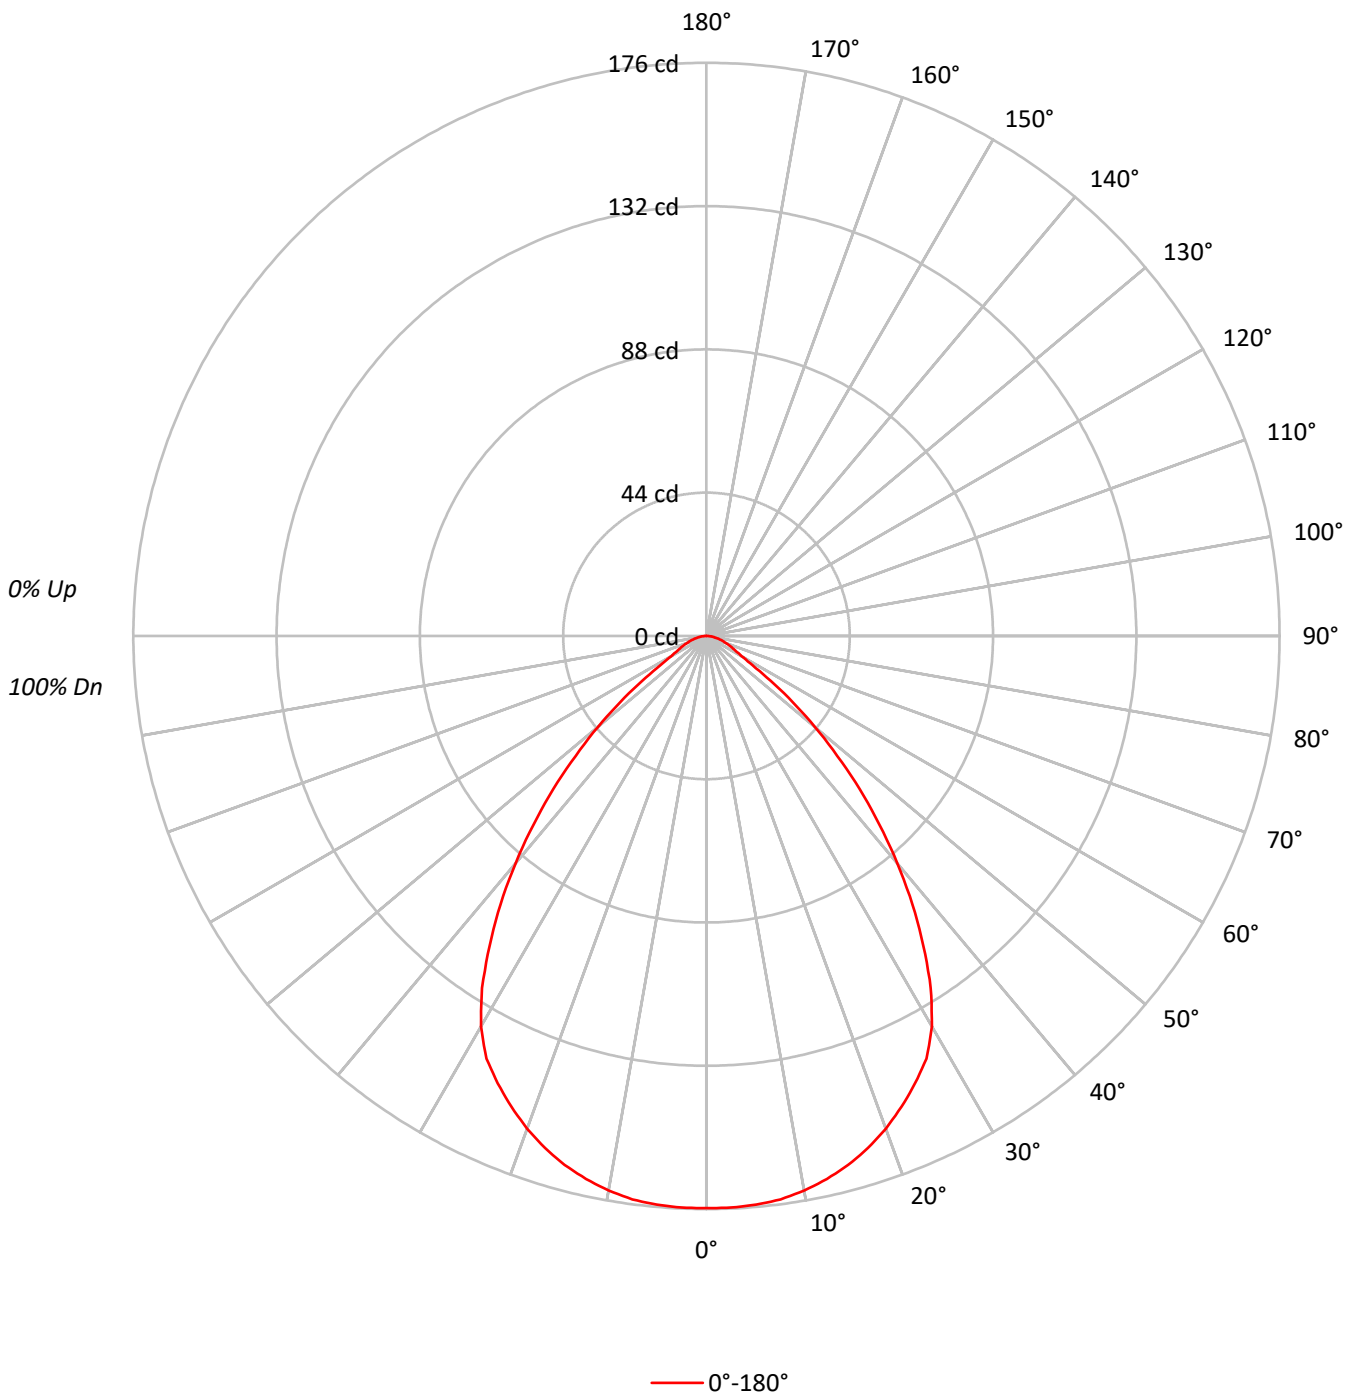



TEST NUMBER: P865869

CATALOG NUMBER: PRLX-2004-S-940-15L-G-U-S-X-X-BRSS-X

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	112	108	105	102	109	106	103	101	102	100	97	98	96	95	95	93	92	90
2	104	98	93	89	102	96	92	88	93	89	86	90	87	84	87	84	82	80
3	97	89	83	78	95	88	82	77	85	80	76	82	78	75	80	76	73	72
4	91	81	74	69	89	80	73	68	78	72	68	76	71	67	74	69	66	64
5	85	74	67	62	83	73	66	61	71	65	61	69	64	60	68	63	60	58
6	79	68	61	55	78	67	60	55	66	59	55	64	59	54	63	58	54	52
7	74	63	55	50	73	62	55	50	61	54	50	59	54	49	58	53	49	47
8	70	58	51	46	68	57	50	46	56	50	45	55	49	45	54	49	45	43
9	66	54	47	42	64	53	46	42	52	46	42	51	46	41	50	45	41	40
10	62	50	43	39	61	50	43	39	49	43	38	48	42	38	47	42	38	37

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	2866
5°	2870
10°	2864
15°	2840
20°	2794
25°	2728
30°	2607
35°	2312
40°	1942
45°	1534
50°	1101
55°	682
60°	404
65°	340
70°	300
75°	277
80°	235
85°	243

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 1534 cd/sqm

TEST NUMBER: P865869

CATALOG NUMBER: PRLX-2004-S-940-15L-G-U-S-X-X-BRSS-X

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	16.7	5.7
10°-20°	47.4	16.1
20°-30°	69.6	23.6
30°-40°	72.1	24.5
40°-50°	51.2	17.4
50°-60°	22.6	7.7
60°-70°	8.9	3.0
70°-80°	4.6	1.6
80°-90°	1.4	0.5
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	133.6	45.4
0°-40°	205.8	69.9
0°-60°	279.5	94.9
0°-90°	294.5	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	294.5	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	176	
5°	175	17
15°	168	47
25°	152	70
35°	116	72
45°	66	51
55°	24	23
65°	9	9
75°	4	5
85°	1	1
90°	0	

TEST NUMBER: P865869

CATALOG NUMBER: PRLX-2004-S-940-15L-G-U-S-X-X-BRSS-X

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	175.7
2.5°	175.7
5°	175.3
7.5°	174.5
10°	172.9
12.5°	170.8
15°	168.2
17.5°	164.9
20°	161.0
22.5°	156.5
25°	151.6
27.5°	146.3
30°	138.4
32.5°	128.2
35°	116.1
37.5°	103.9
40°	91.2
42.5°	78.6
45°	66.5
47.5°	54.5
50°	43.4
52.5°	33.4
55°	24.0
57.5°	16.7
60°	12.4
62.5°	10.4
65°	8.8
67.5°	7.6
70°	6.3
72.5°	5.3
75°	4.4
77.5°	3.5
80°	2.5
82.5°	2.0
85°	1.3
87.5°	0.6
90°	0.0

TEST NUMBER: P865869  
 CATALOG NUMBER: PRLX-2004-S-940-15L-G-U-S-X-X-BRSS-X

**CIE UGR TABLE:**

Reflectances:											
Ceiling		0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall		0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane		0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions		Viewed crosswise					Viewed endwise				
X=2H	Y=2H	6.44	7.74	6.81	8.05	8.36	6.44	7.74	6.81	8.05	8.36
	3H	7.35	8.49	7.73	8.82	9.19	7.35	8.49	7.73	8.82	9.19
	4H	7.71	8.77	8.11	9.12	9.51	7.71	8.77	8.11	9.12	9.51
	6H	7.97	8.95	8.39	9.32	9.71	7.97	8.95	8.39	9.32	9.71
	8H	8.06	8.99	8.49	9.38	9.78	8.06	8.99	8.49	9.38	9.78
	12H	8.13	9.02	8.57	9.40	9.83	8.13	9.02	8.57	9.40	9.83
4H	2H	6.67	7.73	7.07	8.08	8.47	6.67	7.73	7.07	8.08	8.47
	3H	7.79	8.66	8.21	9.06	9.47	7.79	8.66	8.21	9.06	9.47
	4H	8.28	9.05	8.71	9.47	9.92	8.28	9.05	8.71	9.47	9.92
	6H	8.66	9.32	9.12	9.77	10.24	8.66	9.32	9.12	9.77	10.24
	8H	8.79	9.41	9.26	9.86	10.33	8.79	9.41	9.26	9.86	10.33
	12H	8.90	9.45	9.39	9.94	10.41	8.90	9.45	9.39	9.94	10.41
8H	4H	8.42	9.04	8.89	9.49	9.96	8.42	9.04	8.89	9.49	9.96
	6H	8.89	9.40	9.39	9.90	10.38	8.89	9.40	9.39	9.90	10.38
	8H	9.10	9.55	9.62	10.07	10.56	9.10	9.55	9.62	10.07	10.56
	12H	9.29	9.70	9.80	10.19	10.76	9.29	9.70	9.80	10.19	10.76
12H	4H	8.41	8.96	8.90	9.44	9.92	8.41	8.96	8.90	9.44	9.92
	6H	8.90	9.36	9.42	9.88	10.37	8.90	9.36	9.42	9.88	10.37
	8H	9.16	9.57	9.68	10.07	10.64	9.16	9.57	9.68	10.07	10.64