

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for
Cooper Lighting Solutions

Brand: SHAPER

Report Number: P600683

Luminaire Tested: 215-90-30K-LL3-UNV-STD-X-X-WHHR-FL-X

Issue Date: 7/6/2022

Test Information

Test Method: LM-79-2019
Report Number: P600683
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G3-2203-582-13)
Test Lab: INNOVATION CENTER
Issue Date: 7/6/2022
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: SHAPER
Catalog Number: 215-90-30K-LL3-UNV-STD-X-X-WHHR-FL-X
Description: SHAPER PrentaLux 200 SERIES 3D PRINTED LUMINAIRE
Light Source: 3000K CCT, 90 CRI LEDS
Ballast/Driver: ELECTRONIC DRIVER

Summary


Lumens per Lamp: N/A
Luminaire Lumens: 1808.5 lumens
Efficiency: N/A
Efficacy: 103.9 lumens/watt
Spacing Criteria (0/90/45): 0.9 / 0.9 / 0.85
Luminous Opening: Circular (Dia: 1' x H: 0')
CIE Type: Direct

Input Watts (W): 17.4
Input Voltage (V): 120
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



TEST NUMBER: P600683
CATALOG NUMBER: 215-90-30K-LL3-UNV-STD-X-X-WHHR-FL-X

Luminous Intensity Polar Plot

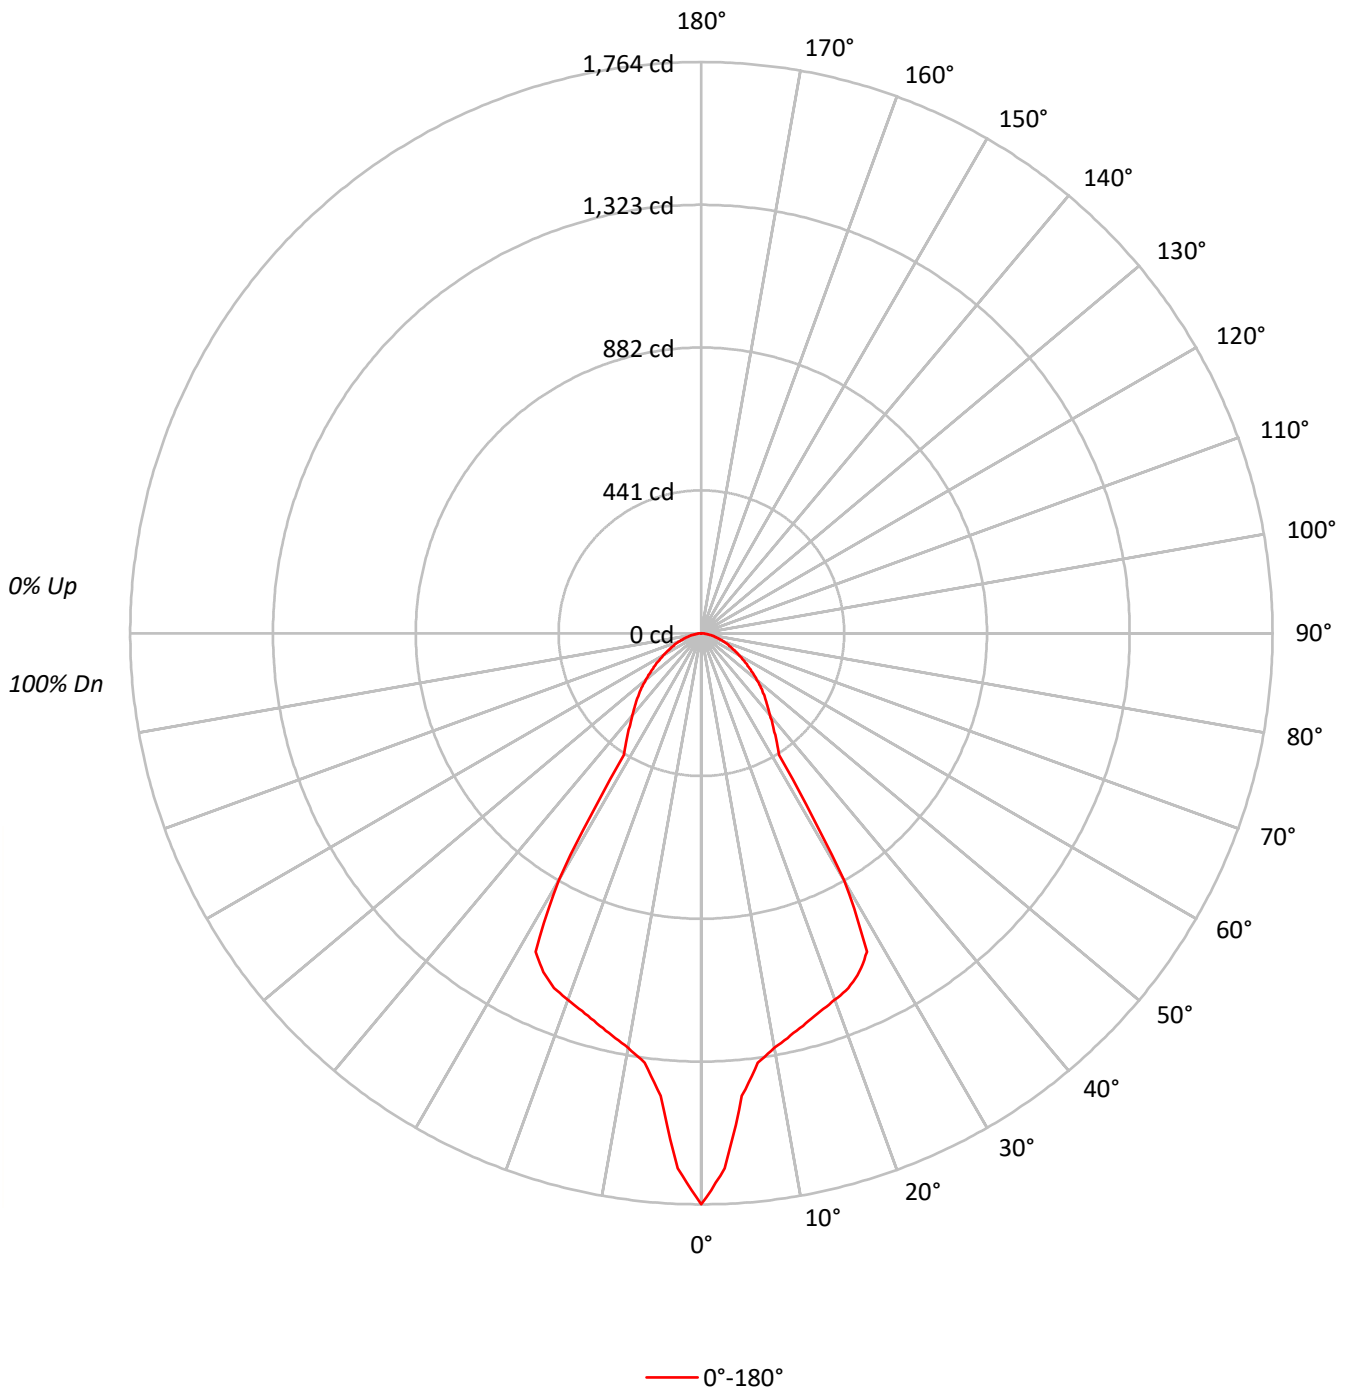



TEST NUMBER: P600683

CATALOG NUMBER: 215-90-30K-LL3-UNV-STD-X-X-WHHR-FL-X

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

| | | | | | | | | | | | | | | | | | | | | | | |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|----|----|----|---|
| RF | 20 | | | | | 20 | | | | | 20 | | | | | 20 | | | | | 20 | |
| RC | 80 | | | | | 70 | | | | | 50 | | | | | 30 | | | | | 10 | 0 |
| RW | 70 | 50 | 30 | 10 | 70 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 0 | |
| RCR | | | | | | | | | | | | | | | | | | | | | | |
| 0 | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | 106 | 106 | 106 | 102 | 102 | 102 | 100 | | | | |
| 1 | 112 | 108 | 105 | 102 | 109 | 106 | 103 | 100 | 102 | 99 | 97 | 98 | 96 | 94 | 95 | 93 | 92 | 90 | | | | |
| 2 | 104 | 98 | 93 | 89 | 102 | 96 | 92 | 87 | 93 | 89 | 86 | 90 | 87 | 84 | 87 | 84 | 82 | 80 | | | | |
| 3 | 97 | 89 | 83 | 78 | 95 | 88 | 82 | 77 | 85 | 80 | 76 | 82 | 78 | 75 | 80 | 77 | 74 | 72 | | | | |
| 4 | 91 | 82 | 75 | 70 | 89 | 81 | 74 | 69 | 78 | 73 | 68 | 76 | 71 | 67 | 74 | 70 | 67 | 65 | | | | |
| 5 | 85 | 75 | 68 | 63 | 84 | 74 | 67 | 62 | 72 | 66 | 62 | 70 | 65 | 61 | 69 | 64 | 61 | 59 | | | | |
| 6 | 80 | 70 | 62 | 57 | 79 | 69 | 62 | 57 | 67 | 61 | 56 | 66 | 60 | 56 | 64 | 59 | 56 | 54 | | | | |
| 7 | 76 | 65 | 57 | 52 | 74 | 64 | 57 | 52 | 62 | 56 | 52 | 61 | 56 | 52 | 60 | 55 | 51 | 50 | | | | |
| 8 | 71 | 60 | 53 | 48 | 70 | 60 | 53 | 48 | 58 | 52 | 48 | 57 | 52 | 48 | 56 | 51 | 47 | 46 | | | | |
| 9 | 68 | 56 | 49 | 45 | 66 | 56 | 49 | 45 | 55 | 49 | 45 | 54 | 48 | 44 | 53 | 48 | 44 | 43 | | | | |
| 10 | 64 | 53 | 46 | 42 | 63 | 52 | 46 | 42 | 51 | 46 | 42 | 51 | 45 | 41 | 50 | 45 | 41 | 40 | | | | |

AVERAGE LUMINANCE (cd/sqm):

| | |
|-----|-------|
| | 0° |
| 0° | 24170 |
| 5° | 19729 |
| 10° | 18090 |
| 15° | 17696 |
| 20° | 17573 |
| 25° | 17457 |
| 30° | 13961 |
| 35° | 6741 |
| 40° | 5907 |
| 45° | 5363 |
| 50° | 4761 |
| 55° | 4184 |
| 60° | 3659 |
| 65° | 3201 |
| 70° | 2793 |
| 75° | 2356 |
| 80° | 1642 |
| 85° | 582 |

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 5363 cd/sqm



TEST NUMBER: P600683

CATALOG NUMBER: 215-90-30K-LL3-UNV-STD-X-X-WHHR-FL-X

ZONAL LUMENS:

| Zone | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10° | 134.3 | 7.4 |
| 10°-20° | 352.6 | 19.5 |
| 20°-30° | 516.5 | 28.6 |
| 30°-40° | 280.7 | 15.5 |
| 40°-50° | 213.0 | 11.8 |
| 50°-60° | 157.6 | 8.7 |
| 60°-70° | 99.0 | 5.5 |
| 70°-80° | 47.3 | 2.6 |
| 80°-90° | 7.5 | 0.4 |
| 90°-100° | 0.0 | 0.0 |
| 100°-110° | 0.0 | 0.0 |
| 110°-120° | 0.0 | 0.0 |
| 120°-130° | 0.0 | 0.0 |
| 130°-140° | 0.0 | 0.0 |
| 140°-150° | 0.0 | 0.0 |
| 150°-160° | 0.0 | 0.0 |
| 160°-170° | 0.0 | 0.0 |
| 170°-180° | 0.0 | 0.0 |
| 0°-30° | 1003.4 | 55.5 |
| 0°-40° | 1284.1 | 71.0 |
| 0°-60° | 1654.7 | 91.5 |
| 0°-90° | 1808.5 | 100.0 |
| 90°-120° | 0.0 | 0.0 |
| 90°-150° | 0.0 | 0.0 |
| 90°-180° | 0.0 | 0.0 |
| 0°-180° | 1808.5 | 100.0 |

CANDELA DISTRIBUTION:

| | 0° | Flux |
|-----|------|------|
| 0° | 1764 | |
| 5° | 1434 | 134 |
| 15° | 1247 | 353 |
| 25° | 1154 | 517 |
| 35° | 403 | 281 |
| 45° | 277 | 213 |
| 55° | 175 | 158 |
| 65° | 99 | 99 |
| 75° | 44 | 47 |
| 85° | 4 | 7 |
| 90° | 0 | |



TEST NUMBER: P600683

CATALOG NUMBER: 215-90-30K-LL3-UNV-STD-X-X-WHHR-FL-X

CANDELA DISTRIBUTION (FULL):

| | 0° |
|-------|--------|
| 0° | 1763.6 |
| 2.5° | 1654.5 |
| 5° | 1434.1 |
| 7.5° | 1337.7 |
| 10° | 1299.9 |
| 12.5° | 1272.4 |
| 15° | 1247.2 |
| 17.5° | 1223.4 |
| 20° | 1204.9 |
| 22.5° | 1187.1 |
| 25° | 1154.4 |
| 27.5° | 1108.4 |
| 30° | 882.2 |
| 32.5° | 445.2 |
| 35° | 402.9 |
| 37.5° | 364.3 |
| 40° | 330.2 |
| 42.5° | 302.7 |
| 45° | 276.7 |
| 47.5° | 250.0 |
| 50° | 223.3 |
| 52.5° | 198.8 |
| 55° | 175.1 |
| 57.5° | 153.6 |
| 60° | 133.5 |
| 62.5° | 115.7 |
| 65° | 98.7 |
| 67.5° | 84.6 |
| 70° | 69.7 |
| 72.5° | 57.1 |
| 75° | 44.5 |
| 77.5° | 32.6 |
| 80° | 20.8 |
| 82.5° | 11.9 |
| 85° | 3.7 |
| 87.5° | 1.5 |
| 90° | 0.0 |

(END OF REPORT)